CRIMINAL INVESTIGATION COMMAND FIELD OPERATIONS BUILDING

(CATEGORY CODE 14114)

ADAPT-BUILD BIM PROTOTYPE OF THE RA 10-15 FIELD OPERATIONS FACILITY FOR THE REGION REPRESENTED BY FORT DRUM, NEW YORK

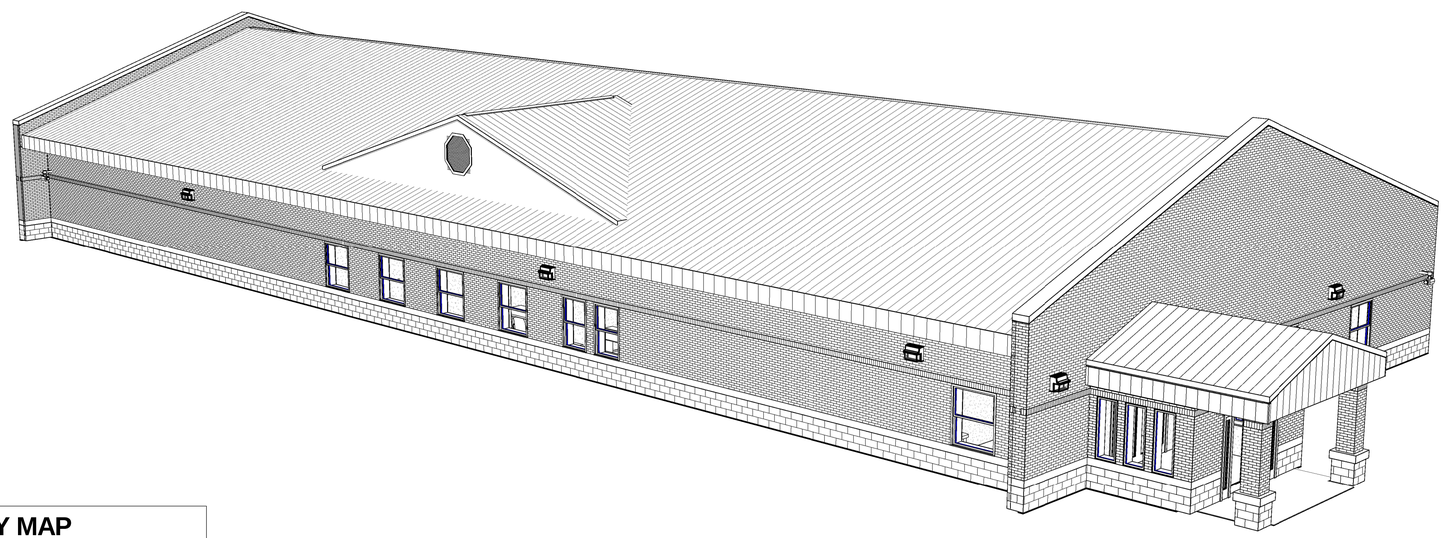

VICINITY MAP

SHEET INDEX

GENERAL

G-001	TITLE SHEET
G-002	SYMBOLS & ABBREVIATIONS
G-101	LIFE SAFETY GENERAL NOTES
G-102	LIFE SAFETY PLAN

CIVIL

C-101	SCHEMATIC SITE PLAN

STRUCTURAL

S-001	GENERAL STRUCTURAL NOTES, DESIGN LOADS & ABBREVIATIONS
S-002	GENERAL STRUCTURAL NOTES
S-003	WIND PRESSURE DIAGRAMS
S-101	FOUNDATION PLAN
S-102	FRAMING PLAN - GROUND FLOOR
S-103	FRAMING PLAN - TOP OF STEEL
S-104	FRAMING PLAN - ROOF
S-201	FRAMING ELEVATIONS
S-301	FOUNDATION SECTIONS
S-302	ROOF FRAMING SECTIONS
S-501	TYPICAL STRUCTURAL DETAILS
S-502	TYPICAL STRUCTURAL DETAILS
S-503	TYPICAL STRUCTURAL DETAILS
S-504	TYPICAL ATFP STRUCTURAL DETAILS
S-601	COLUMN SCHEDULES AND FOUNDATION SCHEDULES
S-602	FRAMING SCHEDULES

ARCHITECTURE

A-101	FLOOR PLAN
A-102	REFLECTED CEILING PLAN
A-103	ROOF PLAN
A-201	NORTH AND SOUTH ELEVATIONS
A-202	EAST AND WEST ELEVATIONS
A-301	BUILDING SECTIONS
A-311	WALL SECTIONS
A-401	ENLARGED PLANS
A-411	INTERIOR ELEVATIONS
A-412	INTERIOR ELEVATIONS
A-601	PARTITION TYPES
A-602	DOOR SCHEDULE
A-603	WINDOW SCHEDULE
A-604	FINISH SCHEDULE
A-703	SIGNAGE SCHEDULE
A-901	PERSPECTIVE VIEWS

INTERIORS

IF-101	FURNITURE PLAN
IF-102	FURNITURE SCHEDULE
IF-103	FURNITURE SCHEDULE

FIRE PROTECTION

FA-101	FIRE ALARM
FX-101	FIRE SPRINKLER PLAN

MECHANICAL

M-101	MECHANICAL FLOOR PLAN
M-102	HVAC ZONES

ELECTRICAL

EL-101	ELECTRICAL LIGHTING PLAN
EP-101	ELECTRICAL POWER PLAN
EP-601	ONE LINE DIAGRAM

TELECOMMUNICATIONS

T-101	TELECOMUNNICATIONS

WITH THE EXCEPTION OF THE CIVIL SHEETS, THESE SHEETS ARE CREATED WITHIN THE BUILDING INFORMATION MODELS DEVELOPED FOR THE PROJECT. THE ARCHITECTURE AND FURNITURE MODELS ARE 60% TO 65% COMPLETE. THE STRUCTURAL, MECHANICAL, AND ELECTRICAL MODELS ARE 30% TO 35% COMPLETE. THE CIVIL SHEETS ARE 10% COMPLETE.

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:
DESIGN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Designer
PLOT DATE: 11/2/2012 9:52:08 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
TITLE SHEET

SHEET IDENTIFICATION
G-001
SHEET OF 1

G-001-

DRAWING ABBREVIATIONS

A	
AB	ANCHOR BOLT
AD	AREA DRAIN
AC	AIR CONDITIONING
ACT	ACOUSTICAL CEILING TILE
ADD	ADDENDUM
ADD'L	ADDITIONAL
ADJ	ADJACENT
AFF	ABOVE FINISHED FLOOR
AGGR	AGGREGATE
AL ALUM	ALUMINUM
ALT	ALTERNATE
ANOD	ANODIZED
APPROX	APPROXIMATE
ARCH	ARCHITECTURAL
B	
B.M.	BENCH MARK
BD	BOARD
BETW	BETWEEN
BF	BACKFACE
BG	BUMPER GUARD
BL	BED LOCATOR
BL	BUILDING LINE
BLDG	BUILDING
BLKG	BLOCKING
BM	BEAM
BOT	BOTTOM
BR	BUMPER RAIL
BRG	BEARING
BSMT	BASEMENT
BU ROD	BACK-UP ROD
BUR	BUILT-UP ROOF
BW	BEARING WALL
C	
C	COMPACT PARKING SPACE
CDR	CARD READER
CEM	CEMENT
CER	CERAMIC
CG	CORNER GUARD
CIP	CAST IN PLACE
CJ	CONTROL JOINT
CJ	CONSTRUCTION JOINT
CL	CENTER LINE
CLG	CEILING
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL	COLUMN
COMM	COMMUNICATIONS
CONC	CONCRETE
CONN	CONNECTION
CONST	CONSTRUCTION
CONT	CONTINUOUS
COORD	COORDINATE
CPE	CHLORINATED POLYETHYLENE
CORR	CORRIDOR
CR	COLD ROLLED
CR	CRASH RAIL
CSK	COUNTERSUNK
CT	CERAMIC TILE
CTD	CENTERED
CTR	CENTER
CW	CURTAIN WALL
D	
D	DEPTH
DBA	DEFORMED BAR ANCHOR
DET	DETAIL
DIA	DIAMETER
DIAPH	DIAPHRAGM
DIM	DIMENSION
DJ	DEFLECTION JOINT
DL	DEAD LOAD
DN	DOWN
DRG	DRAWING
DS	DOWN SPOUT
DWGS	DRAWINGS
DWLS	DOWELS
E	
EA	EACH
EF	EACH FACE
EIFS	EXTERIOR INSULATION AND FINISH SYSTEM
EJ	EXPANSION JOINT
EL	ELEVATION
ELEC	ELECTRIC
ELEV	ELEVATOR
EOS	EDGE OF SLAB
EQ	EQUAL
EQUIP	EQUIPMENT
ESC	ESCALATOR
EW	EACH WAY
E CONT.	
EWC	ELECTRIC WATER COOLER
EXIST	EXISTING
EXP BLT	EXPANSION BOLT
EXT	EXTERIOR
F	
FD	FLOOR DRAIN
FDN	FOUNDATION
FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FF	FINISH FLOOR
FHC	FIRE HOSE CABINET
FIB	FIBERGLASS
FIN	FINISH
FLR	FLOOR
FS	FAR SIDE
FT	FOOT
FTG	FOOTING
FV	FIELD VERIFY
FVC	FIRE VALVE CABINET
G	
GA	GAUGE
GALV	GALVANIZED
GB	GRADE BEAM
GEN	GENERAL
GFRC	GLASS-FIBER REINFORCED CONCRETE
GI	GALVANIZED IRON
GL	GLASS
GM	GLAZED MASONRY UNIT
GND	GROUND
GR	GRADE
GRG	GLASS-REINFORCED GYPSUM
GYP BD	GYPSUM BOARD
H	
HB	HOSE BIB
HDW	HARDWARE
HDWD	HARDWOOD
HK	HOOK
HM	HOLLOW METAL
HOR, HORIZ	HORIZONTAL
HP	HIGH POINT
HR	HOUR
HS	HEADED STUD
HSKP	HOUSEKEEPING
HT	HEIGHT
HW	HAND WASH
I	
IBC	INTERNATIONAL BUILDING CODE
ID	INSIDE DIAMETER
INSUL	INSULATION
INT	INTERIOR
K	
K	KIPS (1000 LB)
KO	KNOCK-OUT
KP	KICKPLATE
KPD	KEYPAD
KSF	KIPS PER SQUARE FOOT
L	
L	ANGLE
LAV	LAVATORY
LG	LONG
LKB	LOCKABLE
LL	LIVE LOAD
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
LOC	LOCATION
LP	LOW POINT
LT	LIGHT
LWC	LIGHTWEIGHT CONCRETE
M	
MAS	MASONRY
MAT'L	MATERIAL
MAX	MAXIMUM
MECH	MECHANICAL
MEMB	MEMBRANE
MEP	MECHANICAL, ELECTRICAL AND PLUMBING
MFG	MANUFACTURER
MGO	MEDICAL GAS OUTLET
MIN	MINIMUM
M	
MISC	MISCELLANEOUS
MO	MASONRY OPENING
MOB	MEDICAL OFFICE BUILDING
MOD BIT	MODIFIED BITUMEN
MOD	MODIFIED
MSL	MEAN SEA LEVEL
MTL	METAL
N	
NA	NOT AVAILABLE
NIC	NOT IN CONTRACT
NOA	NOTICE OF ACCEPTANCE
NOM	NOMINAL
NS	NEAR SIDE
NTS	NOT TO SCALE
NWC	NORMAL WEIGHT CONCRETE
O	
OA	OVER ALL
OC	ON CENTER
OD	OUTSIDE DIAMETER
OD	OVERFLOW DRAIN
OFCI	OWNER FURNISHED, CONTRACTOR INSTALLED
OFOI	OWNER FURNISHED, OWNER INSTALLED
OH	OPPOSITE HAND
OPNG	OPENING
OPP	OPPOSITE
OSF	OUTSIDE FACE
P	
P LAM	PLASTIC LAMINATE
PC	PRECAST CONCRETE
PCF	POUNDS PER CUBIC FOOT
PCP	PORTLAND CEMENT PLASTER
PENT	PENTHOUSE
PL	PROPERTY LINE
PL	PLATE
PLUMB	PLUMBING
PLYWD	PLYWOOD
PP	PUSH PLATE
POL	POLISHED
PORT CEM	PORTLAND CEMENT
PR	PAIR
PREFAB	PREFABRICATED
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PT	POINT
PT	PNEUMATIC TUBE
PTD	PAINTED
R	
R	RISER
RAD	RADIUS
RAF	RUBBERIZED ASPHALT FLASHING
RAM	RUBBERIZED ASPHALT MEMBRANE
RAU	RUBBERIZED ASPHALT UNDERLAYMENT
RCP	REFLECTED CEILING PLAN
RD	ROOF DRAIN
REBAR	REINFORCING BAR
RECP	RECEPTACLE
REF	REFER OR REFERENCE
REINF	REINFORCING
RELOC	RELOCATE/ RELOCATED
REQ'D	REQUIRED
RFVC	RECESSED FIRE VALVE CABINET
RM	ROOM
RO	ROUGH OPENING
S	
SAB	SOUND ATTENUATION BLANKET
SBC	STANDARD BUILDING CODE
SCHED	SCHEDULE
SDL	SUPERIMPOSED DEAD LOAD
SECT	SECTION
S/H	SINGLE HUNG
SHWR	SHOWER
SIM	SIMILAR
SO	STRUCTURAL OPENING
SOG	SLAB ON GRADE
SP	STAND PIPE
SPA	SPACE, SPACING
SPEC	SPECIFICATION
SQ	SQUARE
SS	STAINLESS STEEL
SSF	SOLID SURFACE
STA	STATION
STC	SOUND TRANSMISSION CLASS
STD	STANDARD
STIFF	STIFFENER
STIR	STIRRUP
STL	STEEL
STRUC	STRUCTURAL
SYM	SYMMETRICAL
SYS	SYSTEM
T	
T	TREAD
T&B	TOP AND BOTTOM
TC	TOP OF CURB
TEL	TELEPHONE
TEMP	TEMPERATURE
THK	THICK
TLT	TOILET
TO	TOP OF
TOB	TOP OF BEAM
TOC	TOP OF CONCRETE
TOF	TOP OF FOOTING
TOP	TOP OF PARAPET
TOS	TOP OF SLAB
TOSTL	TOP OF STEEL
TRSH CH	TRASH CHUTE
TW	TOP OF WALL
TYP	TYPICAL
U	
U/C	UNDER COUNTER
U/G	UNDERGROUND
UNO	UNLESS NOTED OTHERWISE
V	
VAR	VARIES
VCT	VINYL COMPOSITION TILE
VERT	VERTICAL
VEST	VESTIBULE
VWC	VINYL WALL COVERING
W	
W/	WITH
W/C	WHEEL CHAIR
W/O	WITHOUT
W	WIDTH
WP	WATERPROOF(ING)
WD	WOOD
WF	WIDE FLANGE
WL	WIND LOAD
WP	WORK POINT
WPO	WORK POINT - POINT OF ORIGIN
WP1	WORK POINT - NUMBERED
WWF	WELDED WIRE FABRIC

LEGEND

NUMBERING SYSTEM:

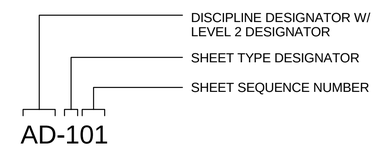

MATERIALS

- CONCRETE/ PRECAST CONCRETE
- SOIL
- SAND, EIFS FINISH COAT, OR CEMENT PLASTER
- BRICK
- CMU
- STONE
- FIBERGLASS BATT INSULATION
- FIBERGLASS SEMI RIGID INSULATION
- MINERAL WOOL SEMI RIGID INSULATION
- EXPANDED POLYSTYRENE RIGID INSULATION
- EXTRUDED POLYSTYRENE RIGID INSULATION
- POLYISOCYANURATE RIGID INSULATION
- GYPSUM BOARD
- EXTERIOR GYPSUM SHEATHING
- EXTERIOR CEMENT BOARD
- COATED GLASS MAT WATER RESISTANT GYP BD
- PLYWOOD
- COVER BOARD

DRAWING SYMBOLS

- ROOM NAME 100 — ROOM NAME/NUMBER
- 01 — COLUMN LINE DESIGNATOR
- X — ACCESSORY
- 1 — DEMOLITION NUMBERED NOTES
- 1 A-100 — BUILDING/WAL L SECTION
- 1 A-201 — ELEVATION
- 1 A-100 — SECTION CUT
- 1 A-100 — PLAN, BLOW-UP DETAIL
- INTERIOR ELEVATION INDICATOR
- DIRECTION INDICATOR
- EDGE OF SLAB
- FACE OF BUILDING
- 9'-0" AFF — CEILING HEIGHT
- FIRE EXTINGUISHER
- CORNER GUARDS
- BG — BUMPER RAIL
- HR — HAND RAIL
- WALL PROTECTION
- 3 — WALL TYPE
- BUILDING EXPANSION JOINT
- CMU WALL
- NEW WALL
- EXISTING WALL
- DEMO WALL
- 1 HOUR FIRE WALL
- SMOKE RESISTIVE PARTITION

CEILING SYMBOLS

- GYP BD CEILING
- SUPPLY AIR
- RETURN AIR
- EXHAUST AIR
- ACCESS PANEL
- WALL MOUNTED FLUORESCENT FIXTURE
- EXIT SIGNS - HATCH INDICATES EXIT TEXT AND ARROW INDICATES DIRECTION
- SD — SMOKE DETECTOR
- S — SPEAKER
- PROJECTOR

ELECTRICAL SYMBOLS

- PANELBOARD
- DUPLEX RECEPTACLE "GFCI" - GROUND FAULT CIRCUIT INTERRUPTER
- QUADRUPLEX RECEPTACLE "WP" - WEATHER PROOF
- RECESSED 2X4 FLUORESCENT LIGHT
- RECESSED 2X2 FLUORESCENT LIGHT
- STRIP FLUORESCENT LIGHT
- PENDANT FLUORESCENT LIGHT
- DOWNLIGHT
- OCCUPANCY SENSOR
- LIGHT SWITCH "3" - THREE WAY "4" - FOUR WAY "D" - DIMMER
- EMERGENCY WALL LIGHT
- TELEPHONE OUTLET "2" - TWO (2) GANG PORT
- TELEPHONE/DATA OUTLET
- SIPRnet OUTLET
- DATA OUTLET
- TV — CATV OUTLET

NOTES

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer	DATE: SEPTEMBER 12, 2012
DRAWN BY: Author	CKD BY: Checker
SBMT BY: Approver	SOLICITATION NO.:
PLOT SCALE:	PLOT DATE: 1/12/2012 8:52:39 AM
	CONTRACT NO.:
SIZE: 22" x 34"	FILE NAME:
	FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
SYMBOLS & ABBREVIATIONS

SHEET IDENTIFICATION
G-002
SHEET OF 1

G-002-

BUILDING CODE SUMMARY

UFC BUILDING CODE SUMMARY:
RA 10-15 BUILDING:

1. CLASSIFICATION OF OCCUPANCY:
Primary Occupancy: Business
Secondary Occupancy: N/A

2. CONSTRUCTION TYPE:
Allowed type of Construction: ☒ I-A ☒ I-B ☒ II-A ☒ II-B ☒ III-B ☒ IV-HT ☒ V-A ☐ V-B

Proposed type of Construction: II-B

3. HEIGHT & AREA (ALLOWABLE/ACTUAL):
Allowable height: 55'-0" (4 story)
Allowable Area: 23,000 SF

4. ALLOWABLE INCREASES (With Automatic Sprinkler Protection):
Allowable Height Increase: 20" (1 story)
Allowable Area Increase: 300%

5. HEIGHT AND AREA INCREASE:

Allowable height: 75'-0" (5 story)
Actual height: 30' (1 story)
Allowable Area: 23,000 SF + 69,000 SF = 92,000 SF
Actual Area: 9,550 SF

6. EXTERIOR PROTECTION:
Required Exterior Exposure Protection:
Less than 10 ft. - 1 Hour
10 ft. or more - 0 Hour
Provided Exterior Exposure Protection: 0 Hour

7. INTERIOR PROTECTION:
Required Interior Fire Rated Occupancy Separations: NOT REQUIRED

8. FIRE AREA SEPARATIONS:
Required Internal Fire Area Separations: NOT REQUIRED
Provided Internal Fire Area Separations: NOT REQUIRED

UFC BUILDING CODE SUMMARY:
VEHICLE PROCESSING BUILDING:

1. CLASSIFICATION OF OCCUPANCY:
Primary Occupancy: MODERATE HAZARD STAGE (GROUP S-1)
Secondary Occupancy: N/A

2. CONSTRUCTION TYPE:
Allowed type of Construction:

Proposed type of Construction: II-B

3. HEIGHT & AREA (ALLOWABLE/ACTUAL):
Allowable height: 55'-0" (3 story)
Allowable Area: 17,500 SF

4. ALLOWABLE INCREASES (With Automatic Sprinkler Protection):
Allowable Height Increase: 20" (1 story)
Allowable Area Increase: 300%

5. HEIGHT AND AREA INCREASE:

Allowable height: 55'-0" (3 story)
Actual height: 30' (1 story)
Allowable Area: 17,500 SF + 52,250 SF = 70,000 SF
Actual Area: 768 SF

6. EXTERIOR PROTECTION:
Required Exterior Exposure Protection:
Less than 10 ft. - 1 Hour
10 ft. or more - 0 Hour
Provided Exterior Exposure Protection: 0 Hour

7. INTERIOR PROTECTION:
Required Interior Fire Rated Occupancy Separations: NOT REQUIRED

8. FIRE AREA SEPARATIONS:
Required Internal Fire Area Separations: NOT REQUIRED
Provided Internal Fire Area Separations: NOT REQUIRED

LIFE SAFETY CODE SUMMARY

UFC LIFE SAFETY CODE SUMMARY:

1. CLASSIFICATION OF OCCUPANCY:
Primary Occupancy: BUSINESS
Secondary Occupancy: N/A
2. OCCUPANT LOAD FACTOR:
NFPA 101 Table 7.3.1.2: BUSINESS (B) 100 GSF/PERSON
ASSEMBLY (A-3) 15 NSF/PERSON
STORAGE (S) 300 GSF/PERSON
MECH./ELEC. (M/E) 300 GSF/PERSON

3. EXITS:
Required Number of Exits: 2
Provided Number of Exits: 3

4. MEANS OF EGRESS:
Required Capacity of Means of Egress: 25"
Provided Capacity of Means of Egress: 138"
(Total of 119 persons multiply 0.2 = 24")

5. EXITS:
Required Separation of Exits: 57' (<1/3 overall diagonal of 170')
Provided Separation of Exits: 82'
Required Arrangement of Horizontal Exits: NA
Provided Arrangement of Horizontal Exits: NA
Maximum Allowable Travel Distance: 300-0"
Maximum Actual Travel Distance: 122'-3"
Maximum Allowable Common Path of Travel: 75'-0"
Maximum Actual Common Path of Travel: 63'-0"
Maximum Allowable Dead-End Corridor: 50'
Maximum Actual Dead-End Corridor: 18'-0"

FLOOR, ROOM AND/OR SPACE DESIGNATION	MINIMUM NUMBER OF EXITS		MAXIMUM TRAVEL DISTANCE		ARRANGEMENT MEANS OF EGRESS (SECTION 7.5)	
	REQUIRED	SHOWN ON PLANS	ALLOWABLE TRAVEL DISTANCE (TABLE A.7.6)	ACTUAL TRAVEL DISTANCE SHOWN ON PLANS	REQUIRED DISTANCE BETWEEN EXIT DOORS	ACTUAL DISTANCE SHOWN ON PLANS
RA 10-15	2	3	300'	122'-3"	57'	82'

6. EXIT DISCHARGE
Required Discharge from Exits: 119
Provided Discharge from Exits: 690

7. FIRE RATED SEPARATIONS
Required Fire Rated Separation of Exits: N/A
Provided Fire Rated Separation of Exits: N/A
Required Fire Rated Separation of Exit Access: N/A
Provided Fire Rated Separation of Exit Access: N/A

8. HAZARDOUS AREAS:
Required Fire Rated Separation of Hazardous Areas: SMOKE RESISTIVE
Provided Fire Rated Separation of Hazardous Areas: SMOKE RESISTIVE

9. INTERIOR FINISHES:
Flame Spread/Smoke Development Ratings of Interior Finishes:
Exit Access Corridors - Class A or B
Other Spaces - Class A, B or C

10. SMOKE CONTROL:
Requirements (if any) for Smoke Control Systems Based on the specific
Occupancy Chapter and Building Design Considerations: NA

11. LOCKING ARRANGEMENTS:

Delayed-Egress Locks- Installed In Accordance With NFPA 101:7.2.1.6.1
7.2.1.6.1 Delayed-Egress Locking Systems. Approved, listed, delayed-egress locking systems shall be permitted to be installed on door assemblies serving low and hazard contents in buildings protected throughout by an approved, supervised automatic sprinkler system in accordance with Section 9.7, and where permitted in chapters 11 through 43, provided that the following criteria are met:

(1) The provisions of 7.2.1.6.2 for access-controlled egress door assemblies with delayed-egress locking systems.
(2) The door leaves shall unlock upon actuation of one of the following:
  (a) Approved, supervised automatic sprinkler system in accordance with Section 9.7
  (b) Not more than one heat detector of an approved, supervised automatic fire detection system in accordancce with Section 9.6
  (c) Not more than two smoke detectors of an approved, supervised automatic fire detection system in accordance with Section 9.6
(3) The door leaves shall unlock upon loss of power controlling the lock or lock mechanism.
(4)* An irreversible process shall release the lock within 15 seconds, or 30 seconds where approved by the authority having jurisdiction, upon application of a force to the release device required in 7.2.1.5.9 under the following conditions:
  (a) The force shall not be required to exceed 15 lbf (67 N)
  (b) The force shall not be required to be continuously applied for more than 3 seconds.
  (c) The initiation of the release process shall activate an audible signal in the vicinity of the door opening.
  (d) Once the lock has been released by the application of force to the releasing device, relocking shall be by manual means only.
(5)* A readily visible, durable sign in letters not less than 1 in,(25mm) high and not less than 1/8 in. (3.2 mm) in stroke width on a contrasting background that reads as listed below shall be located on the door leaf adjacent to the release device:

PUSH UNTIL ALARM SOUNDS
DOOR CAN BE OPENED IN 15 SECONDS

ROOM AREA AND OCCUPANCY SCHEDULE

ROOM DATA				OCCUPANCY DATA		
Number	Name	Area	Volume	Type	Load Factor	LOAD TOTAL
141	ADMIN / OPS ROOM	670 SF	6028 CF	B	100	7
126	ARMS VAULT	64 SF	576 CF			
131	CORRIDOR	772 SF	6952 CF	NA		
139	CORRIDOR	128 SF	1150 CF	NA		
102	CORRIDOR	141 SF	1266 CF	NA		
105	CORRIDOR	220 SF	1984 CF	NA		
114	CORRIDOR	455 SF	4096 CF	NA		
120	CORRIDOR	121 SF	1092 CF	NA		
110	CRIMINAL INTELLIGENCE CENTER ROOM	297 SF	2676 CF	B	100	3
130	CRIMINAL INVESTIGATOR OFFICE	154 SF	1389 CF	B	100	2
133	DRUG SUPPRESSION TEAM OFFICE	154 SF	1387 CF	B	100	2
134	DRUG SUPPRESSION TEAM OFFICE	154 SF	1387 CF	B	100	2
123	DUTY AGENT OFFICE	153 SF	1374 CF	B	100	2
129	ELECTRICAL ROOM	134 SF	1202 CF	M/E	300	1
001	ENTRY VESTIBULE	132 SF	1184 CF	NA		
121	EVIDENCE CUSTODIAN OFFICE	168 SF	1516 CF	B	100	2
122	EVIDENCE DEPOSITORY ROOM	497 SF	4477 CF	S	300	2
124	EVIDENCE PROCESSING	169 SF	1522 CF	B	100	2
132	INVESTIGATIVE OPS TECH OFFICE	156 SF	1403 CF	B	100	2
142	JANITOR	51 SF	460 CF	NA		
109	LARGE INTERVIEW ROOM	254 SF	2282 CF	B	100	3
128	MECHANICAL ROOM	439 SF	3955 CF	M/E	300	2
103	MEN	153 SF	1379 CF	B	100	2
106	MULTI-PURPOSE LOUNGE	496 SF	4461 CF	A-3	15	34
117	OBSERVATION ROOM	143 SF	1285 CF	B	100	2
113	PHOTO ID ROOM	131 SF	1179 CF	B	100	2
115	POLYGRAPH EXAM OFFICE	104 SF	936 CF	B	100	2
116	POLYGRAPH EXAM ROOM	108 SF	968 CF	B	100	2
140	RECYCLE CLOSET	39 SF	348 CF	S	300	1
107	SHOWER	120 SF	1076 CF	B	100	2
112	SMALL INTERVIEW ROOM	139 SF	1250 CF	B	100	2
111	SMALL INTERVIEW ROOM	141 SF	1269 CF	B	100	2
108	SPECIAL AGENT IN CHARGE	199 SF	1790 CF	B	100	2
135	SPECIAL AGENT OFFICE	154 SF	1387 CF	B	100	2
136	SPECIAL AGENT OFFICE	154 SF	1387 CF	B	100	2
137	SPECIAL AGENT OFFICE	148 SF	1333 CF	B	100	2
138	SPECIAL AGENT OFFICE	165 SF	1484 CF	B	100	2
119	SUSPECT TOILET	44 SF	394 CF	B	100	1
118	SUSPECT WAITING ROOM	159 SF	1433 CF	B	100	2
125	TABLE OF ORGANIZATION AND EQUIPMENT STORAGE	517 SF	4657 CF	S	300	2
127	TELECOM ROOM	144 SF	1294 CF	M/E	300	1
003	VESTIBULE NORTH	66 SF	591 CF	NA		
002	VESTIBULE WEST	64 SF	573 CF	NA		
101	VISITOR WAITING AREA	251 SF	2258 CF	A-3	15	17
104	WOMEN	157 SF	1412 CF	B	100	2
	TOTAL NET AREA=	9278 SF	83498 CF	TOTAL OCCUPANCY LOAD=118		

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer | DATE: SEPTEMBER 12, 2012
DRAWN BY: Author | CKD BY: Checker | SOLICITATION NO.:
SBMT BY: Approver | PLOT DATE: 11/2/2012 8:32:59 AM | CONTRACT NO.:
PLOT SCALE: | FILE NUMBER:
SIZE: 22" x 34" | FILE NAME:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
LIFE SAFETY GENERAL NOTES

SHEET IDENTIFICATION
G-101
SHEET OF

G-101-

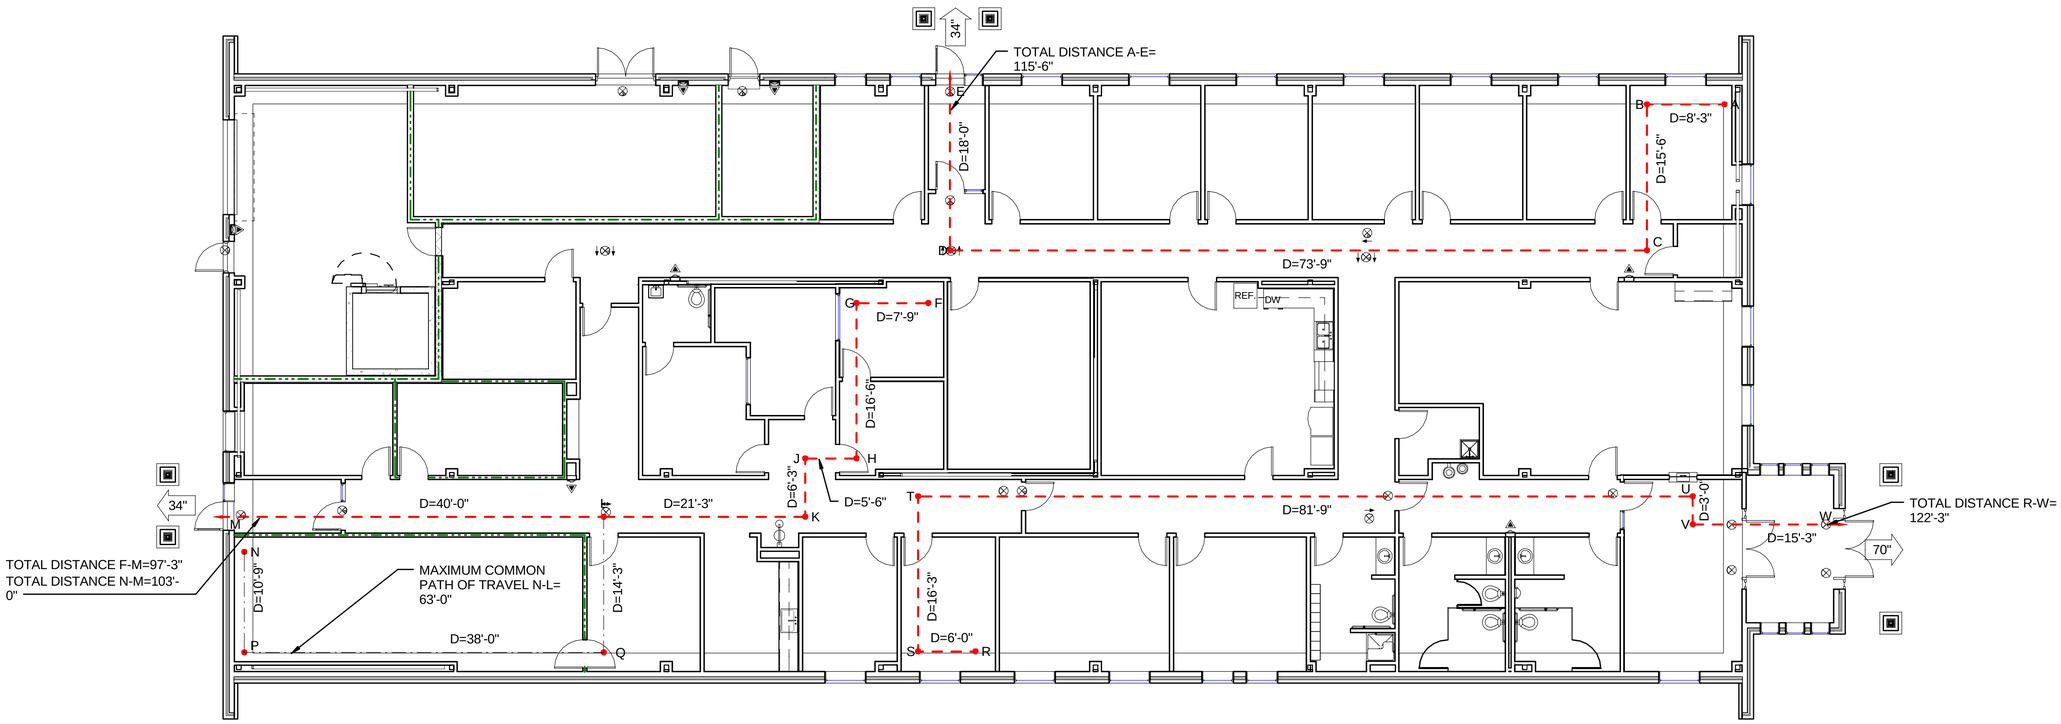

A1 LIFE SAFETY PLAN
1/8" = 1'-0"

PLAN NORTH

LEGEND

- XX" - CLEAR EXIT WIDTH
- TRAVEL DISTANCE
- COMMON PATH OF TRAVEL
- SMOKE RESISTIVE PARTITION
- FIRE EXTINGUISHER
- EXIT SIGN

8 6 4 2 0 8 16

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER: 2262-06014
DESIGN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Designer
PLOT DATE: 1 1/2/2012 8:33:01 AM
PLOT SCALE: 1 Vertex
SIZE: 22" x 34"
FILE NAME: EGRESS ROUTE PLAN

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
LIFE SAFETY PLAN

SHEET IDENTIFICATION
G-102
SHEET 22 OF 1

A I 1- G-102- xxx

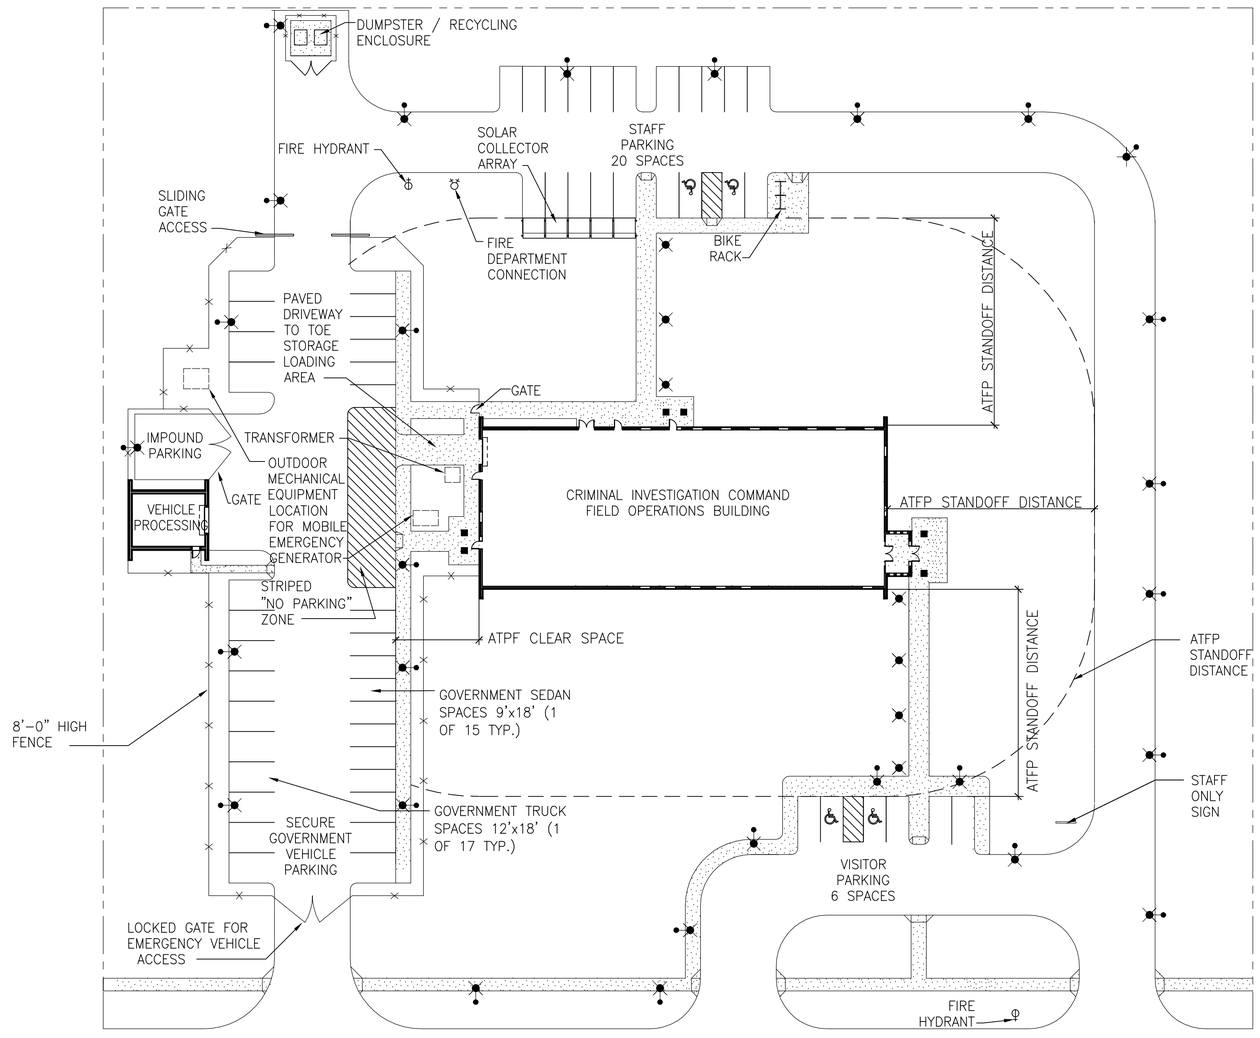

A2 SITE PLAN
1" = 30'

PLAN NORTH

LEGEND

POLE MOUNTED LIGHTING FIXTURE NOMINAL HEIGHT 25 FEET

BOLLARD LIGHTING FIXTURE NOMINAL HEIGHT 36 INCHES

30' 15' 5' 0' 15' 30' 60'
SCALE: 1"=30'

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER: -

DESIGN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Approver
PLOT DATE: 1/31/2012 4:20:00 PM
PLOT SCALE: 1:1
SIZE: 22" x 34"
FILE NAME: -

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY

SCHEMATIC SITE PLAN

SHEET IDENTIFICATION
C-101
SHEET OF x

C101- XXX

GENERAL NOTES

LOAD CRITERIA

1. STRUCTURE IS DESIGNED IN ACCORDANCE WITH THE INTERNATIONAL BUILDING CODE, 2009 EDITION.
ASCE 7-05 - AMERICAN SOCIETY OF CIVIL ENGINEERS, 2005 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES.
AISC - AMERICAN INSTITUTE OF STEEL CONSTRUCTION, MANUAL OF STEEL CONSTRUCTION, THIRTEENTH EDITION.
AISC 360-05 - AMERICAN INSTITUTE OF STEEL CONSTRUCTION, SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS, WITH COMMENTARY.
ACI 318-08 - ACI INTERNATIONAL 2008 BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE AND COMMENTARY.
UFC 3-301-01 - UNIFIED FACILITIES CRITERIA, STRUCTURAL ENGINEERING 2010.
UFC 4-010-01 - UNIFIED FACILITIES CRITERIA, DOD MINIMUM ANTITERRORISM STANDARDS FOR BUILDINGS 2003 WITH 2007 REVISION.

2. DESIGN LIVE LOADS (REDUCED AS ALLOWED BY THE BUILDING CODE):

ROOF	20 PSF	
DESIGN SNOW LOAD:		
GROUND SNOW LOAD,	Pg	70 PSF
SLOPED ROOF SNOW LOAD,	Ps	58.8 PSF
EXPOSURE FACTOR,	Ce	1.0
ROOF THERMAL FACTOR,	Ct	1.2
IMPORTANCE FACTOR,	Is	1.0
DESIGN WIND LOADS:		
BASIC WIND SPEED,	V	90 MPH (THREE SECOND GUST)
IMPORTANCE FACTOR,	Iw	1.00
EXPOSURE	C	
INTERNAL PRESSURE COEFF	GCpi	+/-0.18 (ENCLOSED BUILDING)

3. DESIGN SEISMIC LOADS ARE BASED ON THE FOLLOWING DATA:

MAPPED SHORT PERIOD SPECTRAL RESPONSE ACCELERATION,	Ss 30.0%g
MAPPED 1-SEC PERIOD SPECTRAL RESPONSE ACCELERATION,	S1 8.0%g
SHORT PERIOD DESIGN SPECTRAL RESPONSE ACCELERATION,	Sds 0.312
1-SEC PERIOD DESIGN SPECTRAL RESPONSE ACCELERATION,	Sd1 0.128
OCCUPANCY CATEGORY	II
SEISMIC DESIGN CATEGORY	B
SITE CLASS	D
BASIC STRUCTURAL SYSTEM	STEEL FRAMING
BASIC SEISMIC-FORCE-RESISTING SYSTEM	
ORDINARY STEEL MOMENT FRAME	
RESPONSE MODIFICATION FACTOR,	R = 3
DEFLECTION AMPLIFICATION FACTOR,	Cd = 3.25
IMPORTANCE FACTOR	Ie = 1.00
SEISMIC RESPONSE COEFFICIENT	Cs = 0.104
ANALYSIS PROCEDURE	
EQUIVALENT LATERAL FORCE	
DESIGN BASE SHEAR	Cs x W

FOUNDATIONS

1. THE FOUNDATION DESIGN IS BASED ON THE GEOTECHNICAL ENGINEERING REPORT BY _____, DATED _____.

2. FOOTINGS SHALL BE FOUNDED ON QUALIFIED VIRGIN SOIL OR ON ENGINEERED FILL AT THE ELEVATIONS SHOWN ON PLAN. ALL UNSUITABLE FOUNDATION MATERIAL SHALL BE REMOVED AND REPLACED WITH STRUCTURAL FILL UP TO THE DESIGNED BOTTOM OF FOOTING ELEVATION. SOLID BEARING CONDITION SHALL BE CERTIFIED BY THE GEOTECHNICAL ENGINEER PRIOR TO REBAR PLACEMENT.

FOR GRAVITY LOADS (DEAD AND LIVE LOADS): STRIP AND COLUMN FOOTINGS SUPPORTED ON UNDISTURBED NATIVE SOIL STRATUM OR STRUCTURAL FILL WITH PROPER COMPACTION CAN BE DESIGNED FOR NET ALLOWABLE SOIL BEARING CAPACITIES OF 2,000 POUNDS PER SQUARE FOOT (PSF), RESPECTIVELY FOR SERVICE LOADS.

MINIMUM SOIL COVER TO BOTTOM OF FOOTING SHALL BE 7 FEET FOR FROST PROTECTION.

3. NO FOUNDATION CONCRETE SHALL BE INSTALLED UNTIL ALL FOUNDATION WORK HAS BEEN COORDINATED WITH UNDERGROUND UTILITIES. REPORT TO OWNER FOR ANY CONFLICT BETWEEN FOUNDATION AND UTILITY LINES. OBTAIN OWNER APPROVED SOLUTIONS BEFORE PROCEEDING.

4. TO MINIMIZE WEATHERING, THE LAST 6 INCHES OF EXCAVATION FOR ALL FOOTINGS SHALL BE MADE IMMEDIATELY PRIOR TO PLACEMENT OF FOOTINGS.

5. CFX.X AND WFX.X INDICATE FOOTING TYPES. SEE FOOTING SCHEDULE FOR SIZE AND REINFORCING. UNLESS NOTED OTHERWISE, THE CENTERLINES OF ALL COLUMN FOOTINGS SHALL BE LOCATED ON CENTERLINES OF CONCRETE PEDESTAL OR STEEL COLUMN WHICHEVER IS IN DIRECT CONNECTION WITH THE FOOTING.

CONCRETE

1. CONCRETE STRENGTH:

FOOTINGS	f'c = 4,000 psi
FOUNDATION WALLS AND PEDESTALS	f'c = 4,000 psi
GROUND FLOOR SLAB	f'c = 4,000 psi
COMPOSITE CONCRETE FLOOR SLAB	f'c = 4,000 psi
ALL CONCRETE NOT OTHERWISE SPECIFIED	f'c = 4,000 psi

2. REINFORCING BARS
ASTM A 615 GRADE 60, DEFORMED — fy = 60 KSI

3. REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 318. DEVELOPMENT AND SPLICE LENGTHS ARE IN TENSION UNLESS NOTED OTHERWISE.

4. CONTINUOUS REINFORCING IN WALLS AND SLABS MAY BE SPLICED, AS REQUIRED, PROVIDING BARS ARE OF THE LONGEST PRACTICABLE LENGTH AND SPLICES ARE SHOWN ON REINFORCING SHOP DRAWINGS. WHEREVER POSSIBLE, SPLICES SHALL BE STAGGERED. FIELD CUTTING OF REINFORCEMENT WILL NOT BE PERMITTED.

5. PROVIDE CONCRETE COVER FOR REINFORCING AS SPECIFIED BELOW. IN NO CASE SHALL REINFORCEMENT COVER BE LESS THAN THE REQUIREMENTS OF ACI 301.

CONCRETE DEPOSITED AGAINST THE GROUND	3"
CONCRETE EXPOSED TO EARTH OR WEATHER	2"
BEAMS AND COLUMNS	1 ½"
SLABS AND WALLS	1"

6. PROVIDE DOWELS TO MATCH REINFORCEMENT SIZE AND SPACING INDICATED FOR ALL STRUCTURAL ELEMENTS, UNLESS NOTED OTHERWISE.

7. MAJOR CONSTRUCTION JOINTS, IF ANY, ARE SHOWN ON THE DRAWINGS. INTERMEDIATE JOINTS IN WALLS, SLABS, AND FLOOR FRAMING ARE NOT SHOWN. CONSTRUCTION JOINTS MAY BE ADDED, OMITTED OR RELOCATED IF PROPERLY DETAILED ON SHOP DRAWINGS AND APPROVED BY THE DOR.

8. SEE ARCHITECTURAL AND MECHANICAL DRAWINGS FOR LOCATIONS OF OPENINGS AND SLEEVES IN CONCRETE WALLS AND SUPPORTED FLOORS. SPREAD REINFORCEMENT AT OPENINGS AND SLEEVES UNLESS NOTED OTHERWISE. DO NOT CUT REINFORCEMENT. SEE TYPICAL REINFORCEMENT DETAILS FOR OPENINGS IN SLABS AND WALLS FOR ADDITIONAL REQUIREMENTS.

9. CONCRETE WALLS SHALL BE TEMPORARILY BRACED AGAINST EARTH PRESSURE AND OTHER FORCES UNTIL FLOOR SLABS ARE IN PLACE AND HAVE ATTAINED REQUIRED STRENGTHS.

10. FOUNDATION WALLS SHALL BE CAST IN ALTERNATE PANELS NOT TO EXCEED 30 FEET IN LENGTH.

11. PROVIDE WATERSTOPS IN ALL CONSTRUCTION JOINTS AT OR BELOW GRADE. PROVIDE WATERSTOPS IN EXPANSION JOINTS AND CONSTRUCTION JOINTS OF LIQUID□CONTAINING STRUCTURES AND WHERE REQUIRED TO PREVENT INFILTRATION OF GROUND WATER.

12. DEPRESS FLOOR SLABS AS REQUIRED; SEE ARCHITECTURAL DRAWINGS FOR LOCATION AND DEPTH OF DEPRESSED AREAS.

13. CHAMFER EDGES OF PERMANENTLY EXPOSED CONCRETE SURFACES 3/4-INCH, UNLESS NOTED OTHERWISE.

CONCRETE SLAB ON GRADE

1. COMPACTED SOIL IS TO PROVIDE A SATISFACTORY SUBGRADE FOR THE LOAD BEARING CONCRETE SLAB ON GRADE. BACKFILL MATERIAL SHALL BE GRAVELLY SOILS, WELL-GRADED SANDS, AND SAND-GRAVEL MIXTURES RELATIVELY FREE OF PLASTIC FINES.

2. FILL AND BACKFILL SHALL BE COMPACTED TO A MINIMUM OF 95% AASHTO T-180C DENSITY AND SHALL CONFORM TO ABOVE REFERENCED GEOTECHNICAL ENGINEER'S REQUIREMENTS.

3. PROVIDE MINIMUM 4" THICK POROUS FILL DIRECTLY UNDER VAPOR BARRIER TO PREVENT WATER CAPILLARY ACTION.

4. UNLESS NOTED OTHERWISE, ISOLATION JOINTS SHALL BE USED AT JUNCTIONS WITH WALLS AND COLUMNS, USE ½" THICK PREMOLDED JOINTS FULL DEPTH OF SLAB.

5. UNLESS NOTED OTHERWISE, PLACE CONTROL JOINTS AT CENTER LINE OF COLUMNS. PROVIDE INTERMEDIATE JOINTS IF COLUMN SPACING IS GREATER THAN 20 FT. IN ANY CASE JOINT SPACING SHALL NOT BE GREATER THAN 15 FT. IN SIDE WALKS TOOLED JOINTS SHALL BE SPACED AS THE WIDTH OF THE SIDEWALK.

6. CONTROL JOINT DEPTH SHALL BE ¼ OF SLAB THICKNESS. JOINTS SHALL BE SAWED WITHIN 24 HOURS AFTER CONCRETING.

7. VAPOR BARRIER, OVERLAPPED 6" AT JOINTS, AND WITH A PERMEANCE OF LESS THAN 0.3% PERMS IN ACCORDANCE WITH ASTM E-98 SHALL BE PROVIDED DIRECTLY UNDER INTERIOR SLAB. WHERE NO VAPOR BARRIER IS USED, THE SUBGRADE MUST BE DAMPENED WITH WATER IN ADVANCE OF CONCRETING. STANDING WATER ON THE SUBGRADE AND/OR ANY MUDDY OR SOFT SPOT IS NOT PERMITTED.

8. ANY STRUCTURAL MEMBER PENETRATING SLAB ON GRADE IS TO BE ISOLATED WITH ½" PRE-MOLDED JOINT FILLER COMPLYING WITH ASTM D-1752, TYPE I.

9. PREMATURE FINISHING IS NOT ALLOWED. IMMEDIATE FOLLOWING FLOATING, TROWELLING WITH STEEL TROWELS SHOULD BE COMMENCED IF REQUIRED. BROOMING SHALL BE AFTER THE STEEL TROWELLING OPERATION.

10. SLAB FINISH TYPE: INSIDE BUILDING – STEEL TROWELED; OUTSIDE SLAB – BROOMED, UNLESS NOTED OTHERWISE.

MASONRY

1. DESIGN MASONRY ASSEMBLAGE STRENGTH, F'M = 1,500 PSI. NET AREA COMPRESSIVE STRENGTH OF CONCRETE MASONRY UNITS SHALL BE A MINIMUM OF 1,900 PSI.

2. CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C90 AND BE MANUFACTURED WITH LIGHTWEIGHT AGGREGATE.

3. MORTAR SHALL CONFORM TO ASTM C 270 TYPE "S" (____ PSI). GROUT FOR FILLED CELL SHALL CONFORM TO ASTM C476 AND SHALL NOT CONTAIN ADMIXTURES. GROUT SHALL ATTAIN A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 3,000 PSI, SLUMP 9 IN.

4. REINFORCEMENT SHALL BE DEFORMED BARS CONFORMING TO ASTM A615 / A615M, GRADE 60 AND SHALL HAVE FABRICATION TOLERANCES IN ACCORDANCE WITH ACI 315. SHOP-FABRICATE REINFORCING BARS WHICH ARE INDICATED TO BE BENT OR HOOKED.

5. PROVIDE 9 GAGE HORIZONTAL REINFORCEMENT AT 16" SPACING LADDER TYPE FOR NON-LOAD BEARING WALL, TRUSS TYPE FOR LOAD BEARING WALL.

6. ALUMINUM CONDUITS, PIPES, AND ACCESSORIES SHALL NOT BE EMBEDDED IN MASONRY GROUT, OR MORTAR, UNLESS EFFECTIVELY COATED OR COVERED TO PREVENT ALUMINUM-CEMENT CHEMICAL REACTION OR ELECTROLYTIC REACTION BETWEEN ALUMINUM AND STEEL.

7. PROVIDE VERTICAL REBARS ACCORDING TO PLAN OR WALL SCHEDULE. SEE "TYPICAL WALL END AND CORNER DETAILS" FOR SPECIAL REINFORCING DETAIL.

8. VERTICAL REINFORCEMENT MUST HAVE A MINIMUM 48 BAR DIAMETER LAP SPLICE. UNLESS NOTED OTHERWISE, CENTER WALL REINFORCEMENT IN BLOCK CELLS. USE NONMETALLIC BAR POSITIONERS.

9. PROVIDE DOWEL REINFORCEMENT IN FOUNDATION OF SAME SIZE AND SPACING AS VERTICAL WALL REINFORCEMENT.

10. PROVIDE A CONTINUOUS BOND BEAM AT TOP OF WALL WITH 2 #5 BARS INSIDE. VERTICAL REBARS SHALL BE DEVELOPED INTO BOND BEAM, UNLESS NOTED OTHERWISE.

11. BRACE TOP OF INTERIOR, NON-LOAD BEARING MASONRY WALLS TERMINATING AT THE UNDERSIDE OF FLOOR OR ROOF STRUCTURE AGAINST OUT-OF-PLANE MOVEMENT IN ACCORDANCE WITH THE "TYPICAL NON-BEARING CMU WALL BRACING" DETAIL.

12. PROVIDE CONCRETE LINTEL AND WINDOW SILL ACCORDING TO SCHEDULES IN TYPICAL OPENING DETAIL.

STRUCTURAL ABBREVIATIONS

CFS	COLD FORMED STEEL
CJ	CONTRACTION JOINT
CL	CENTER LINE
CLR	CLR (COVER)
CONT	CONTINUOUS
DOR	DESIGNER OF RECORD
EF	EACH FACE
EJ	EXPANSION JOINT
EL	ELEVATION
EQ	EQUAL
EW	EACH WAY
EXT	EXTERIOR
FIN	FINISHED
FL	FLOOR
FTG	FOOTING
HORIZ	HORIZONTAL
INT	INTERIOR
OC	ON CENTER (SPACING)
PFMB	PRE-FABRICATED METAL BUILDING
REINF	REINFORCING (REBAR)
SCHDL	SCHEDULE
SOG	SLAB-ON-GRADE
T&B	TOP AND BOTTOM
TOS	TOP OF STEEL
TOC	TOP OF CONCRETE
VERT	VERTICAL
W/O	WITHOUT
WP	WORK POINT
WWR	WELDED WIRE REINFORCING

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6135 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 8:50:19 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
GENERAL STRUCTURAL NOTES, DESIGN LOADS & ABBREVIATIONS

SHEET IDENTIFICATION
S-001
SHEET 0 OF 0

S-001-

STEEL

1. MATERIAL STRENGTH
   WIDE FLANGE SHAPES - ASTM A 992, Fy = 50 KSI
   STRUCTURAL RECTANGULAR TUBING - ASTM A 500 GRADE B, Fy = 46 KSI
   (NOTED AS "HSS 4x4x1/4")
   ALL OTHER STRUCTURAL STEEL - ASTM A 36, Fy = 36 KSI
   WELDING ELECTRODES - AWS D1.1, E70XX

2. THE CENTERLINES OF ALL COLUMNS AND BEAMS SHALL BE LOCATED ON COLUMN LINES UNLESS NOTED OTHERWISE.

3. BOLTS SHALL BE ¾ INCH DIAMETER, TYPE A325, UNLESS NOTED OTHERWISE.

4. ANCHOR BOLTS SHALL CONFORM TO ASTM F1554, GRADE 36, UNLESS NOTED OTHERWISE. SWAGED ANCHOR BOLTS AND ANCHOR BOLTS WITH HOOKED END ANCHORAGE ARE NOT ALLOWED.

5. SHEAR CONNECTIONS FOR SIMPLY SUPPORTED BEAMS SHALL BE DESIGNED FOR REACTIONS INDICATED ON THE FRAMING PLANS. WHERE NONE ARE INDICATED, BEAMS SHALL BE DESIGNED FOR AN END REACTION EQUAL TO 1/2 OF THE TOTAL UNIFORM LOAD CAPACITY TABULATED IN THE ALLOWABLE UNIFORM LOAD TABLES OF THE AISC MANUAL, 13TH EDITION.

6. BOLTED MOMENT CONNECTIONS SHALL BE SLIP-CRITICAL CONNECTIONS. OTHER CONNECTIONS SHALL BE BEARING CONNECTIONS WITH THREADS INCLUDED IN SHEAR PLANES.

7. WELDS INDICATED "CJP" ("PJP") SHALL BE COMPLETE (PARTIAL) JOINT PENETRATION GROOVE WELDS. FABRICATOR SHALL PRODUCE COMPLETE (OR PARTIAL) JOINT PENETRATION GROOVE WELDS WHICH CONFORM TO ALL AWS D1.1 QUALIFIED WELD REQUIREMENTS AND WHICH ARE APPLICABLE TO THE SPECIFIC CONDITIONS SHOWN.

8. WHERE THE WORK OF OTHER TRADES REQUIRES CUTS, HOLES, ETC., IN STRUCTURAL STEEL MEMBERS, CUTS, HOLES, ETC., SHALL BE MADE IN THE SHOP AND SHOWN ON THE SHOP DRAWINGS. MAKING HOLES OR CUTS IN STRUCTURAL STEEL MEMBERS IN THE FIELD WILL NOT BE PERMITTED WITHOUT SPECIFIC APPROVAL OF THE DOR.

9. THE LATERAL LOAD RESISTING SYSTEM INCLUDES STRUCTURAL STEEL AND THE DIAPHRAGM AS INDICATED BELOW. ALL ELEMENTS OF THE LATERAL LOAD RESISTING SYSTEM AND DIAPHRAGM ARE REQUIRED TO BE COMPLETE AS INDICATED AND DETAILED IN THE STRUCTURAL CONTRACT DOCUMENTS TO PROVIDE THE LATERAL STRENGTH AND STABILITY OF THE STEEL STRUCTURE. THE STRUCTURE SHALL BE CONSIDERED UNSTABLE UNTIL THESE SYSTEMS AND ELEMENTS ARE COMPLETE.

9.1 THE LATERAL LOAD RESISTING SYSTEM FOR THE STEEL STRUCTURE INCLUDES THE FOLLOWING ELEMENTS AS INDICATED AND DETAILED IN THE STRUCTURAL CONTRACT DOCUMENTS:
   BRACED FRAMES
   MOMENT FRAMES
   CONNECTIONS, BASEPLATES, ANCHOR BOLTS, AND GROUT

9.2 THE LATERAL LOAD RESISTING DIAPHRAGM FOR THE STEEL STRUCTURE INCLUDES THE FOLLOWING ELEMENTS AS INDICATED AND DETAILED IN THE STRUCTURAL CONTRACT DOCUMENTS:
   STEEL ROOF DECK

10. STABILITY BRACING: THE STABILITY OF STRUCTURAL STEEL ELEMENTS INCLUDING INDIVIDUAL HOT-ROLLED STEEL SHAPES AND FABRICATED TRUSSES IS PROVIDED BY THE FOLLOWING ELEMENTS AS INDICATED AND DETAILED IN THE STRUCTURAL CONTRACT DOCUMENTS. THESE ELEMENTS SHALL BE COMPLETE AS SHOWN IN THE STRUCTURAL CONTRACT DOCUMENTS BEFORE ANY TEMPORARY MEANS AND METHODS REQUIRED FOR ERECTION ARE REMOVED.
   STEEL ROOF DECK
   STRUCTURAL STEEL BRACING AND KICKERS

STEEL JOISTS

1. FABRICATION AND ERECTION SHALL CONFORM TO THE STANDARD OF STEEL JOIST INSTITUTE (SJI). THE STEEL JOIST FABRICATOR SHALL BE A MEMBER OF SJI.

2. JOIST MANUFACTURER SHALL DESIGN THE MEMBER SIZES AND CONNECTIONS OF THE JOISTS IN ACCORDANCE WITH DIMENSIONS AND LOADING CONDITIONS SPECIFIED ON PLAN. DESIGN CALCULATIONS SHALL BE SIGNED AND SEALED BY A LICENSED PROFESSIONAL ENGINEER AND SUBMITTED TO DOR FOR REVIEW.

3. STEEL JOIST SPACING SHALL NOT EXCEED SPACING INDICATED ON DRAWINGS AND PLACEMENT OF JOISTS SHALL BE CAREFULLY COORDINATED WITH PARTITIONS AND WORK OF OTHER TRADES TO AVOID INTERFERENCES.

4. PROVIDE JOIST BRIDGING IN ACCORDANCE WITH SJI SPECIFICATIONS. OMIT JOIST BRIDGING WHERE INDICATED OR WHERE REQUIRED TO ALLOW INSTALLATION OF WORK OF OTHER TRADES. PROVIDE DIAGONAL BRIDGING IN EACH ADJACENT BAY IN LINE WITH OMITTED BRIDGING.

5. WELD ALL JOISTS TO SUPPORTING STEEL WITH 1-1/2 INCHES OF 1/8 FILLET FOR K-SERIES JOISTS AND (WHEN APPLICABLE) 2 INCHES OF 1/4 INCH FILLET WELD FOR LH- OR DLH- SERIES JOISTS, EACH SIDE OF BEARING.

6. JOISTS ARE TO BE FIELD BOLTED AT COLUMN LINES, OR, IF THERE ARE NO JOISTS AT THE COLUMN LINE, FIELD BOLT THE JOIST NEAREST THE COLUMN ON EACH SIDE OF THE BEAM. EXTEND BOTTOM CHORDS OF THE SAME JOISTS AND WELD THEM TO THE BEAM OR COLUMN.

7. EXTEND ALL JOISTS 1 INCH MINIMUM PAST CENTERLINE OF SUPPORTING MEMBER WHERE POSSIBLE.

8. ADJACENT JOISTS OF THE SAME DEPTH ARE TO HAVE WEB MEMBERS IN LINE TO PERMIT PASSAGE OF HVAC DUCTS.

9. JOISTS AND JOIST GIRDERS WITH CONCENTRATED LOADS IN EXCESS OF 50 POUNDS ON THE TOP OR BOTTOM CHORDS NOT LOCATED AT A PANEL POINT SHALL BE REINFORCED WITH A FIELD INSTALLED MEMBER. THE FIELD INSTALLED MEMBER SHALL BE LOCATED AT THE CONCENTRATED LOAD AND SHALL BRACE THE CHORD BACK TO A PANEL POINT.

10. STEEL JOISTS DESIGNATED "SP" ON PLAN ARE SPECIAL JOISTS THAT SHALL BE DESIGNED FOR THE SPECIAL CRITERIA INDICATED.

STEEL DECK

1. ROOF DECK SHALL BE GALVANIZED STEEL CONFORMING TO ASTM A653-94 WITH A MINIMUM YIELD STRENGTH OF 33 KSI. STEEL ROOF DECK SHALL BE 1 1/2" DEEP WIDE RIB DECK WITH THE FOLLOWING MINIMUM SECTION PROPERTIES:
t=0.0358 in (20 Gage)
Ip=0.212 in4/ft
Sp=0.234 in3/ft
Sn=0.247 in3/ft

2. ROOF DECK SHALL BE FASTENED TO THE SUPPORTING STRUCTURE WITH 5/8" Ø PUDDLE WELDS AT A 36/4 WELD PATTERN. SIDE LAP CONNECTIONS SHALL BE MADE WITH #10 SELF TAPPING SCREWS AT QUARTER POINTS BETWEEN SUPPORTS. FASTEN DISCONTINUOUS SIDE OF ROOF DECK TO SUPPORTING STRUCTURE WITH 5/8" Ø PUDDLE WELDS AT 12" ON CENTER UNLESS NOTED OTHERWISE.

3. WHERE 4 OR MORE SUPPORTS ARE PROVIDED, STEEL DECK SHALL SPAN CONTINUOUSLY OVER A MINIMUM OF 3 SUPPORTS (2-SPAN CONDITION), UNLESS NOTED OTHERWISE.

4. 20 GAGE RIDGE PLATES, VALLEY PLATES AND MISCELLANEOUS METAL DECK ACCESSORIES SHALL BE PROVIDED AND INSTALLED BY THE CONTRACTOR IN ACCORDANCE WITH THE DECK MANUFACTURER'S RECOMMENDATIONS.

5. PERMANENT SUSPENDED LOADS SHALL NOT BE SUPPORTED BY STEEL ROOF DECK.

COLD FORMED STEEL FRAMING

1. STRUCTURAL MEMBERS SHALL BE DESIGNED IN ACCORDANCE WITH THE AMERICAN IRON AND STEEL INSTITUTE (AISI) "NORTH AMERICAN SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS" (LATEST EDITION).

2. STRUCTURAL MEMBERS TO BE FORMED FROM CORROSION RESISTANT STEEL SHALL CONFORM TO ASTM A 653/AA 653M WITH MINIMUM YIELD STRESS (FY) OF 33 KSI FOR STEEL THICKNESS LESS THAN OR EQUAL TO 54 MIL (16 GAGE) OR 50 KSI FOR THICKNESS GREATER THAN 54 MIL.

3. COLD-FORMED STEEL MATERIAL SHALL BE COLOR-CODED FOR EACH DIFFERENT COLD – FORMED STEEL THICKNESS.

4. COLD-FORMED MEMBERS AND DETAILS SHOWN ON THE STRUCTURAL DRAWINGS ARE FOR BID PURPOSE ONLY. STRUCTURAL STUD AND/OR JOIST FRAMING MEMBERS AND CONNECTIONS ARE TO BE ENGINEERED BY THE MANUFACTURER. DESIGN CALCULATIONS AND SHOP DRAWINGS INDICATING ALL JAMBS, POSTS, HEADERS, BRACING AND PIECES NECESSARY FOR CONSTRUCTION SHALL BE SUBMITTED TO THE DESIGNER OF RECORD FOR REVIEW. DESIGN CALCULATIONS SHALL BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER.

5. LOAD BEARING INTERIOR WALLS SHALL BE DESIGNED ACCORDING TO THE COMPRESSION AND TENSION LOADS INDICATED ON PLAN COMBINED WITH A 5 PSF LATERAL LOAD.

6. EXTERIOR LOAD BEARING WALLS SHALL BE DESIGNED FOR THE COMBINED WIND CLADDING AND COMPRESSION OR TENSION LOADS INDICATED ON PLAN. PERMISSIBLE HORIZONTAL DEFLECTION SHALL BE L/600 FOR EXTERIOR WALLS WITH BRICK VENEER ATTACHED, L/360 FOR ALL OTHER WALLS.

7. MAXIMUM STUD SPACING FOR LOAD BEARING WALL SHALL BE 16" ON CENTER, NON LOAD BEARING WALL 24".

8. MINIMUM DEPTH OF STUDS SHALL BE 6" FOR LOAD BEARING WALLS, 4" FOR SHEAR WALLS NOT SUPPORTING ROOF TRUSSES.

9. MECHANICAL BRIDGING AT INTERVALS NOT EXCEEDING 4'-0" ON CENTER SHALL BRACE ALL LOAD BEARING AND CURTAIN TYPE COLD-FORMED STEEL WALLS. BRIDGING SHALL BE IN PLACE PRIOR TO PLACING ANY LOADS ON THE STUD WALLS.

10. FRAMING COMPONENTS ARE TO BE CUT SQUARELY FOR ATTACHMENT TO PERPENDICULAR MEMBERS OR AS REQUIRED FOR AN ANGULAR FIT AGAINST ABUTTING MEMBERS,

11. FIELD CUTTING OF STUDS MUST BE DONE BY SAWING OR SHEARING, TORCH CUTTING OF COLD-FORMED MEMBERS IS UNACCEPTABLE.

12. FASTENING OF COMPONENTS IS TO BE WITH SELF-DRILLING SCREWS OR WELDING. ALL CONNECTION SCREWS SHALL BE ZINC COATED. WELDING OF STUDS MUST COMPLY WITH AWS D 1.3. ALL WELDS TO BE TOUCHED-UP WITH ZINC-RICH PAINT. POWDER DRIVEN FASTENERS ARE NOT ACCEPTABLE FOR STRUCTURAL APPLICATIONS.

13. COLD-FORMED STEEL FRAMING MEMBERS ARE TO BE SECURELY ATTACHED TO THE STRUCTURE WHERE INDICATED ON THE DRAWINGS OR APPROVED SHOP DRAWINGS. FASTENERS SHALL BE COMPATIBLE WITH THE STRUCTURAL MEMBERS.

14. REFERENCE ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION, INCLUDING SHEATHING TYPE, FINISHES, OPENINGS, LOCATIONS ETC.

SPECIAL INSPECTIONS

1. SPECIAL INSPECTIONS WILL BE PERFORMED IN ACCORDANCE WITH THE STATEMENT OF SPECIAL INSPECTIONS

2. OWNER, OR ARCHITECT/STRUCTURAL ENGINEER OF RECORD ACTING AS THE OWNER'S AGENT, SHALL DIRECTLY EMPLOY AND PAY FOR SERVICES OF THE SPECIAL INSPECTORS TO PERFORM REQUIRED SPECIAL INSPECTION.

3. THE FOLLOWING GENERAL TYPES OF WORK REQUIRE SPECIAL INSPECTION: (REFER TO STATEMENT OF SPECIAL INSPECTIONS FOR DETAILED INSPECTION REQUIREMENTS)

FOUNDATIONS
CONCRETE
REINFORCING STEEL
FORMWORK
STRUCTURAL STEEL
STRUCTURAL WELDING
HIGH STRENGTH BOLTS
ROOF DECK ATTACHMENT
COLD-FORMED STEEL FRAMING

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6101 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 8:50:19 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
GENERAL STRUCTURAL NOTES

SHEET IDENTIFICATION
S-002
SHEET 0 OF 0

S-002-



θ ≤ 7 degrees and
Monoslope ≤ 3 degrees



Monoslope roofs
3 degrees < θ ≤ 10 degrees

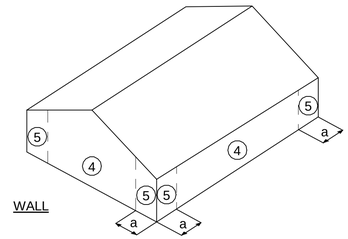

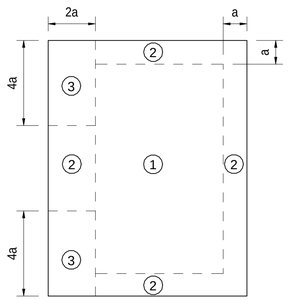

Monoslope roofs
10 degrees < θ ≤ 30 degrees

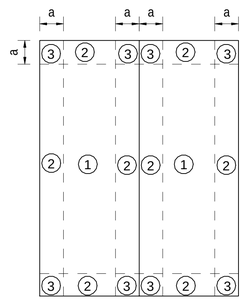

7 degrees < θ ≤ 45 degrees

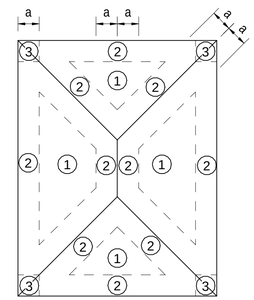

7 degrees < θ ≤ 27 degrees

B1 COMPONENT AND CLADDING DIAGRAM

NOT TO SCALE

MAIN WIND FORCE RESISTING SYSTEM						
	TRANSVERSE DIRECTION			LONGITUDINAL DIRECTION		
Surface	GCpf	w/-GCpi	w/+GCpi	GCpf	w/-GCpi	w/+GCpi
1	0.52	0.70	0.34	0.40	0.58	0.22
2	-0.69	-0.51	-0.87	-0.69	-0.51	-0.87
3	-0.47	-0.29	-0.65	-0.37	-0.19	-0.55
4	-0.42	-0.24	-0.60	-0.29	-0.11	-0.47
5	-0.45	-0.27	-0.63	-0.45	-0.27	-0.63
6	-0.45	-0.27	-0.63	-0.45	-0.27	-0.63
1E	0.78	0.96	0.60	0.61	0.79	0.43
2E	-1.07	-0.89	-1.25	-1.07	-0.89	-1.25
3E	-0.67	-0.49	-0.85	-0.53	-0.35	-0.71
4E	-0.62	-0.44	-0.80	-0.43	-0.25	-0.61

MAIN WIND FORCE RESISTING SYSTEM					
TRANSVERSE DIRECTION			LONGITUDINAL DIRECTION		
Surface	w/-GCpi	w/+GCpi	Surface	w/-GCpi	w/+GCpi
1	11.30 psf	5.46 psf	1	9.41 psf	3.57 psf
2	-8.27 psf	-14.11 psf	2	-8.27 psf	-14.11 psf
3	-4.68 psf	-10.52 psf	3	-3.08 psf	-8.92 psf
4	-3.82 psf	-9.66 psf	4	-1.78 psf	-7.62 psf
5	-4.38 psf	-10.22 psf	5	-4.38 psf	-10.22 psf
6	-4.38 psf	-10.22 psf	6	-4.38 psf	-10.22 psf
1E	15.57 psf	9.73 psf	1E	12.81 psf	6.97 psf
2E	-14.43 psf	-20.27 psf	2E	-14.43 psf	-20.27 psf
3E	-8.00 psf	-13.84 psf	3E	-5.68 psf	-11.52 psf
4E	-7.11 psf	-12.94 psf	4E	-4.05 psf	-9.89 psf

ROOF						
	GCp +/- GCpi			SURFACE PRESSURE		
Area	10 SF	50 SF	100 SF	10 SF	50 SF	100 SF
Negative Zone 1	-1.08	-1.01	-0.98	-17.52 psf	-16.38 psf	-15.89 psf
Negative Zone 2	-1.88	-1.53	-1.38	-30.49 psf	-24.82 psf	-22.38 psf
Negative Zone 3	-1.88	-1.53	-1.38	-30.49 psf	-24.82 psf	-22.38 psf
Positive All Zones	0.68	0.54	0.48	11.03 psf	10.00 psf	10.00 psf
Overhang Zone 2	-2.20	-2.20	-2.20	-35.68 psf	-35.68 psf	-35.68 psf
Overhang Zone 3	-3.70	-2.86	-2.50	-59.40 psf	-46.00 psf	-40.20 psf

WALLS						
	GCp +/- GCpi			SURFACE PRESSURE		
Area	10 SF	100 SF	500 SF	10 SF	100 SF	500 SF
Negative Zone 4	-1.28	-1.10	-0.98	-20.76 psf	-17.90 psf	-15.89 psf
Negative Zone 5	-1.58	-1.23	-0.98	-25.63 psf	-19.90 psf	-15.89 psf
Positive Zone 4 & 5	1.18	1.00	0.88	19.14 psf	16.27 psf	14.27 psf

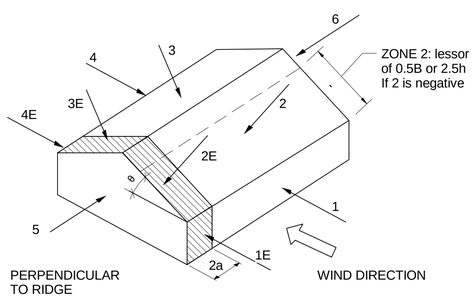

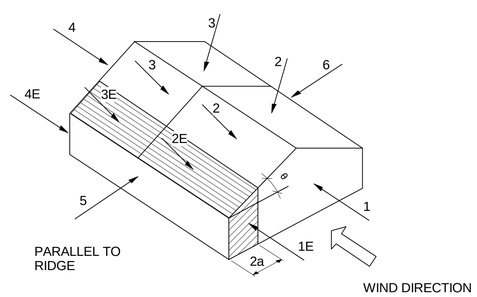

A1 MWFRS DIAGRAM

NOT TO SCALE

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK | DESCRIPTION | DATE | APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
CKD BY: Checker
PLOT DATE: 11/2/2012, 8:30:21 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
WIND PRESSURE DIAGRAMS

SHEET IDENTIFICATION
S-003
SHEET 0 OF 0

S-003-

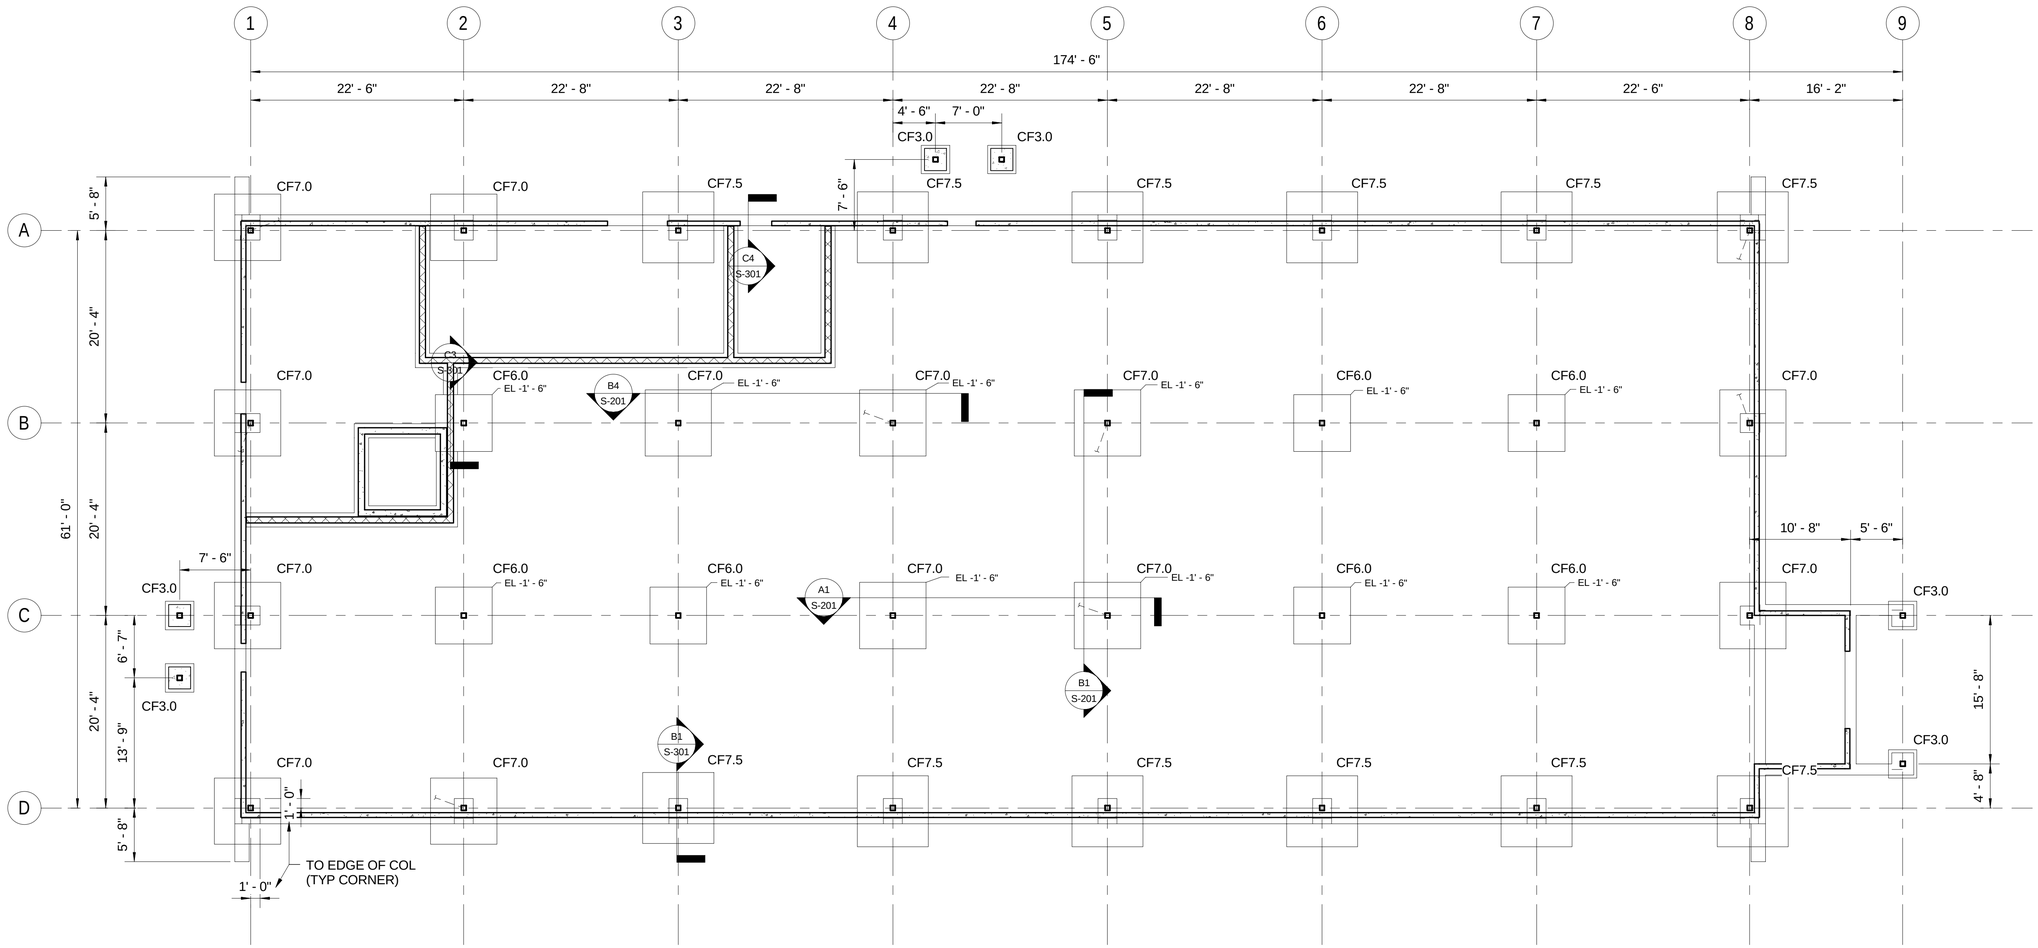

A1 FOUNDATION PLAN

1/8" = 1'-0"

PLAN NORTH

PLAN NOTES

1 DATUM FOR ELEVATIONS GIVEN ON THIS PLAN IS FINISHED GROUND FLOOR, ELEVATION _____' = 0'-0"

2 CFY.Y INDICATES COLUMN FOOTING TYPE WHERE Y.Y INDICATEDS THE LENGTH AND THE WIDTH; WFX.X INDICATES CONTINUOUS WALL FOOTING TYPE. SEE FOOTING SCHEDULE ON SHEET S-601 FOR SIZE AND REINFORCING.

3 UNLESS NOTED OTHERWISE (- X' - XX") ON PLANE, TOP OF TYPICAL EXTERIOR FOOTINGS (ISOLATED AND CONTINUOUS) SHALL BE AT ELEVATION -7'-0" BELOW FINISHED FLOOR. TOP OF INTERIOR FOOTINGS ARE TYPICALLY AT ELEVATION -1-6"

4 FOR GENERAL NOTES AND TYPICAL DETAILS, REFER TO SHEETS S-001 THROUGH S-002 AND S-501 THROUGH S-504

8 6 4 2 0 8 16

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

DES/GN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
CKD BY: Checker
PLOT DATE: 11/2/2012, 8:50:22 AM
PLOT SCALE:
FILE NAME:
SIZE: 22" x 34"

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
FOUNDATION PLAN

SHEET IDENTIFICATION
S-101
SHEET 0 OF 0

S-101-

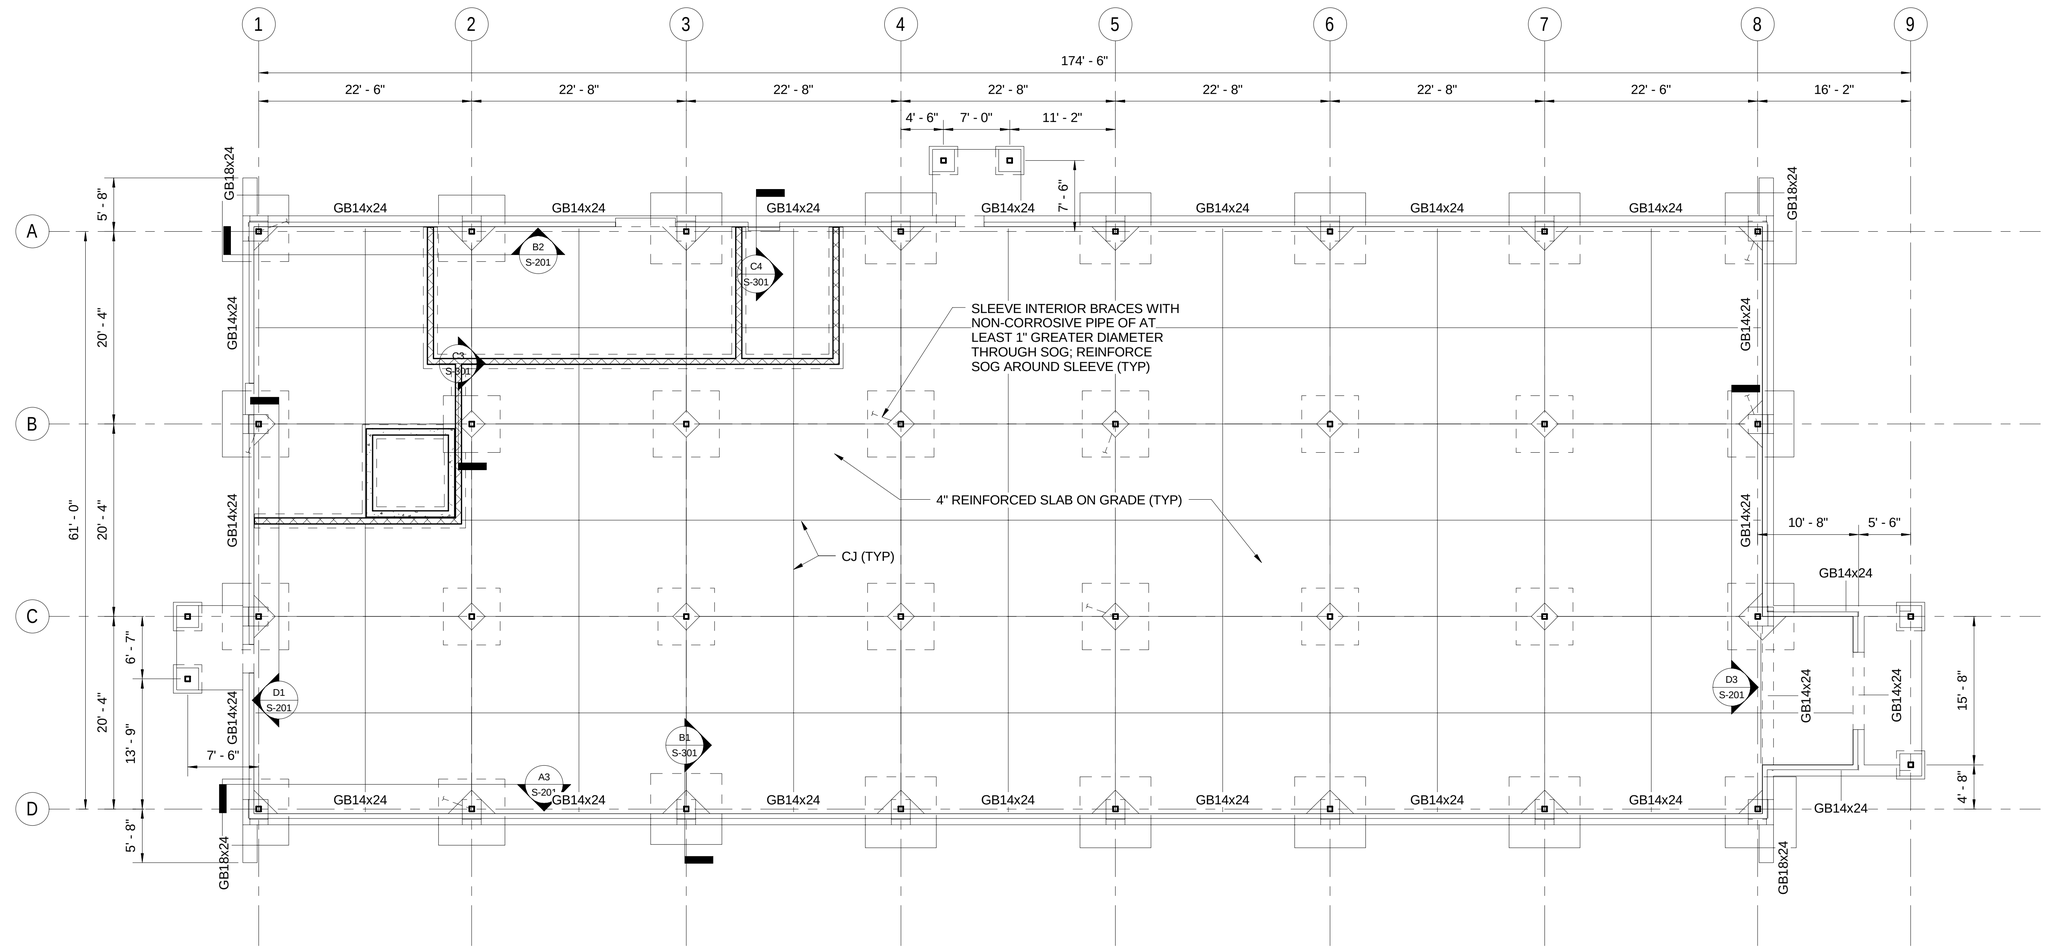

A1 FRAMING PLAN - GROUND FLOOR

1/8" = 1'-0"

PLAN NORTH

PLAN NOTES

1 DATUM FOR ELEVATIONS GIVEN ON THIS PLAN IS FINISHED GROUND FLOOR, ELEVATION _____' = 0'-0"

2 TOP OF CONCRETE SLAB IS AT ELEVATION 0'-0" UNLESS NOTED OTHERWISE (-XX'-XX") ON PLAN

3 GROUND FLOOR SLAB SHALL BE CONCRETE SLAB ON GRADE. SEE PLAN FOR SLAB THICKNESS IN VARIOUS ZONES. REINFORCE SLAB AS FOLLOWS: 4" SLAB - 6"x6"-W2.0xW2.0 WWR

4 FOR SLAB PENETRATIONS GREATER THAN 1'-0" SQUARE AND AT RE-ENTRANT CORNERS IN SLABS-ON-GRADE, PROVIDE 2 DIAGONAL BARS IN THE MID-DEPTH OF THE SLAB. SEE DETAIL SHEET S-501.

5 PENETRATIONS IN SLAB-ON-GRADE SHALL BE MADE AT LEAST 1" LARGER THAT THE DIAMETER OR WIDTH OF THE SIZE OF THE PENETRATING ELEMENT AND THE GAP SHALL BE FILLED WITH STANDARD JOINT FILLER.

6 FOR SLAB DEPRESSION DIMENSIONS, SEE ARCHITECTURAL DRAWINGS.

7 FOR GENERAL NOTES AND TYPICAL DETAILS, REFER TO SHEETS S-001 THROUGH S-002 AND S-501 THROUGH S-504

8 6 4 2 0 8 16

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:
DES/GN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Approver
PLOT DATE: 11/2/2012 8:50:22 AM
PLOT SCALE:
FILE NAME:
SIZE: 22" x 34"

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
FRAMING PLAN - GROUND FLOOR

SHEET IDENTIFICATION
S-102
SHEET 0 OF 0

S-102-

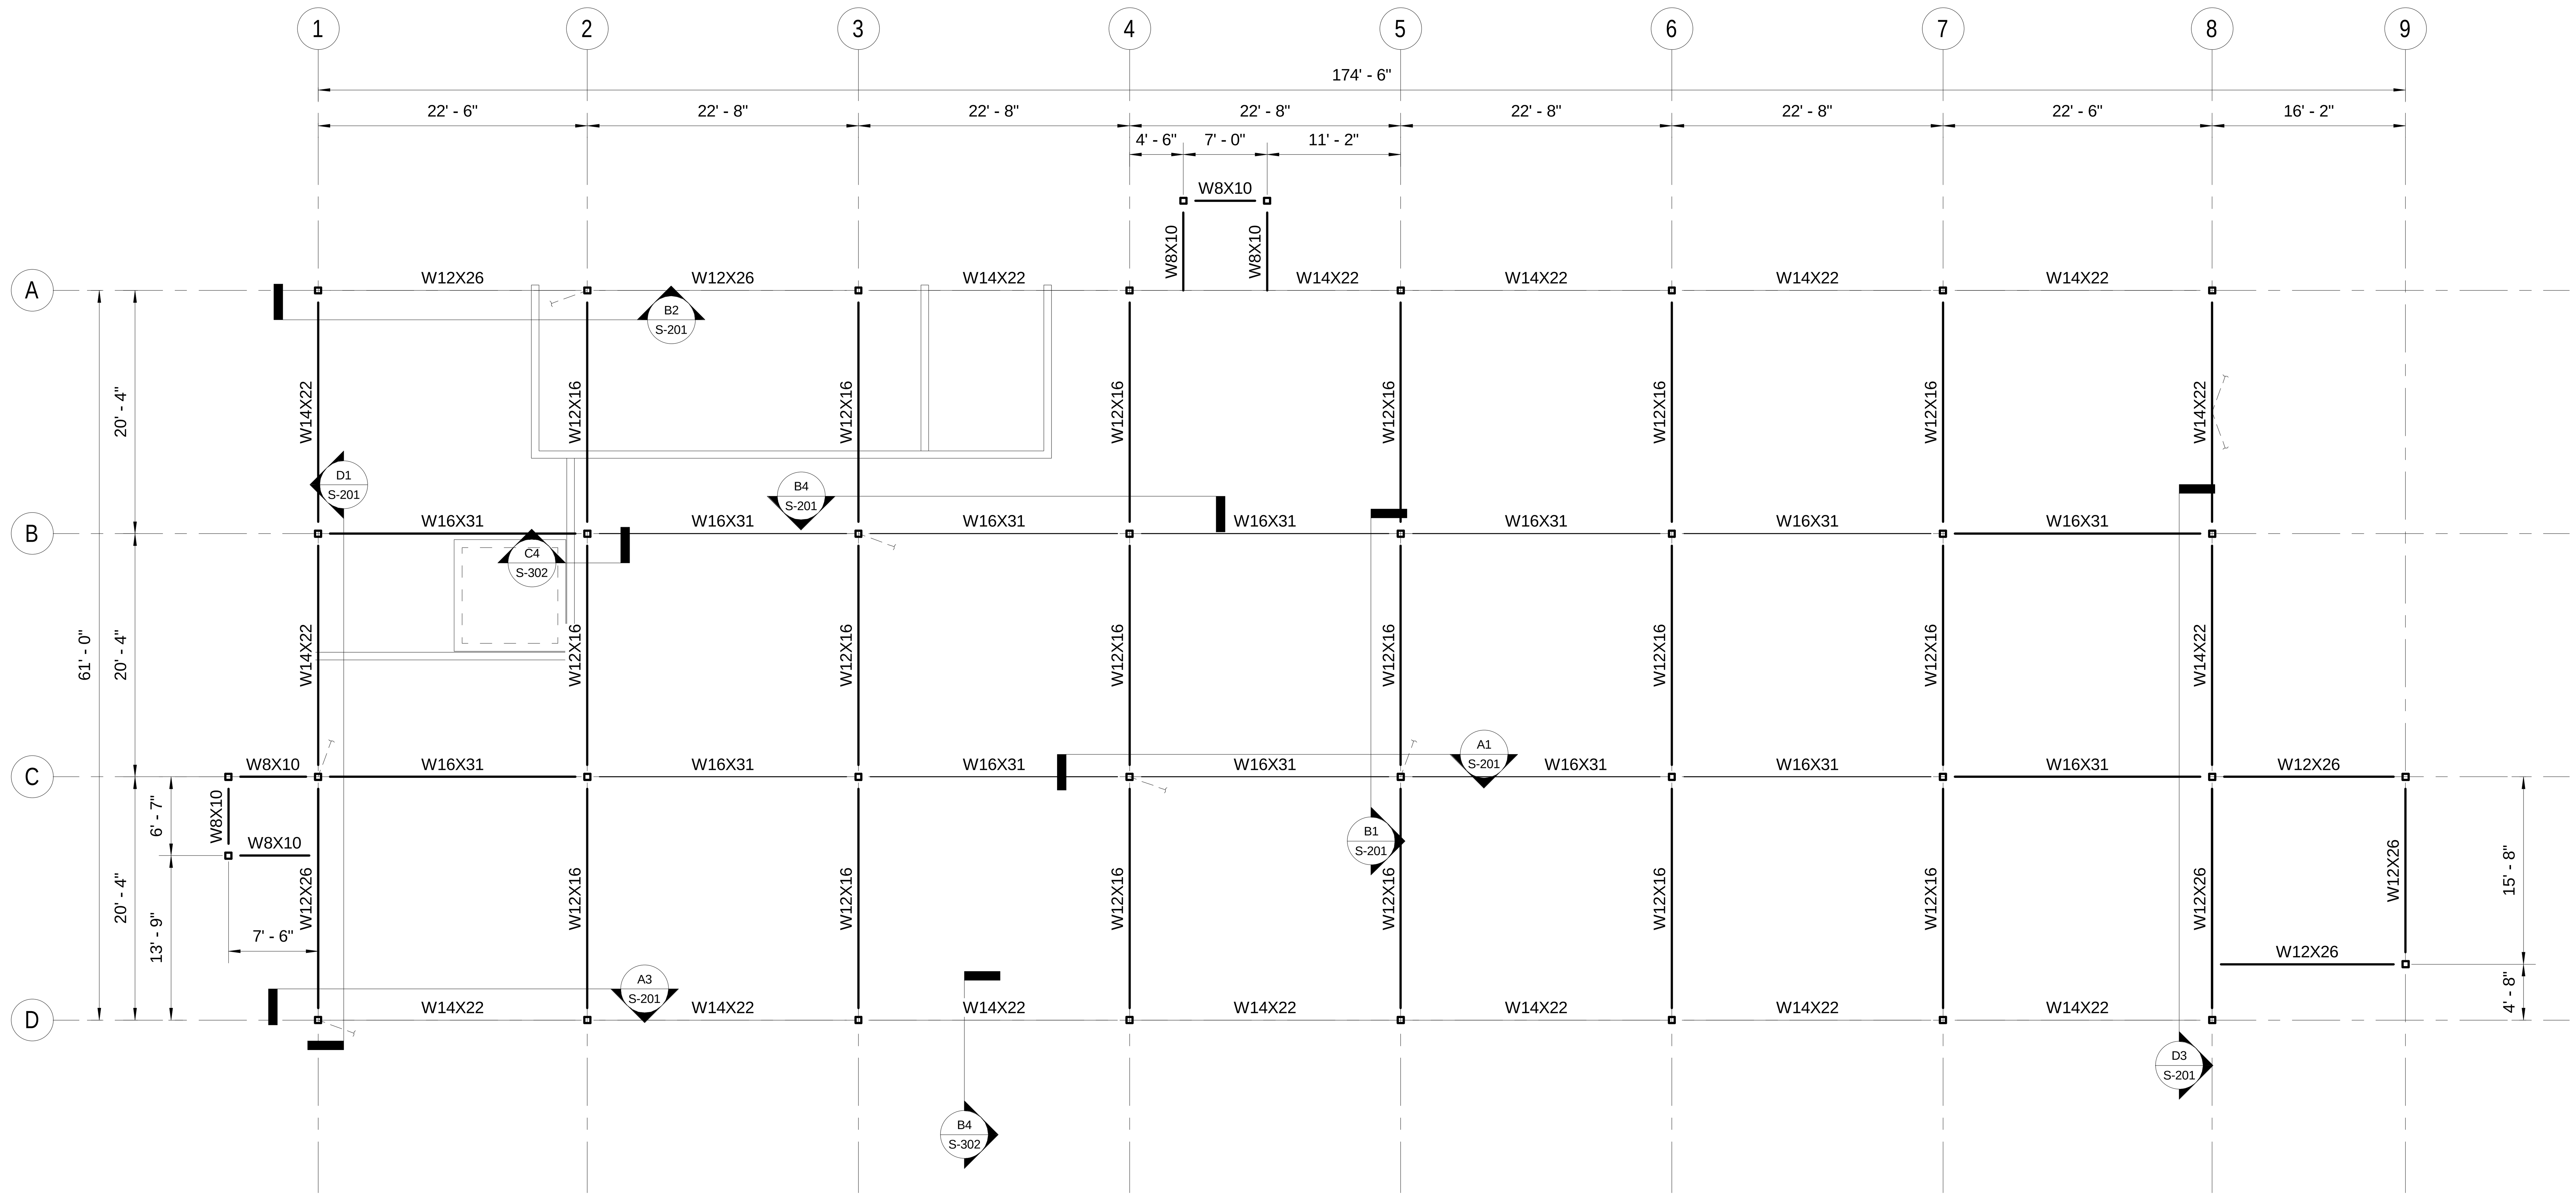

A1 FRAMING PLAN - TOP OF STEEL

1/8" = 1'-0"

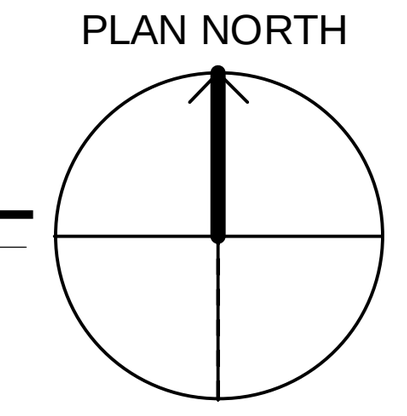

PLAN NOTES

1. TOP OF STEEL ELEVATION IS 12'-7" WHICH IS THE TRUSS BEARING ELEVATION.
2. PREFABRICATED CFS TRUSSES ARE DESIGNATED AS TX, WHERE X REFERS TO THE TRUSS TYPE.
3. TRUSSES SHALL BE DESIGNED, DETAILED, AND SEALED BY A PROFESSIONAL ENGINEER.
4. UNLESS NOTED OTHERWISE, TRUSSES SHALL BE EQUALLY SPACED AT A MAXIMUM OF 5'-0" ON CENTER.
5. REFER TO THE "STEEL DECK" SECTION OF THE GENERAL NOTES ON SHEET S-001 FOR THE STRUCTURAL ROOF DECK REQUIREMENTS
6. SEE SHEET S-302 FOR TYPICAL DETAILS OF TRUSS BEARING, SHEAR AND MOMENT CONNECTIONS, DECK ATTACHMENT, ETC.
7. FOR DIMENSIONS NOT INDICATED, SEE ARCHITECTURAL DRAWINGS.

8 6 4 2 0 8 16

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®

NORFOLK DISTRICT

MARK | DESCRIPTION | DATE | APPR

DATE: SEPTEMBER 12, 2012

SOLICITATION NO.:

CONTRACT NO.:

FILE NUMBER:

DESIGN BY: Designer | CKD BY: Checker | PLOT DATE: 11/2/2012 8:50:23 AM

DRAWN BY: Author | SBMT BY: Approver | PLOT SCALE: | FILE NAME:

SIZE: 22" x 34"

US ARMY CORPS OF ENGINEERS

NORFOLK DISTRICT

NORFOLK, VA

PARSONS BRINCKERHOFF 6161 KEMPSVILLE CIR NORFOLK, VA 23502 SUITE 110

U.S. ARMY

CRIMINAL INVESTIGATION COMMAND

FILED OPERATIONS BUILDING, RA 10-15

ADAPT-BUILD - FORT DRUM, NY

FRAMING PLAN - TOP OF STEEL

SHEET IDENTIFICATION

S-103

SHEET 0 OF 0

S-103-

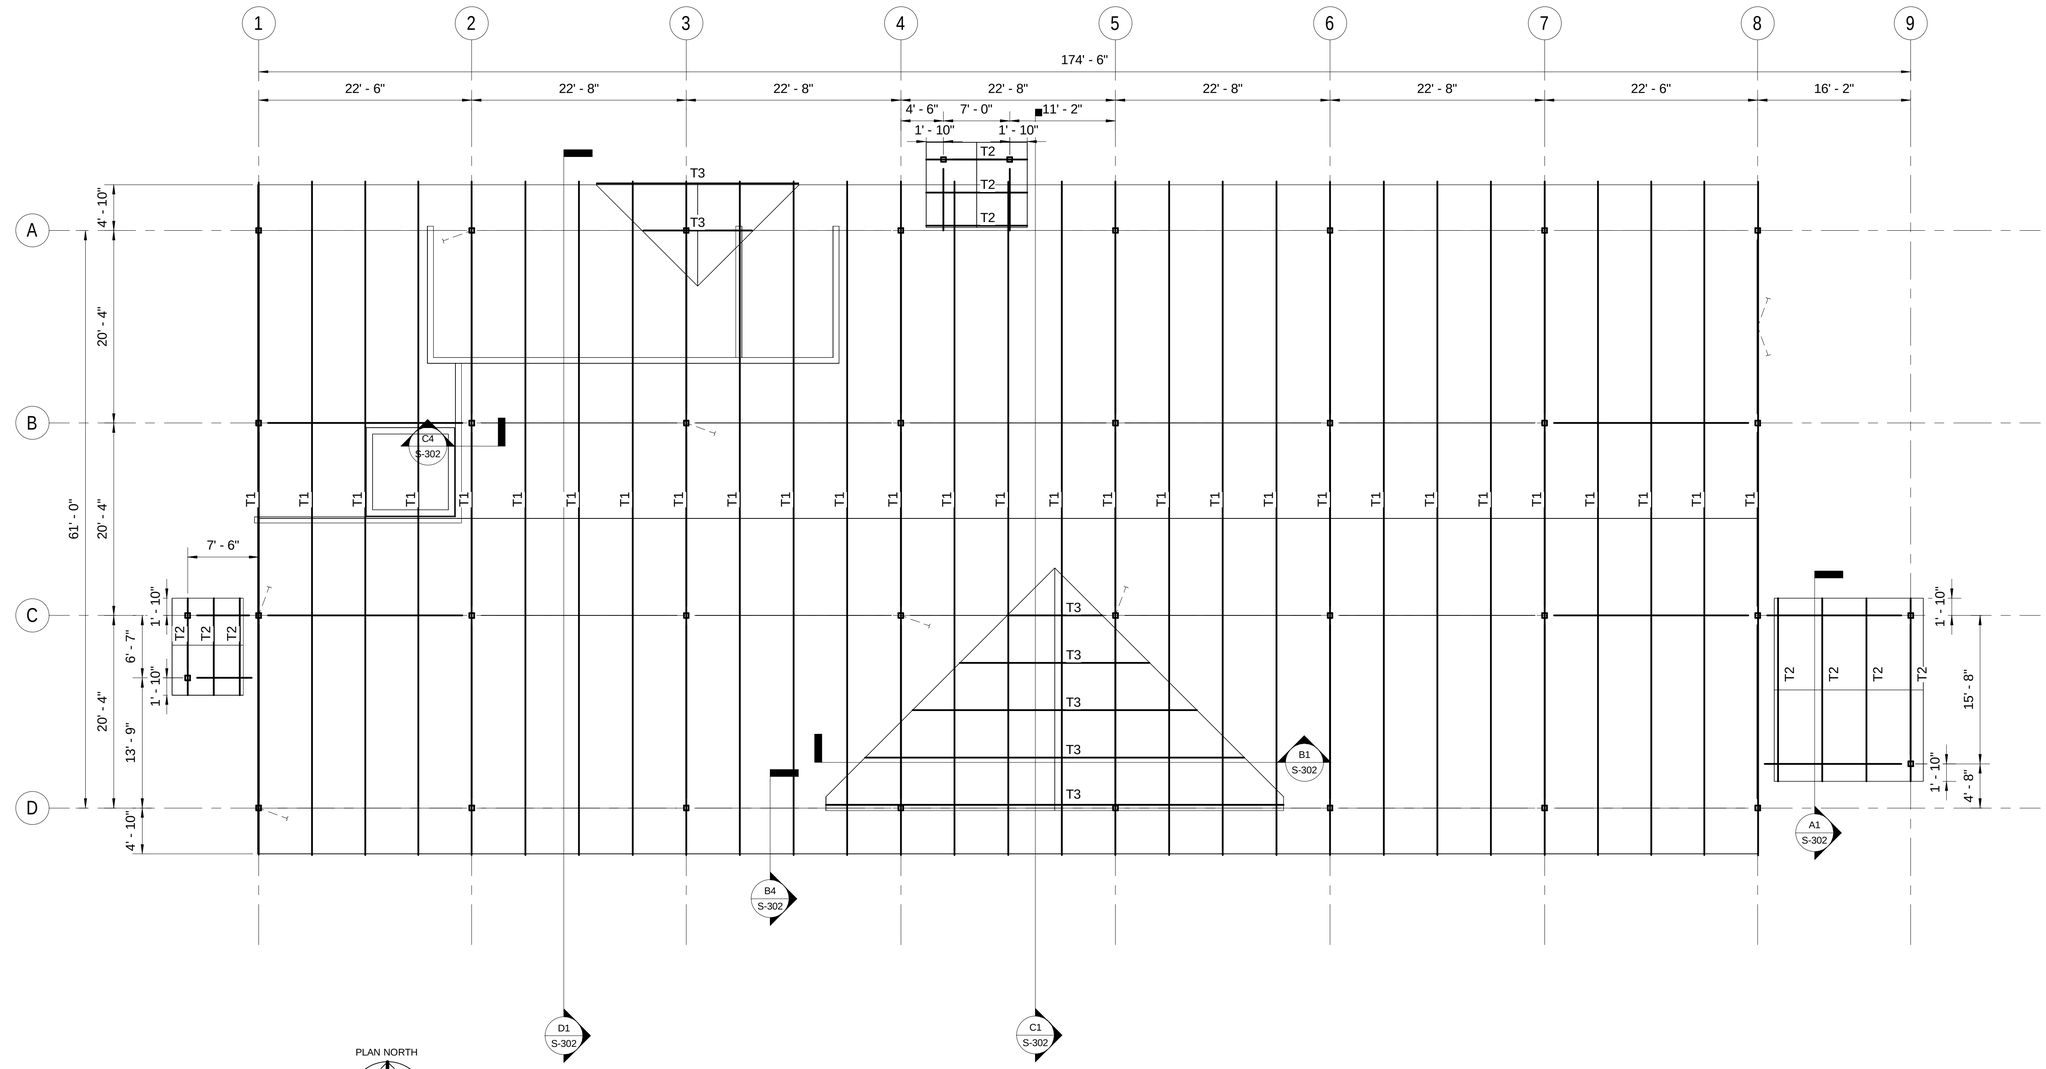

A1 FRAMING PLAN - ROOF

1/8" = 1'-0"

PLAN NORTH

FOR NOTES SEE SHEET S-103

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 8:58:24 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
FRAMING PLAN - ROOF

SHEET IDENTIFICATION
S-104
SHEET 0 OF 0

S-104-

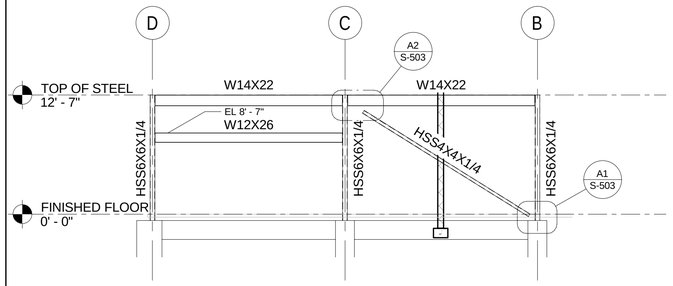

D1 BRACED FRAME ALONG GRID 1

1/8" = 1'-0"

AXIAL WIND LOAD = +/-_____KIPS
AXIAL SEISMIC LOAD = +/-_____KIPS

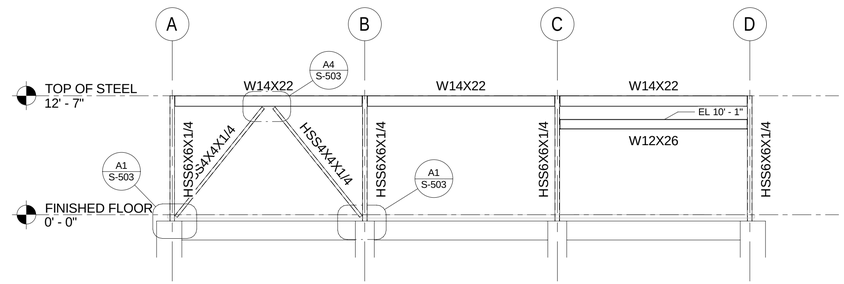

D3 BRACED FRAME ALONG GRID 8

1/8" = 1'-0"

AXIAL WIND LOAD = +/-_____KIPS
AXIAL SEISMIC LOAD = +/-_____KIPS

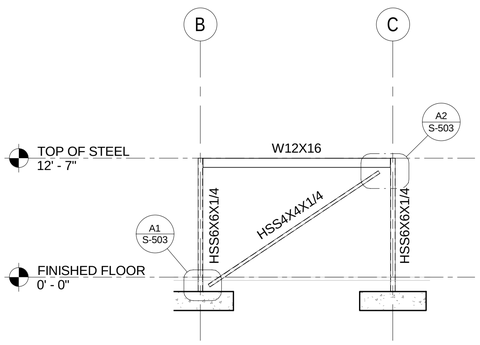

B1 BRACED FRAME ALONG GRID 5

1/8" = 1'-0"

AXIAL WIND LOAD = +/-_____KIPS
AXIAL SEISMIC LOAD = +/-_____KIPS

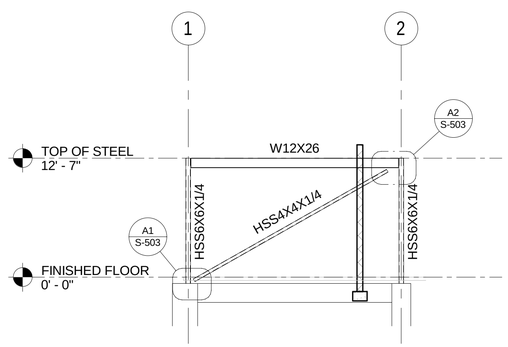

B2 BRACED FRAME ALONG GRID A

1/8" = 1'-0"

AXIAL WIND LOAD = +/-_____KIPS
AXIAL SEISMIC LOAD = +/-_____KIPS

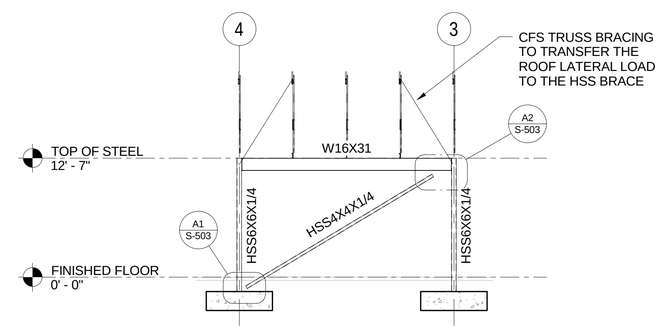

B4 BRACED FRAME ALONG GRID B

1/8" = 1'-0"

AXIAL WIND LOAD = +/-_____KIPS
AXIAL SEISMIC LOAD = +/-_____KIPS

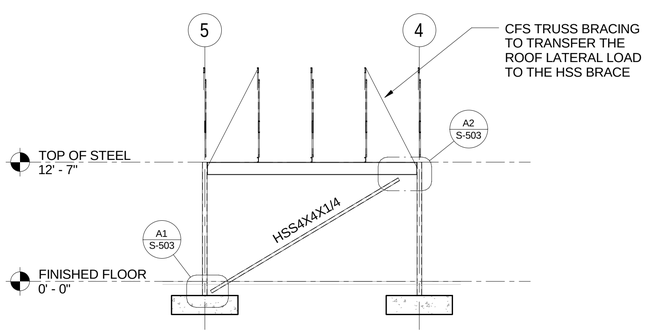

A1 BRACED FRAME ALONG GRID C

1/8" = 1'-0"

AXIAL WIND LOAD = +/-_____KIPS
AXIAL SEISMIC LOAD = +/-_____KIPS

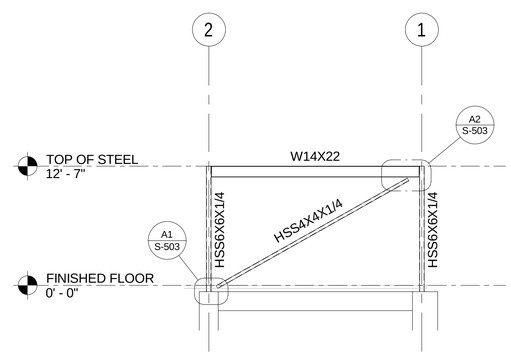

A3 BRACED FRAME ALONG GRID D

1/8" = 1'-0"

AXIAL WIND LOAD = +/-_____KIPS
AXIAL SEISMIC LOAD = +/-_____KIPS

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 8:58:25 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
FRAMING ELEVATIONS

SHEET IDENTIFICATION
S-201
SHEET 0 OF 0

S-201-

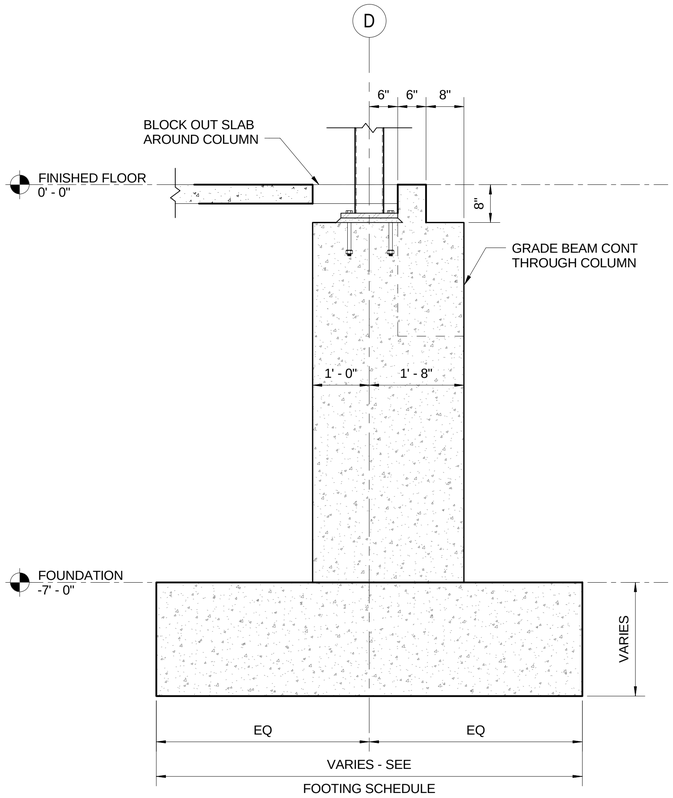

B1 TYPICAL WALL FOUNDATION
3/4" = 1'-0"

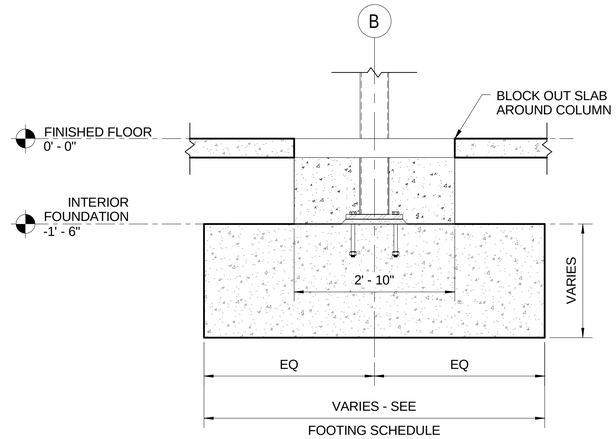

C3 TYPICAL INTERIOR FOOTING
3/4" = 1'-0"

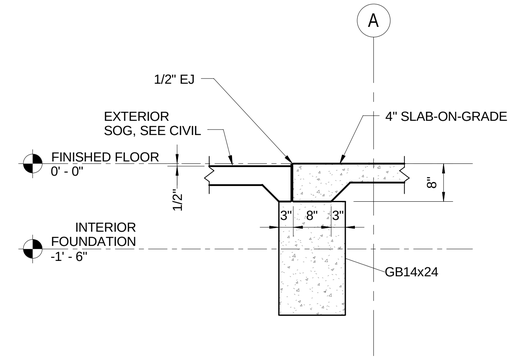

C4 FOUNDATION SECTION AT DOORWAY
3/4" = 1'-0"

SCALE: 3/4"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
CKD BY: Checker
PLOT DATE: 11/2/2012 8:26:22 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
FOUNDATION SECTIONS

SHEET IDENTIFICATION
S-301
SHEET 0 OF 0

S-301-

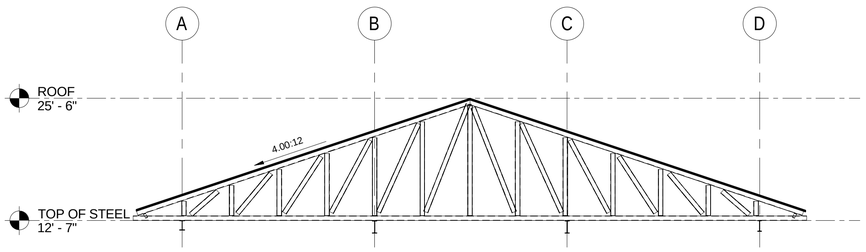

D1 TYPE T1 TRUSS
1/8" = 1'-0"

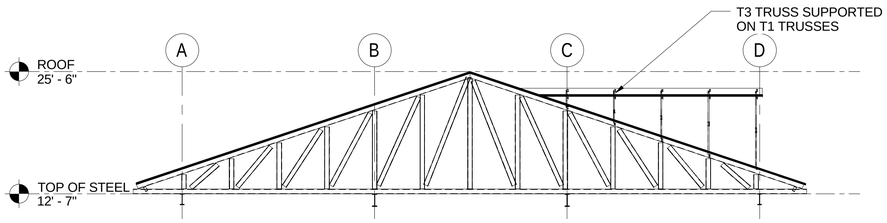

C1 TYPE T1 TRUSS WITH T3 SHOWN
1/8" = 1'-0"

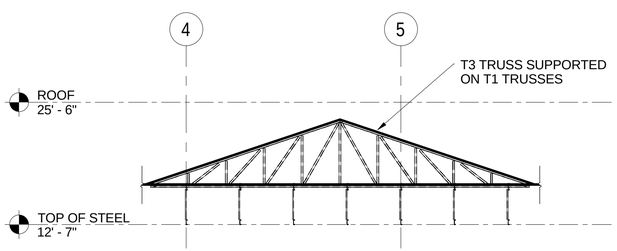

*T3 TRUSSES VARY IN SIZE AND ELEVATION AS INDICATED ON PLAN

B1 TYPE T3 TRUSS
1/8" = 1'-0"

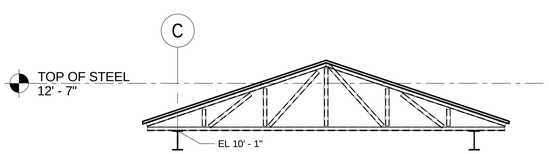

*TYPE T2 TRUSSES VARY IN SIZE AND ELEVATION AS INDICATED ON PLAN

A1 TYPE T2 TRUSS
1/4" = 1'-0"

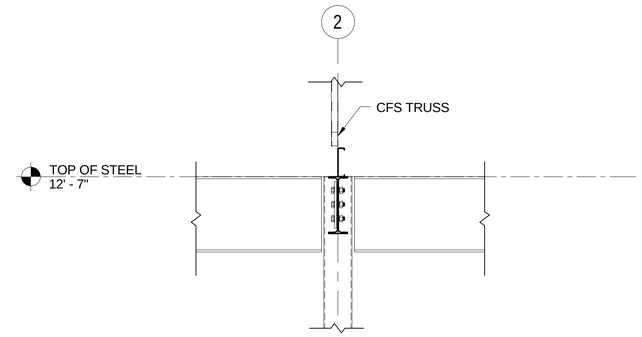

C4 TYPICAL SHEAR CONNECTION
3/4" = 1'-0"

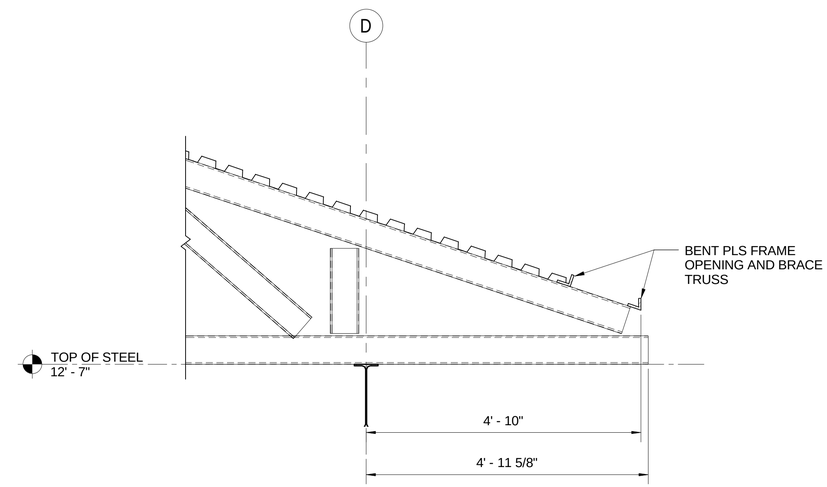

B4 TYP TRUSS OVERHANG
3/4" = 1'-0"

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

4 3 2 1 0 4 8
SCALE: 1/4"=1'-0"

2 1 0 2
SCALE: 3/4"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 1:52:28 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
ROOF FRAMING SECTIONS

SHEET IDENTIFICATION
S-302
SHEET OF 0

S-302-

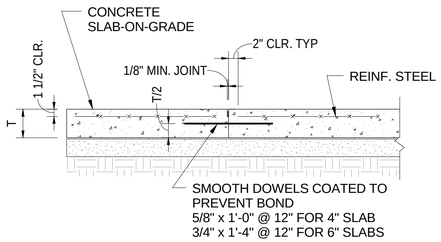

D1 CONSTRUCTION JOINT
NOT TO SCALE

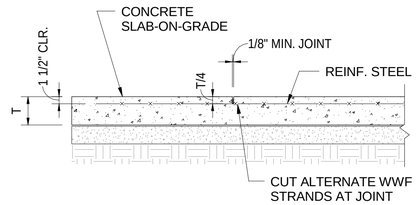

D2 CONTROL JOINT
NOT TO SCALE

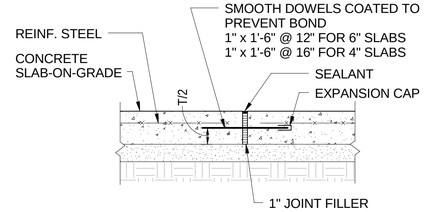

D3 EXPANSION JOINT
NOT TO SCALE

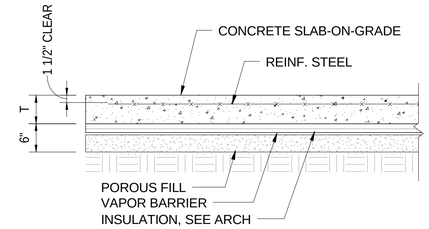

D4 TYPICAL SLAB-ON-GRADE
NOT TO SCALE

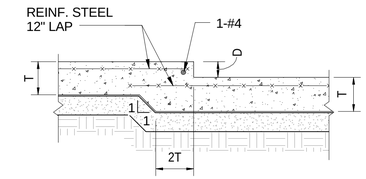

D5 TYPICAL SLAB DEPRESSION
NOT TO SCALE

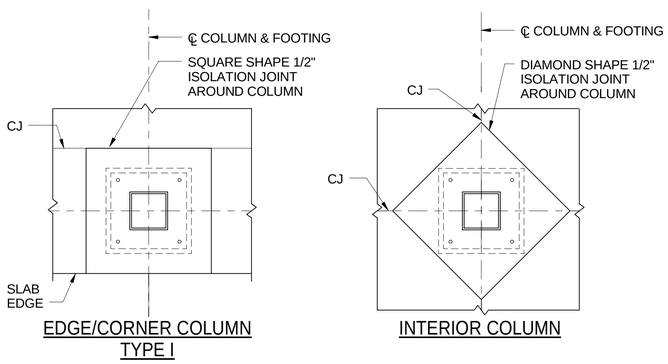

EDGE/CORNER COLUMN TYPE I

INTERIOR COLUMN

B1 SLAB ISOLATION JOINTS AT COLUMN BASE
NOT TO SCALE



B3 PEDESTAL TYPE AND REINF LAYOUT
NOT TO SCALE

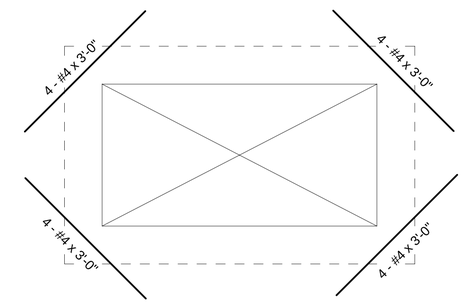

B4 SLAB REINFORCING AROUND OPENING
NOT TO SCALE

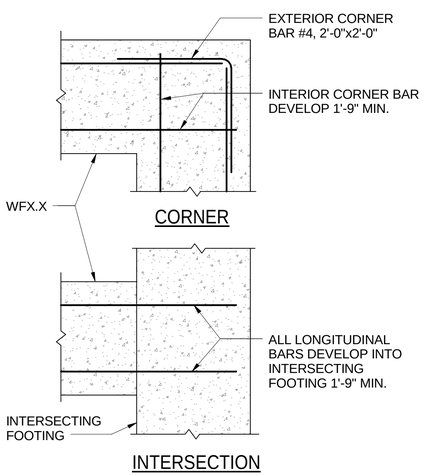

A1 TYPICAL REINFORCING AT FOOTING INTERSECTIONS
NOT TO SCALE

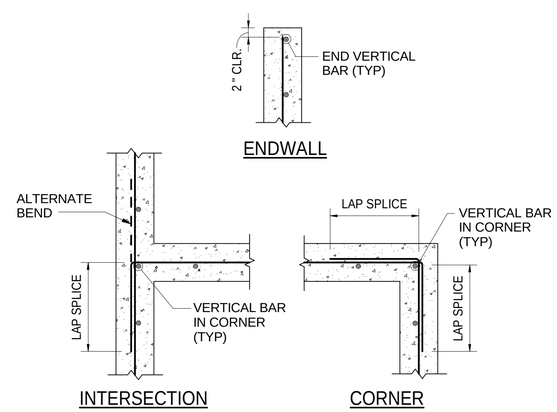

A3 TYPICAL SINGLE MAT REINFORCING IN CONCRETE WALLS
NOT TO SCALE

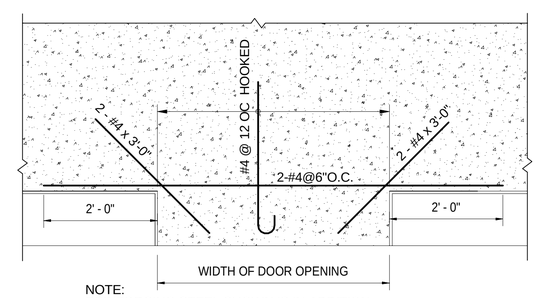

NOTE:
REINFORCING STEEL SHOWN IS IN ADDITION TO TYPICAL SLAB REINFORCING STEEL.

A4 SLAB REINFORCING AT DOORWAY
NOT TO SCALE

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer | DATE: SEPTEMBER 12, 2012
DRAWN BY: Author | CKD BY: Checker | SOLICITATION NO.:
SBMT BY: Approver | PLOT DATE: 11/2/2012 8:32:22 AM | CONTRACT NO.:
PLOT SCALE: | FILE NUMBER:
SIZE: 22" x 34" | FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6116 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
TYPICAL STRUCTURAL DETAILS

SHEET IDENTIFICATION
S-501
SHEET 0 OF 0

S-501-

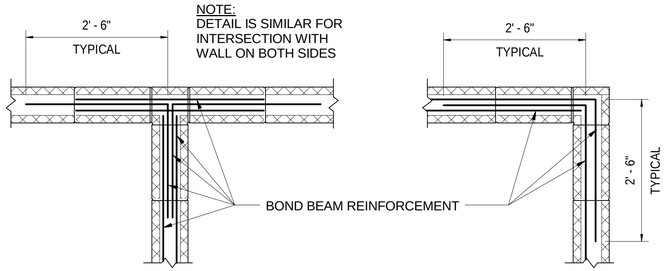

C1 TYPICAL DETAIL AT BOND BEAM INTERSECTIONS

NOT TO SCALE

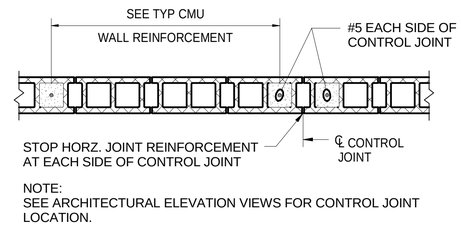

C3 TYPICAL REINFORCING AT CONTROL JOINT

NOT TO SCALE

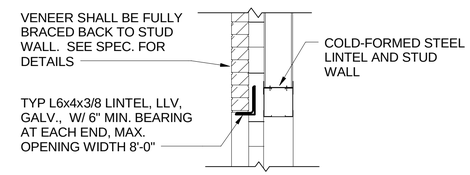

C4 BRICK VENEER LINTEL

NOT TO SCALE

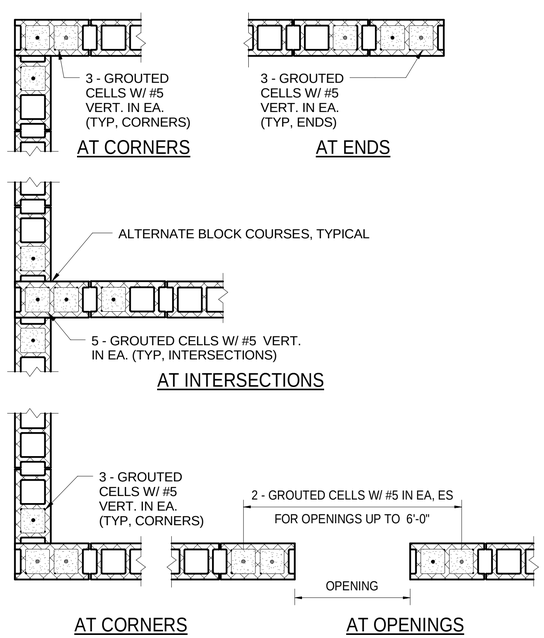

A1 TYPICAL REINFORCING AT CMU WALLS

NOT TO SCALE

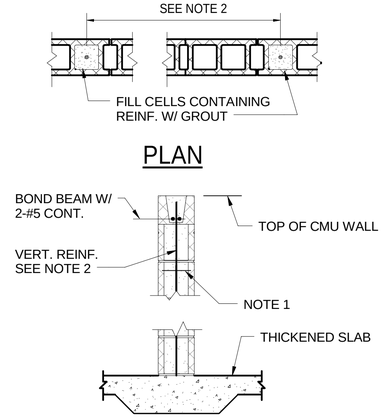

NOTES:

1. HORIZONTAL JOINT REINFORCEMENT SPACED AT 16" O.C. VERTICAL WITH 2-NO. 9 WIRE MINIMUM. PROVIDE ADDITIONAL HORIZONTAL JOINT REINFORCEMENT ONE COURSE ABOVE AND BELOW OPENINGS EXTENDING A MINIMUM OF 2'-0" BEYOND FACE OF OPENING ON EACH SIDE.

2. VERTICAL WALL REINFORCING:
   - 8" CMU #5 @ 48" IN FILLED CELL
   - 10" CMU #5 @ 48" IN FILLED CELL
   - 12" CMU #5 @ 48" EF IN FILLED CELL

A3 TYPICAL CMU WALL REINFORCEMENT

NOT TO SCALE

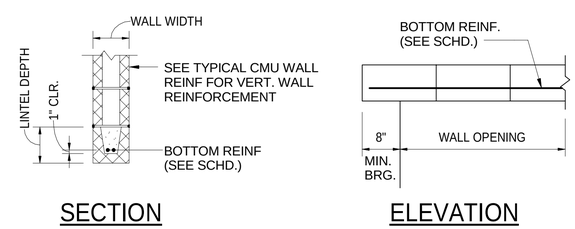

NOTES:

1. FILL CMU CORE AT LINTEL BEARING WITH GROUT AND 1-#5 VERTICAL CONT. TYPICAL FULL HEIGHT FOR NON-LOAD-BEARING PARTITIONS.

2. FIELD CUT OPENINGS GREATER THAN 12". USE CMU LINTEL FOR OPENINGS UP TO 3'-0". USE L4x4x1/4, EACH SIDE OF THE WALL, WITH 8" BEARING EACH END.

LINTEL/SILL SCHEDULE

WALL OPENING	LINTEL DEPTH	REINFORCEMENT
UP TO 4'-0"	8"	2-#4 BOTTOM
4'-0" - 6'-0"	8"	2-#5 BOTTOM
6'-0" TO 8'-0"	16"	2-#5 BOTTOM
8'-0" TO 12'-0"	16"	2-#6 BOTTOM

A4 TYPICAL MASONRY LINTEL

NOT TO SCALE

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:
DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
CKD BY: Checker
PLOT DATE: 11/2/2012 1:36:31 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
TYPICAL STRUCTURAL DETAILS

SHEET IDENTIFICATION
S-502
SHEET 0 OF 0

S-502-



PLAN

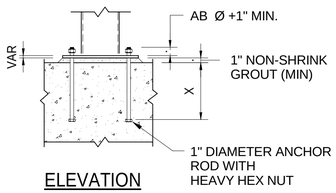

ELEVATION

THE DIMENSION X IS A MINIMUM EMBEDMENT DEPTH AS FOLLOWS:

_____

_____

THE BASE PLATE THICKNESS IS _____

C1 COLUMN BASE PLATE DETAIL
NOT TO SCALE



PLAN



ELEVATION

C2 COLUMN CAP PLATE DETAIL
NOT TO SCALE

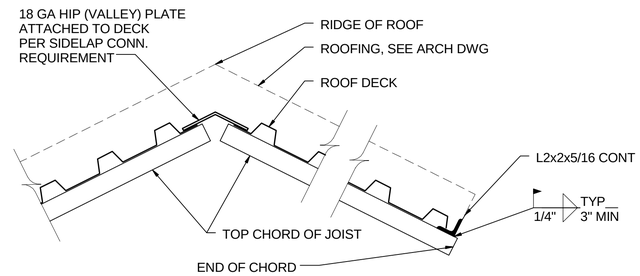

C4 ATTACHMENT AT EDGE OF STEEL DECK
NOT TO SCALE

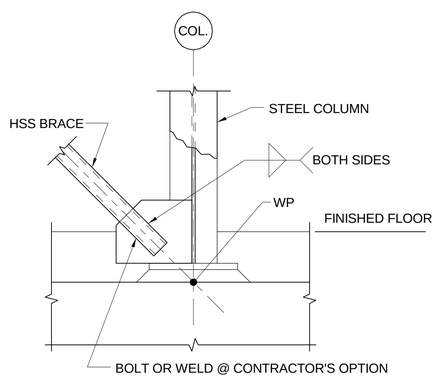

NOTE:
SEE BRACING ELEVATION AND SCHEDULE FOR BRACING SIZES AND LOADS.
DESIGN PIPE BRACE CONN. FOR AXIAL FORCES IN BRACE AS INDICATED.

A1 BRACED FRAME BASE CONNECTION
NOT TO SCALE

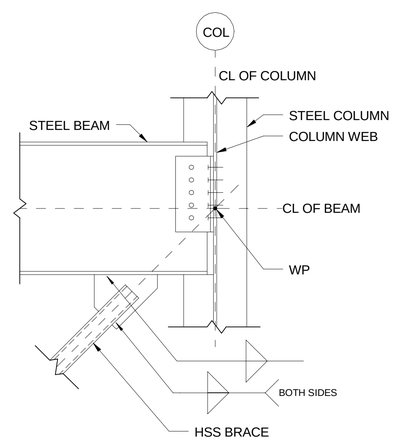

A2 BRACED FRAME CONNECTION
NOT TO SCALE

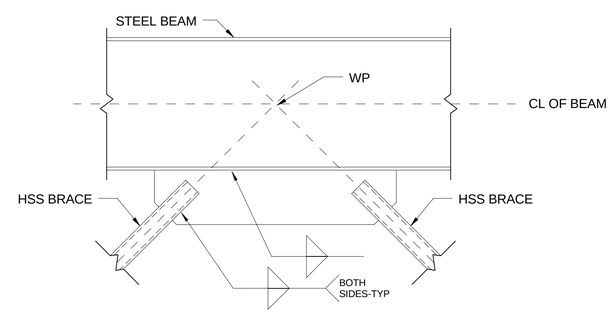

A4 BRACED FRAME CENTER CONNECTION
NOT TO SCALE

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:
PLOT DATE: 11/2/2012 8:52:32 AM
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6135 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
TYPICAL STRUCTURAL DETAILS

SHEET IDENTIFICATION
S-503
SHEET OF 0

S-503-

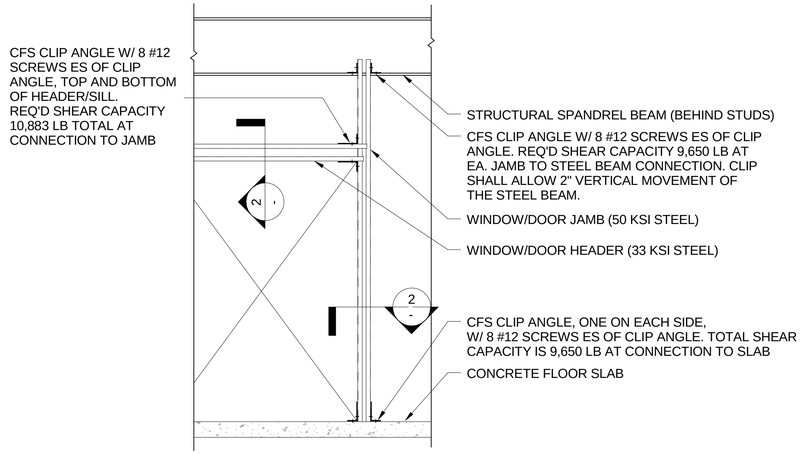

NOTES:

1. METAL STUD FRAMING SHOWN SHALL BE USED AT ALL EXTERIOR WINDOWS AND GLAZED DOORS (SEE ARCH DWG) TO COMPLY WITH ATFP STANDARDS ACCORDING TO UFC-4-010-01.

2. NOMENCLATURE CITED ABOVE IS BASED ON PRODUCT CATALOG OF THE STEEL NETWORK, INC. CONTRACTOR MAY EXCHANGE TO PRODUCT OF OTHER MANUFACTURE, PROVIDED IT SATISFIES THE LOAD CAPACITY LISTED ABOVE, AND IS APPROVED BY THE EOR.

C2 STOREFRONT ELEVATION
NOT TO SCALE

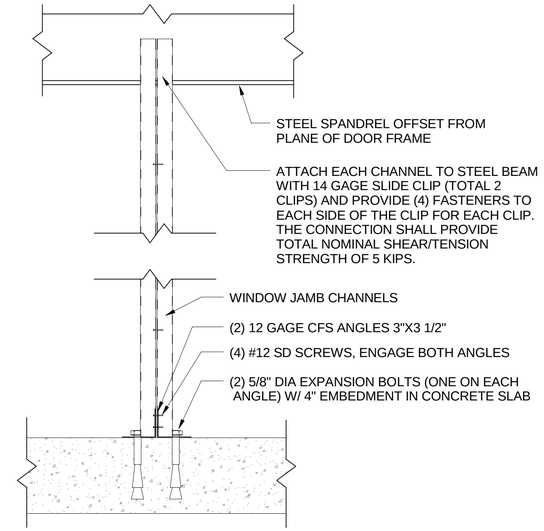

C4 ATFP WINDOW FRAME ELEVATION
NOT TO SCALE

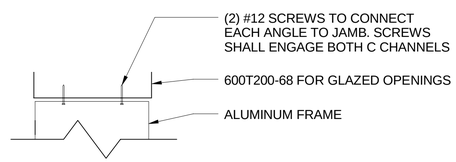

TYPICAL HEADER/SILL
NOT TO SCALE

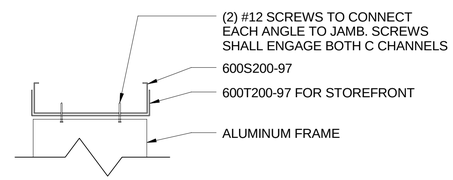

STOREFRONT HEADER/SILL
NOT TO SCALE

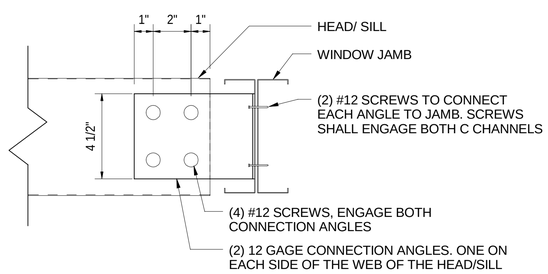

TYPICAL CONNECTION ON HEAD/SILL
NOT TO SCALE

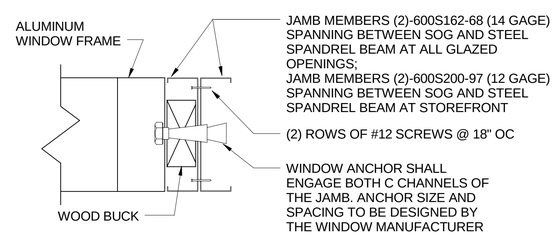

TYPICAL WINDOW/STOREFRONT JAMB
NOT TO SCALE

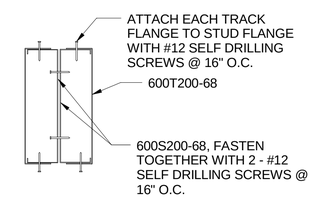

B4 STOREFRONT JAMB/HEADER
3" = 1'-0"

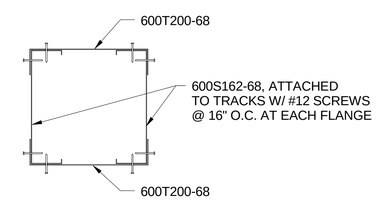

A4 WINDOW HEADER / SILL
NOT TO SCALE

A2 COLD FORMED STEEL EXTERIOR WINDOW FRAME
NOT TO SCALE

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 8:56:32 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
TYPICAL ATFP STRUCTURAL DETAILS

SHEET IDENTIFICATION
S-504
SHEET 0 OF 0

S-504-

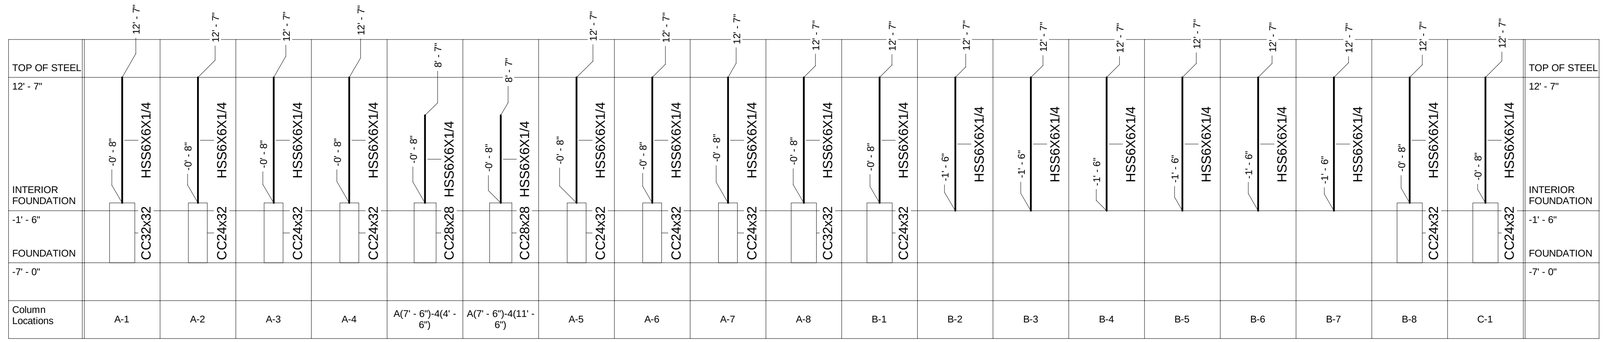

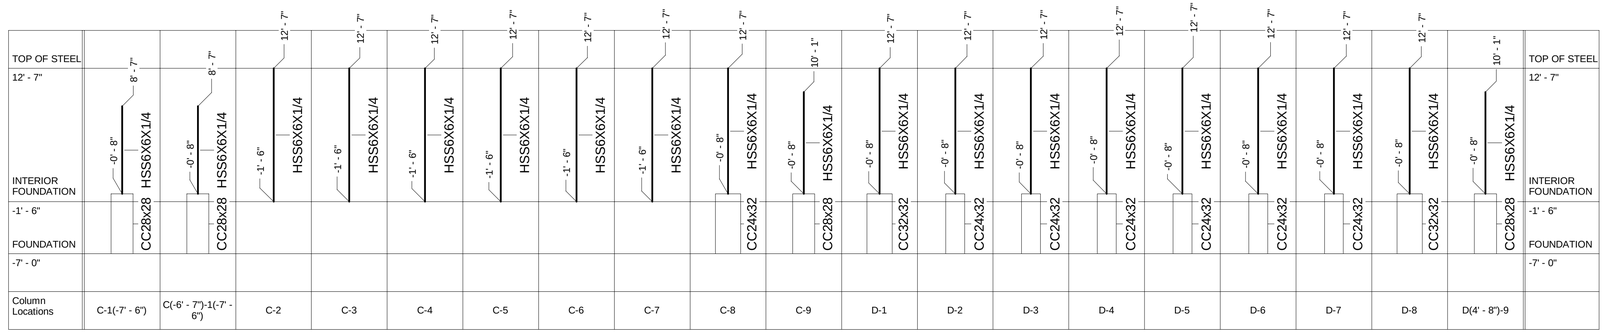

COLUMN FOOTING SCHEDULE

MARK	DIMENSIONS			REINFORCING				REMARKS
				A - BARS		B - BARS		
	WIDTH	LENGTH	DEPTH	QUANTITY	SIZE	QUANTITY	SIZE	
CF3.0	3' - 0"	3' - 0"	1' - 6"	4	4	4	4	
CF6.0	6' - 0"	6' - 0"	2' - 0"	8	4	8	4	
CF7.0	7' - 0"	7' - 0"	2' - 0"	7	5	7	5	
CF7.5	7' - 6"	7' - 6"	2' - 0"	6	6	6	6	

WALL FOOTING SCHEDULE

MARK	DIMENSIONS		REINFORCING				NOTES
			LONGITUDINAL		TRANSVERSE		
	WIDTH	DEPTH	QUANTITY	SIZE	SIZE	SPACING	
WF1.5	1' - 6"	1' - 0"	2	4	4	4' - 0"	

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
SIZE: 22" x 34"
DATE: SEPTEMBER 12, 2012
CKD BY: Checker
PLOT DATE: 11/2/2012 8:50:24 AM
PLOT SCALE:
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
COLUMN SCHEDULES AND FOUNDATION SCHEDULES

SHEET IDENTIFICATION
S-601
SHEET 0 OF 0

S-601-

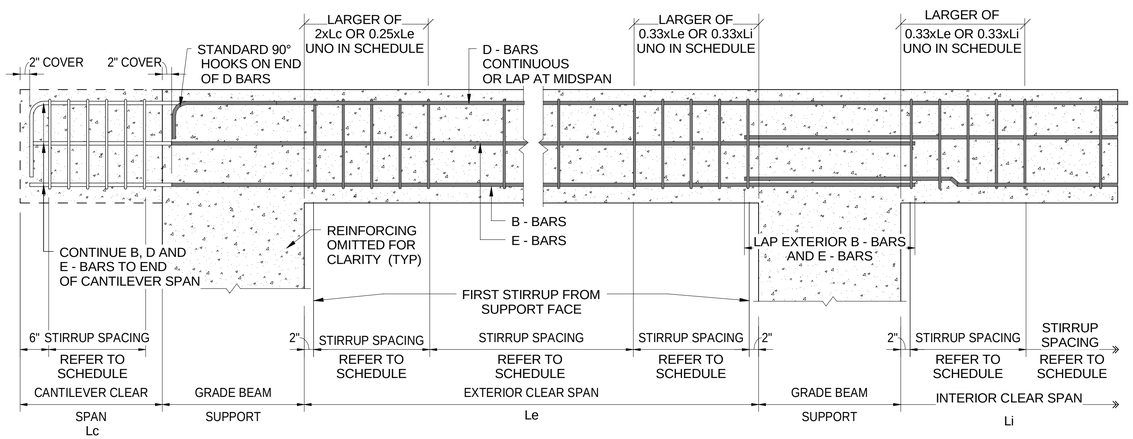

ELEVATION



NOTES:
LAP OUTSIDE FACE B - BARS OVER INTERIOR SUPPORTS AND EXTEND TO END OF EXTERIOR SUPPORTS.

INTERIOR B - BARS EXTEND 6" INTO SUPPORTS

WHERE AREA OF D - BARS ARE DIFFERENT IN ADJACENT SPANS, EXTEND COMBINATION WITH GREATEST AREA TO MIDSPAN OF ADJACENT SPAN

SECTION

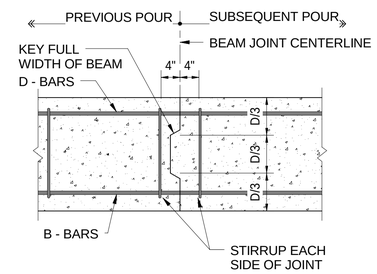

CONSTRUCTION JOINT

GRADE BEAM SCHEDULE

MARK	DIMENSIONS		REINFORCING													REMARKS
			A - BARS		B - BARS		C - BARS		D - BARS		E - BARS		STIRRUPS			
	WIDTH	DEPTH	QUANTITY	SIZE	QUANTITY	SIZE	QUANTITY	SIZE	QUANTITY	SIZE	QUANTITY	SIZE	SIZE	SPACING	TYPE	
GB14x24	14"	24"	0	0	0	0	0	0	0	0	0	0	0	0"	2	
GB18x24	18"	24"	0	0	0	0	0	0	0	0	0	0	0	0"	2	

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

DESIGN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Approver
PLOT DATE: 11/2/2012 1:58:35 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND FILED OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
FRAMING SCHEDULES

SHEET IDENTIFICATION
S-602
SHEET 0 OF 0

S-602-

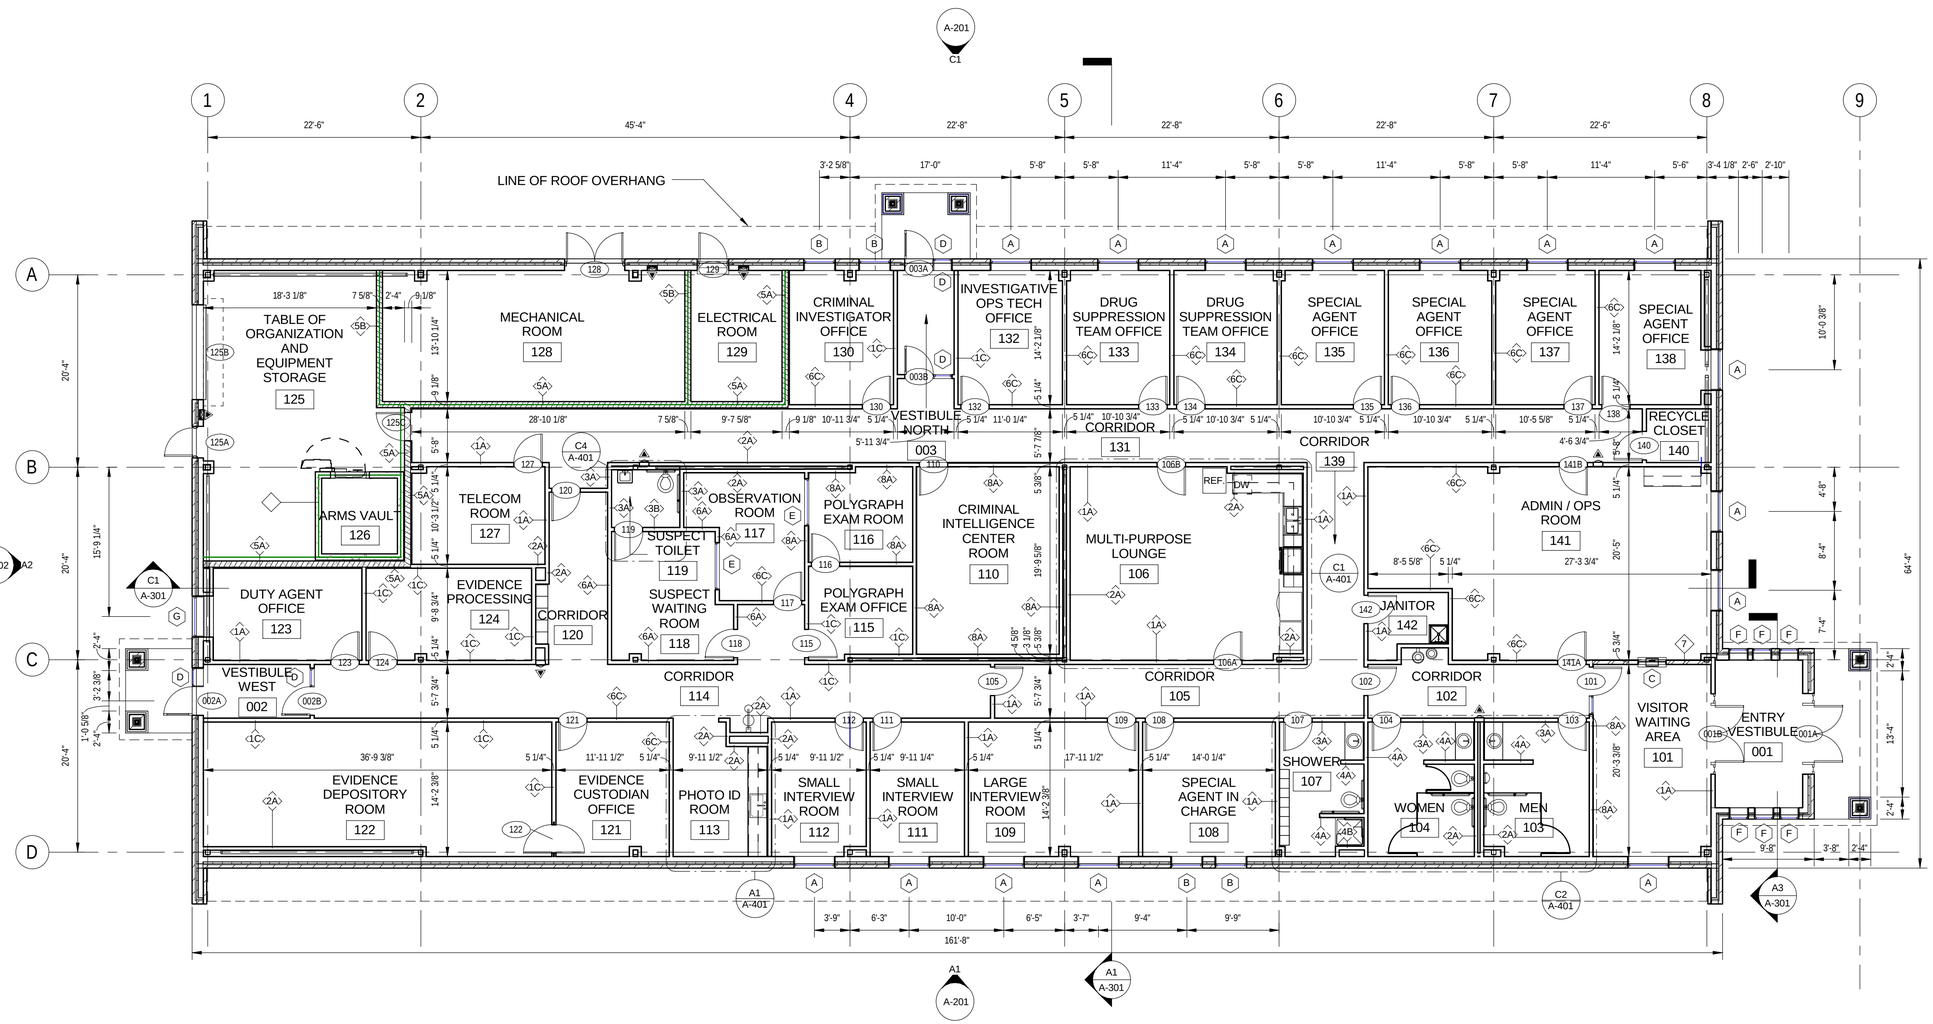

A1 FLOOR PLAN
1/8" = 1'-0"

PLAN NORTH

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER: 212C011 T12D012
DESIGN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Designer
PLOT DATE: 11/2/2012 8:32:24 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME: file name

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6101 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
FLOOR PLAN

SHEET IDENTIFICATION
A-101
SHEET OF 1

A L- A-101- XXX

1. UNLESS OTHERWISE NOTED CEILING HEIGHT SHALL BE 9' 0" AFF

2. HVAC DIFFUSERS, GRILLES, AND SPRINKLER HEADS ARE NOT SHOWN, DUE TO LEVEL OF COMPLETION OF WORK.

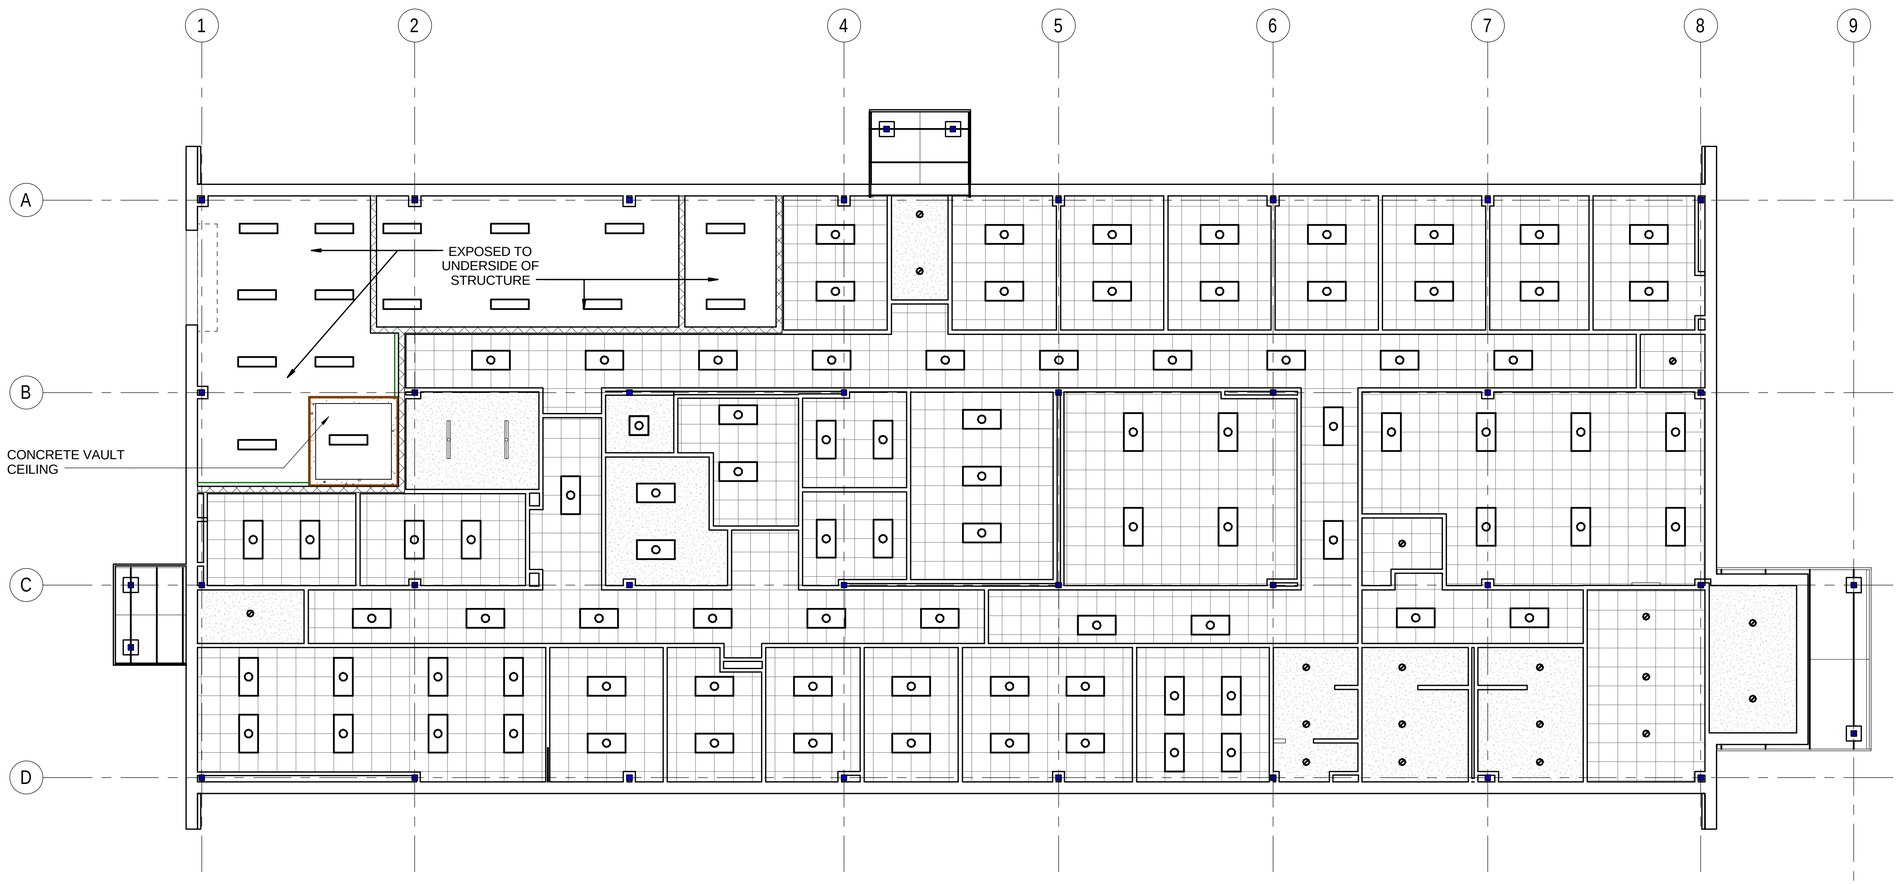

A1 REFLECTED CEILING PLAN
1/8" = 1'-0"

PLAN NORTH

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPD

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
CKD BY: Checker
PLOT DATE: 11/13/2012 11:37:47 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
REFLECTED CEILING PLAN

SHEET IDENTIFICATION
A-102
SHEET OF 1

A A-102-

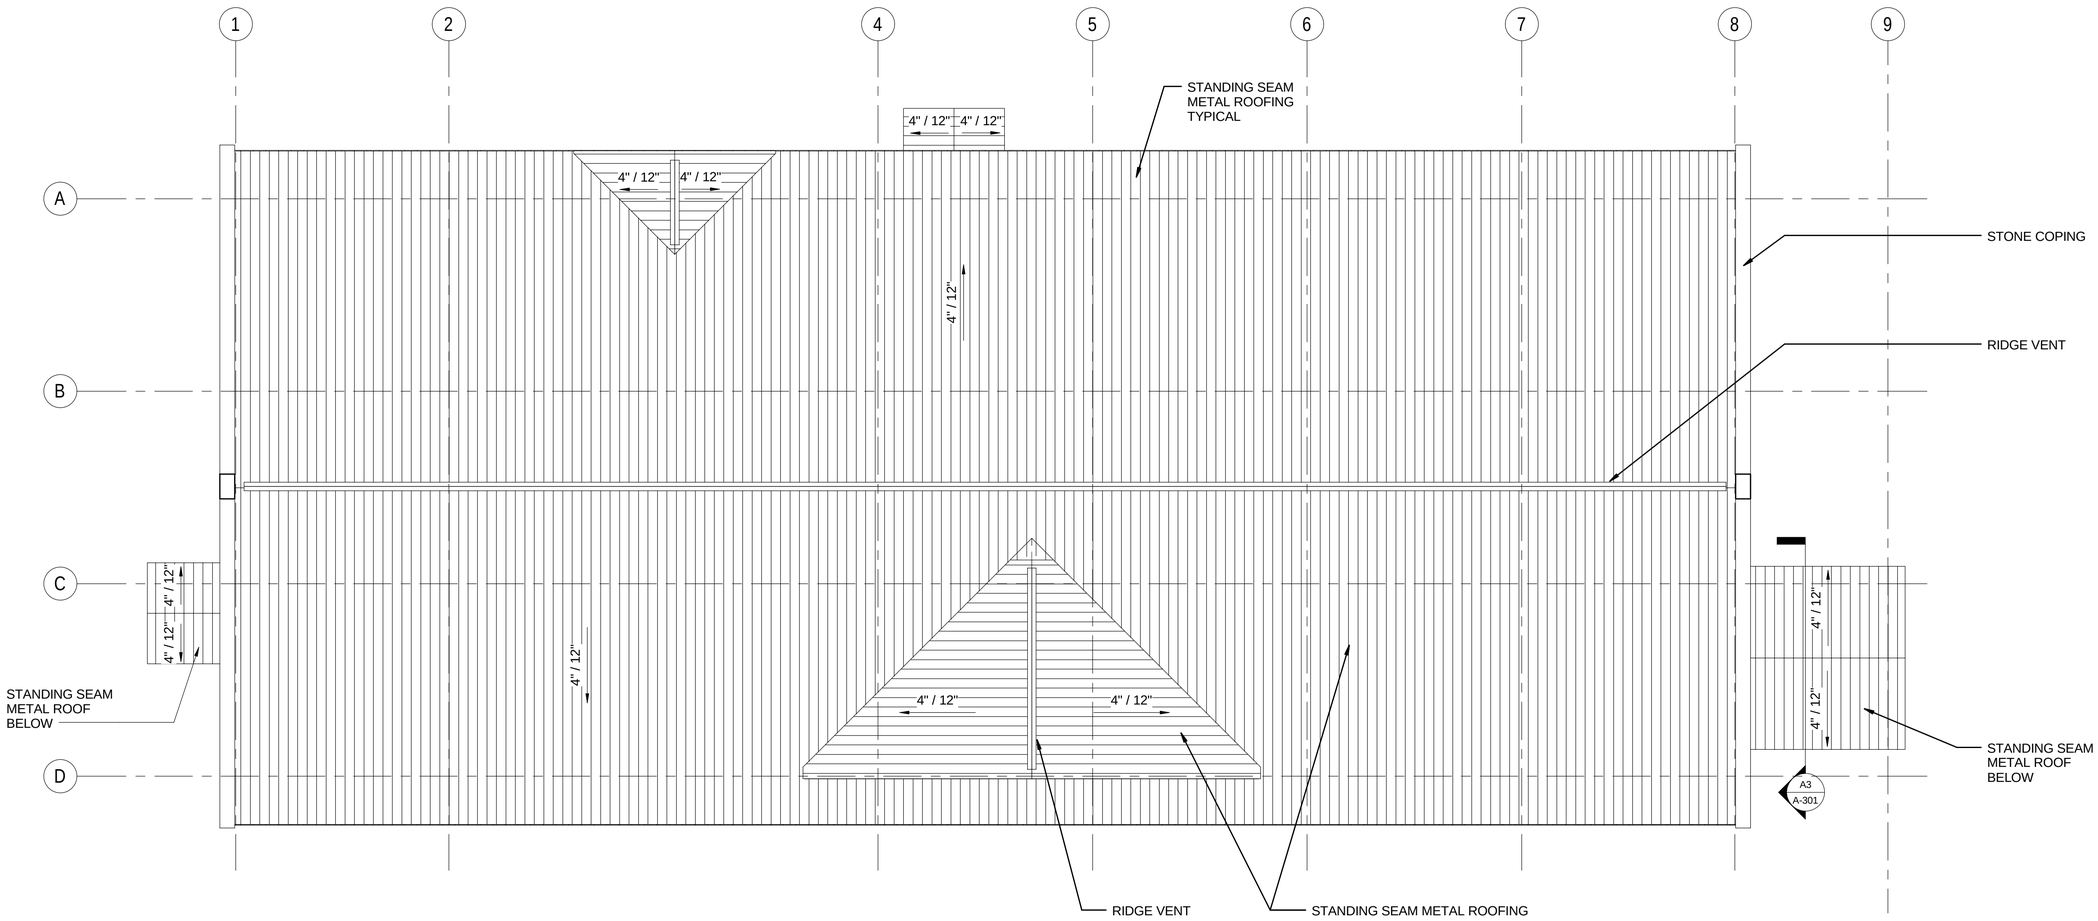

A1 ROOF PLAN
1/8" = 1'-0"

PLAN NORTH

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.
-	-	-	-

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012, 8:32:24 AM
PLOT SCALE: 1:1
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
ROOF PLAN

SHEET IDENTIFICATION
A-103
SHEET OF 1

A A-103-

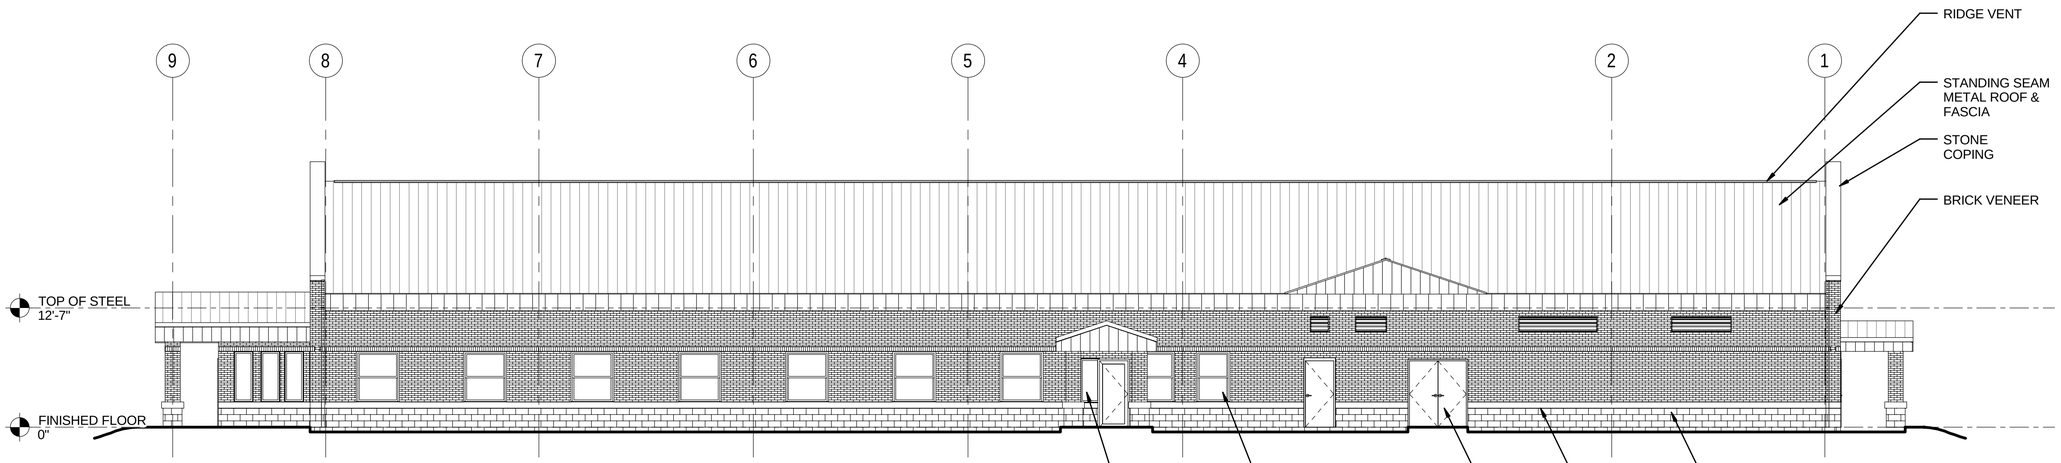

C1 NORTH ELEVATION
1/8" = 1'-0"

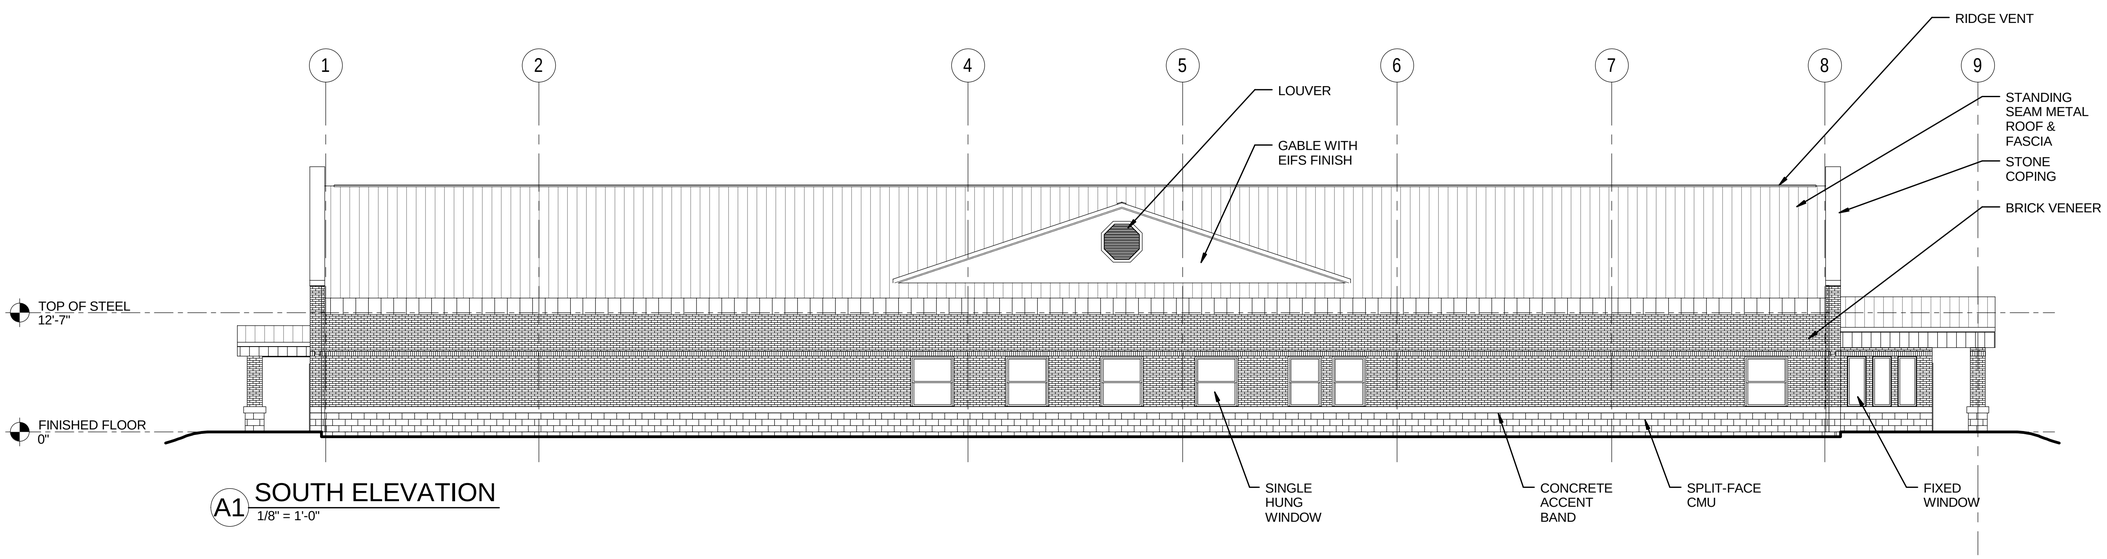

A1 SOUTH ELEVATION
1/8" = 1'-0"

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:
DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
CKD BY: Checker
PLOT DATE: 11/2/2012, 1:32:27 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
NORTH AND SOUTH ELEVATIONS

SHEET IDENTIFICATION
A-201
SHEET OF 1

A-201-

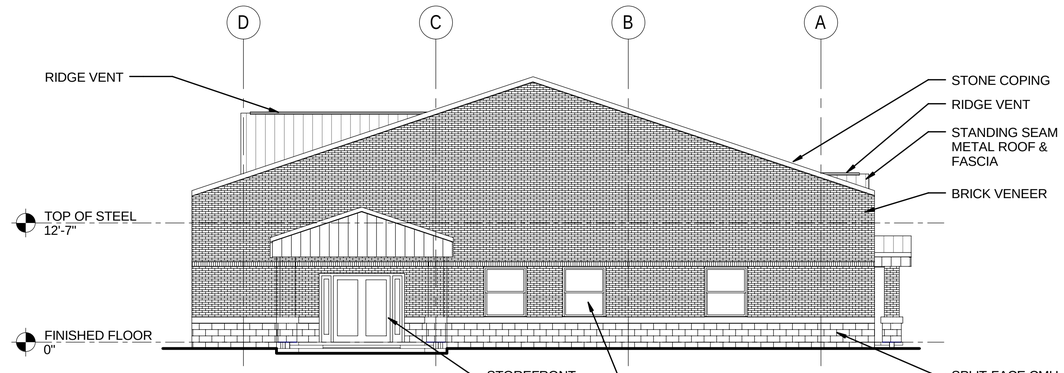

C2 EAST ELEVATION
1/8" = 1'-0"

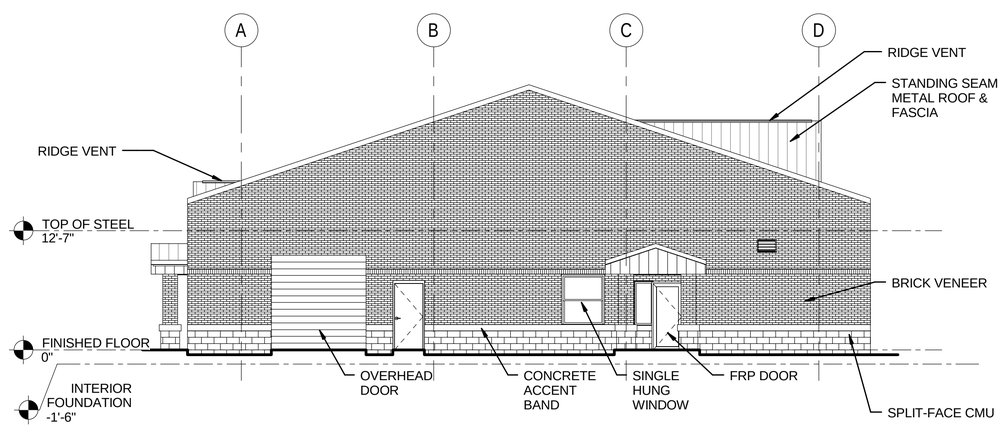

A2 WEST ELEVATION
1/8" = 1'-0"

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 8:28:31 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND FIELD OPERATIONS BUILDING, RA 10-15 ADAPT-BUILD - FORT DRUM, NY
EAST AND WEST ELEVATIONS

SHEET IDENTIFICATION
A-202
SHEET OF 1

A A-202-

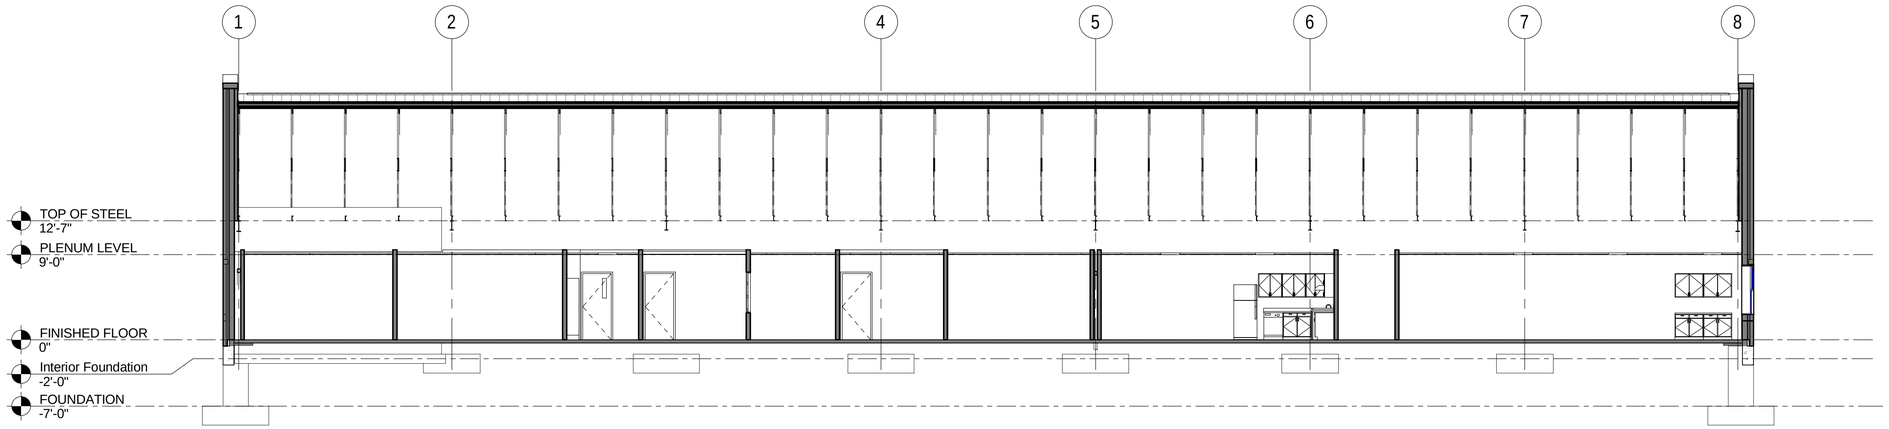

C1 BUILDING SECTION - LONGITUDINAL
1/8" = 1'-0"

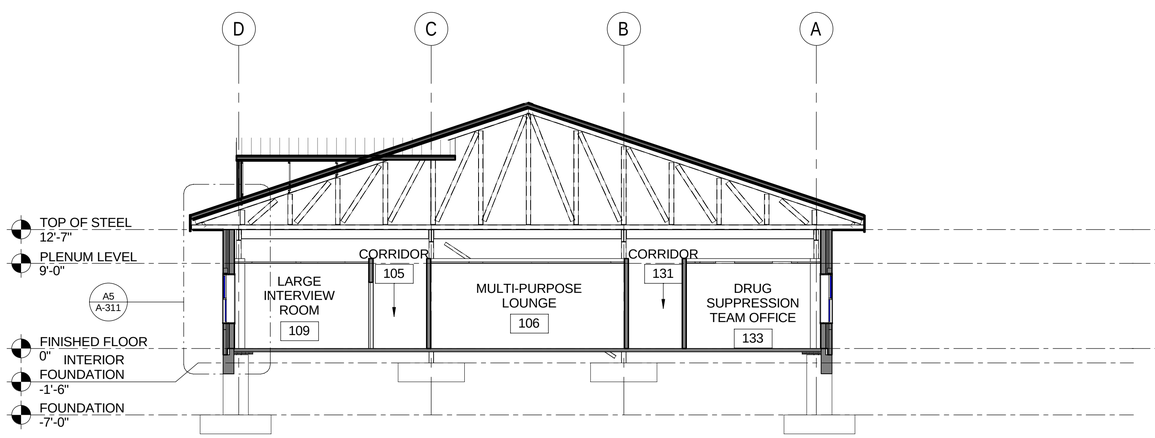

A1 BUILDING SECTION - TRANSVERSE
1/8" = 1'-0"

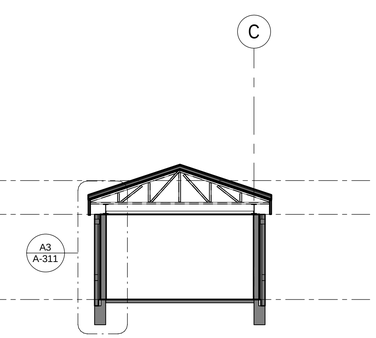

A3 BUILDING SECTION - VESTIBULE
1/8" = 1'-0"

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
CKD BY: Checker
PLOT SCALE:
PLOT DATE: 11/2/2012 8:22:34 AM
SIZE: 22" x 34"
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
BUILDING SECTIONS

SHEET IDENTIFICATION
A-301
SHEET OF 1

A A-301-

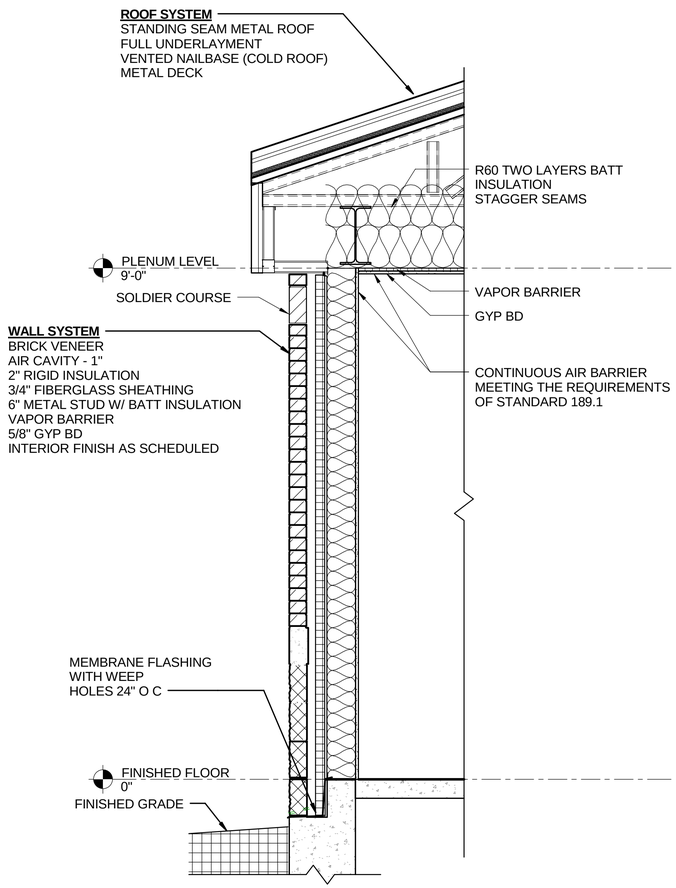

A3 WALL SECTION - VESTIBULE
3/4" = 1'-0"

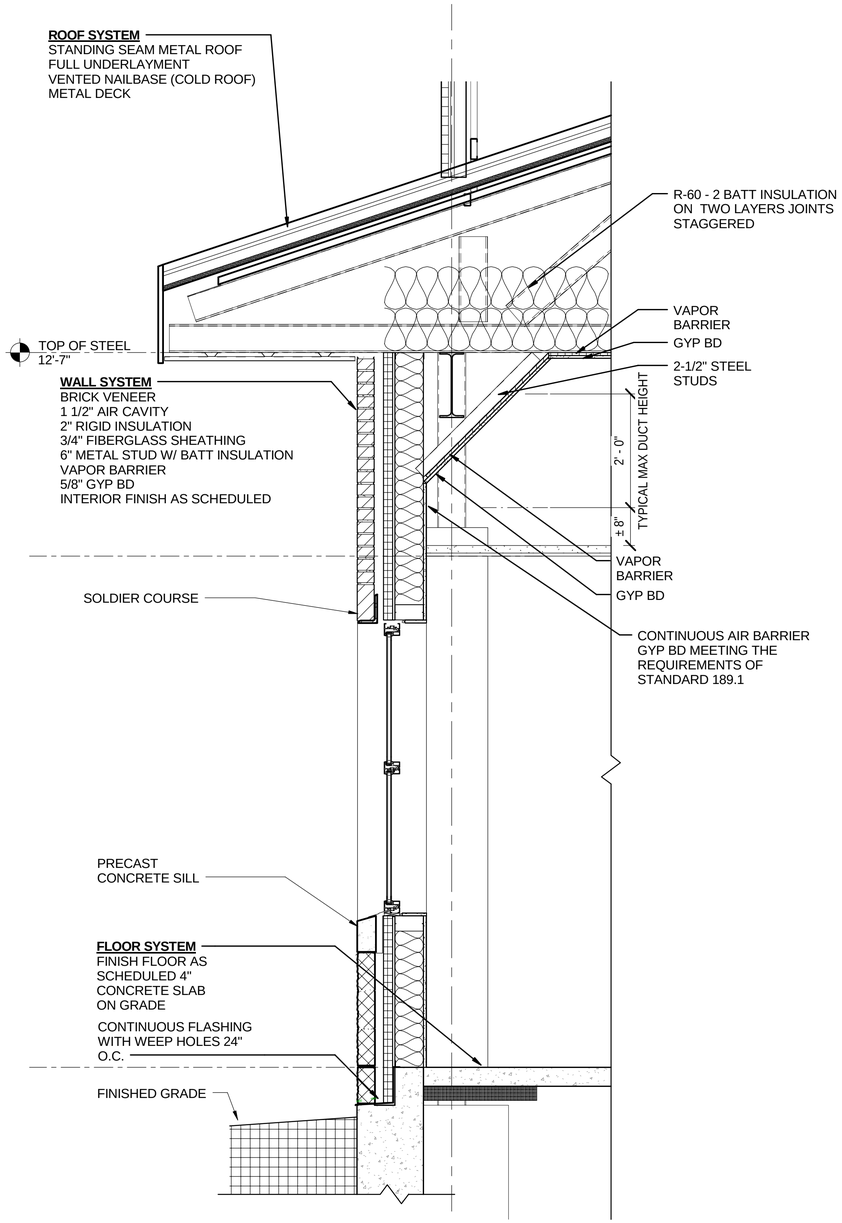

A5 TYPICAL WALL SECTION
3/4" = 1'-0"

2 1 0 2
SCALE: 3/4"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
SIZE: 22" x 34"
CKD BY: Checker
PLOT SCALE: 1
PLOT DATE: 1/12/2012 8:32:29 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
WALL SECTIONS

SHEET IDENTIFICATION
A-311
SHEET OF 1

A A-311-

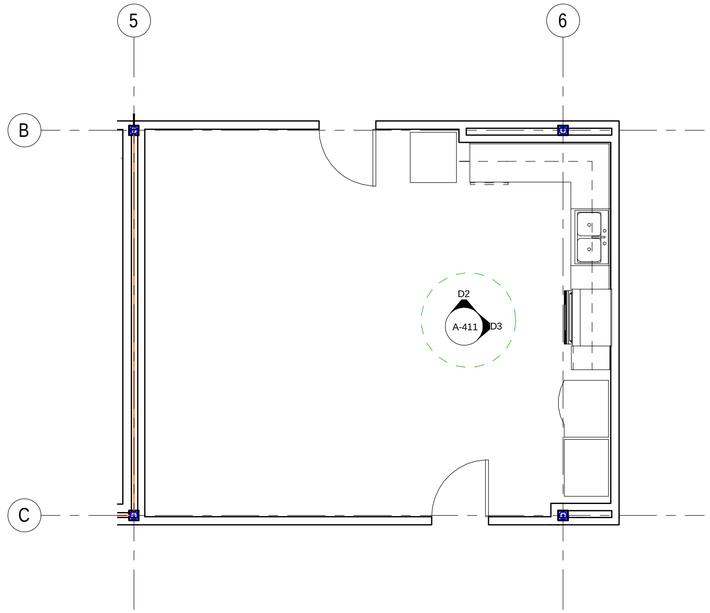

ENLARGED PLAN - MULTI-PURPOSE LOUNGE
C1 1/4" = 1'-0"

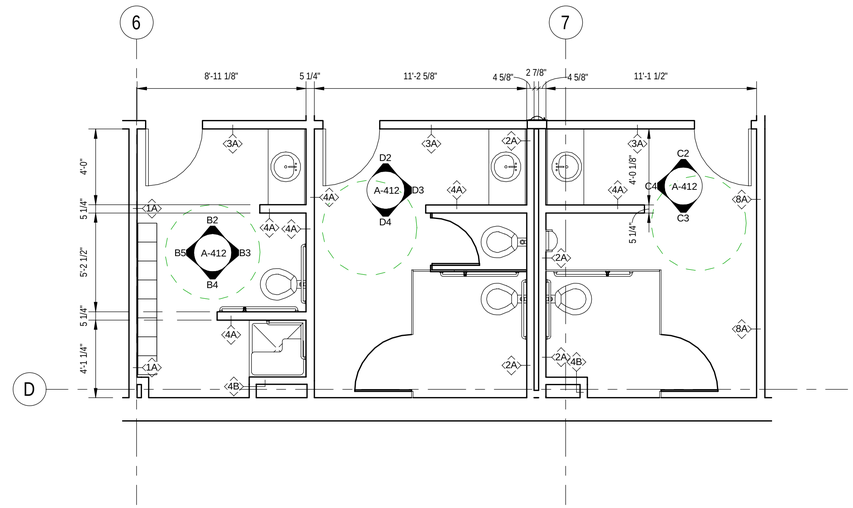

ENLARGED PLAN - MENS & WOMENS RESTROOMS
C2 1/4" = 1'-0"

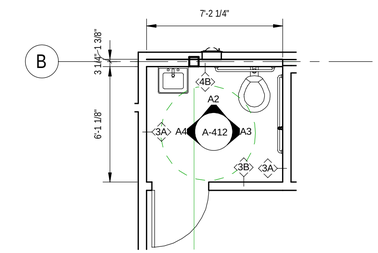

ENLARGED PLAN - SUSPECT TOILET
C4 1/4" = 1'-0"

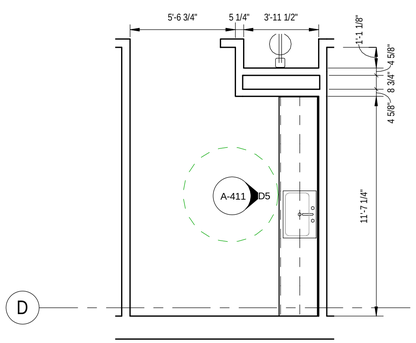

ENLARGED PLAN - PHOTO ID ROOM
A1 1/4" = 1'-0"

SCALE: 1/4"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer	DATE: SEPTEMBER 12, 2012
DRAWN BY: Author	SOLICITATION NO.:
CKD BY: Checker	CONTRACT NO.:
SBMT BY: Designer	PLOT DATE: 11/22/2012 8:42:28 AM
PLOT SCALE: 1	FILE NUMBER:
SIZE: 22" x 34"	FILE NAME:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
ENLARGED PLANS

SHEET IDENTIFICATION
A-401
SHEET OF 1

A-401-

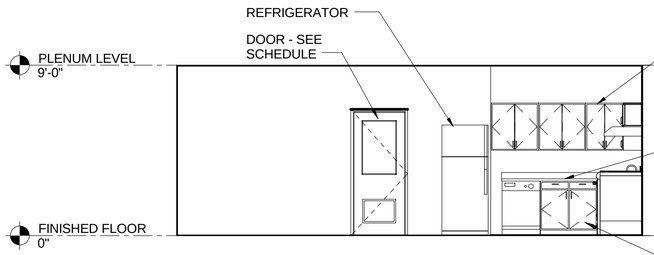

D2 MULTI-PURPOSE LOUNGE
1/4" = 1'-0"

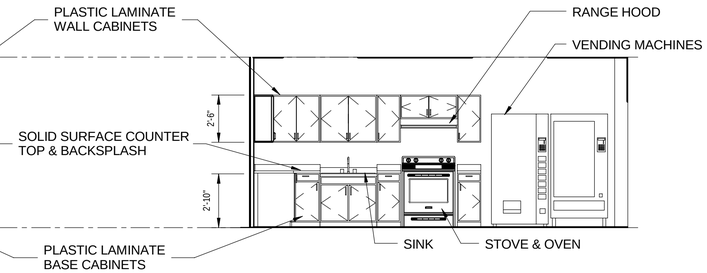

D3 MULTI-PURPOSE LOUNGE
1/4" = 1'-0"

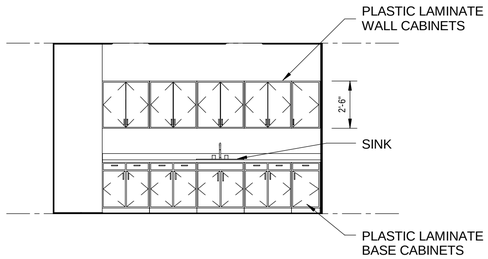

D5 PHOTO ID ROOM
1/4" = 1'-0"

4 3 2 1 0 4 8
SCALE: 1/4"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 10:29:40 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
INTERIOR ELEVATIONS

SHEET IDENTIFICATION
A-411
SHEET OF 1

A-411-

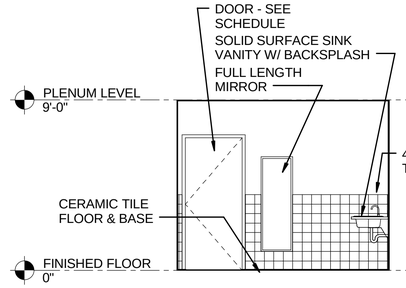

D2 WOMEN RESTROOM
1/4" = 1'-0"

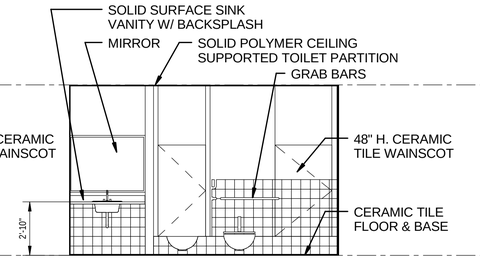

D3 WOMEN RESTROOM
1/4" = 1'-0"

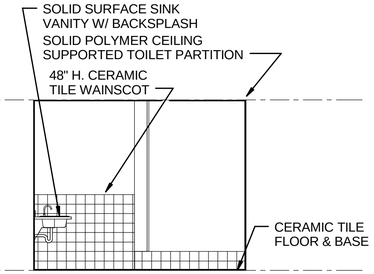

D4 WOMEN RESTROOM
1/4" = 1'-0"

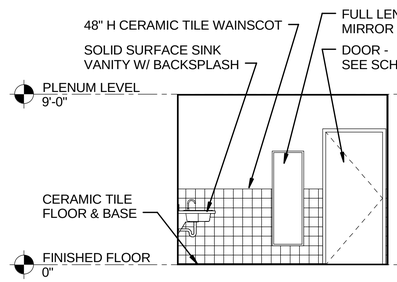

C2 MEN RESTROOM
1/4" = 1'-0"

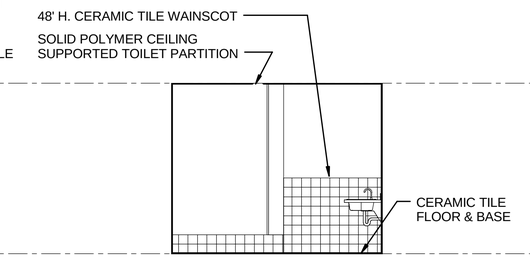

C3 MEN RESTROOM
1/4" = 1'-0"

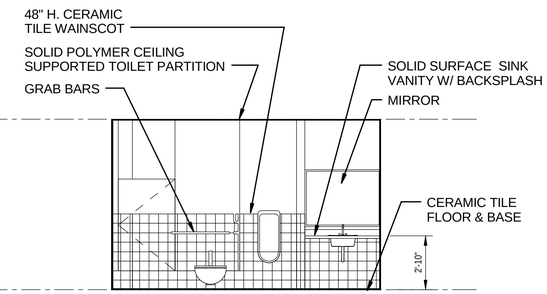

C4 MEN RESTROOM
1/4" = 1'-0"

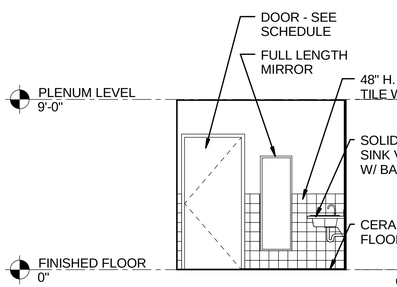

B2 SHOWER
1/4" = 1'-0"

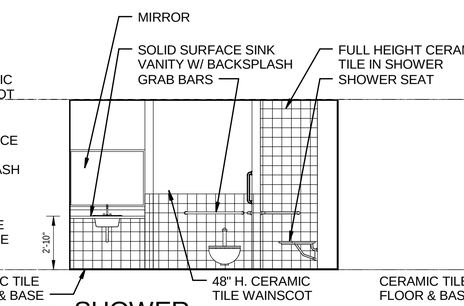

B3 SHOWER
1/4" = 1'-0"

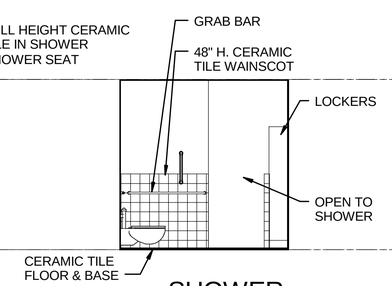

B4 SHOWER
1/4" = 1'-0"

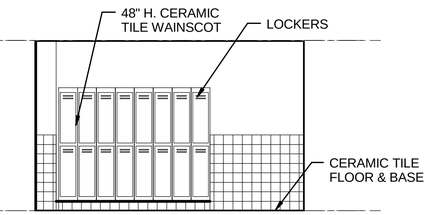

B5 SHOWER
1/4" = 1'-0"

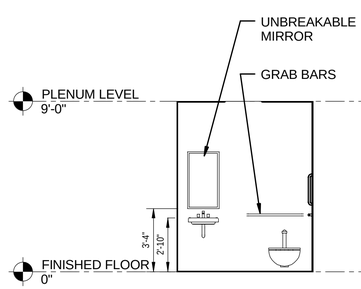

A2 SUSPECT TOILET
1/4" = 1'-0"



A3 SUSPECT TOILET
1/4" = 1'-0"



A4 SUSPECT TOILET
1/4" = 1'-0"

4 3 2 1 0 4 8
SCALE: 1/4"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
PLOT SCALE:
SIZE: 23" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012, 10:28:44 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND FIELD OPERATIONS BUILDING, RA 10-15 ADAPT-BUILD - FORT DRUM, NY
INTERIOR ELEVATIONS

SHEET IDENTIFICATION
A-412
SHEET OF 1

A-412-

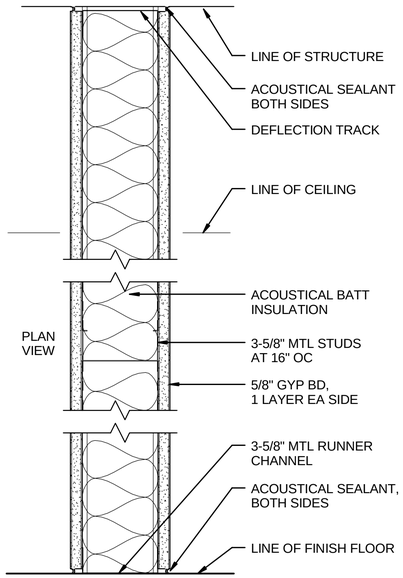

1A STC 45 RATED

1B SMOKE RATED STC 45

1C SMOKE RATED OMIT ACOUSTICAL INSULATION

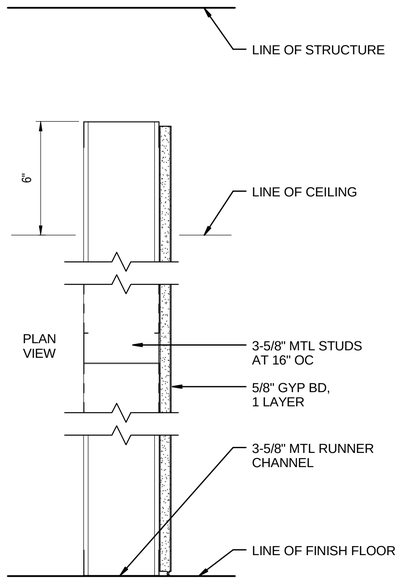

2A

2B IMPACT-RESISTANT GYP BD - ONE SIDE

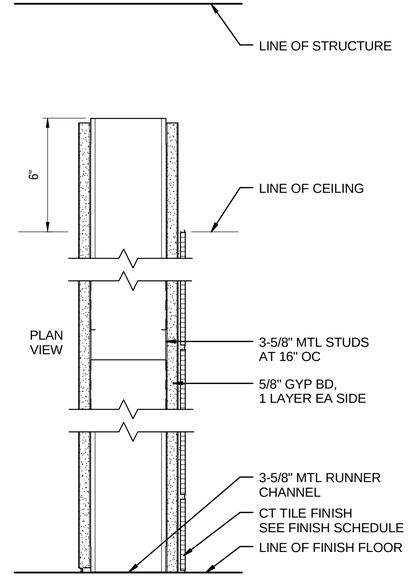

3A

3B IMPACT-RESISTANT GYP BD - ONE LAYER, OPPOSITE CERAMIC TILE (CT)

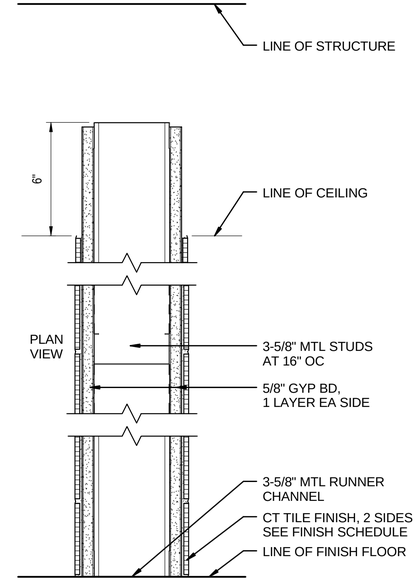

4A CT FINISH - BOTH SIDES

4B CT FINISH - ONE SIDE

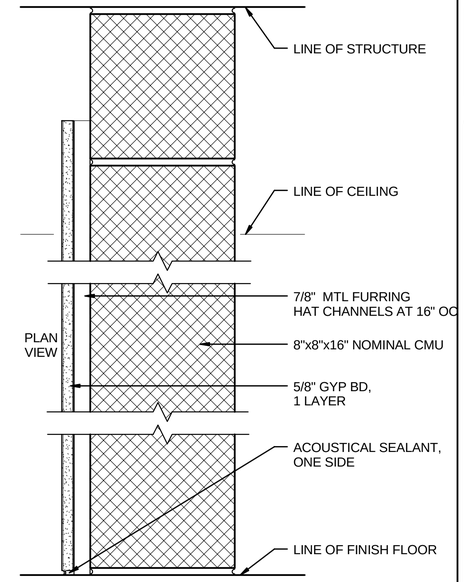

5A EXTEND TO UNDERSIDE OF STRUCTURE - SMOKE RATED

5B CMU ONLY EXTEND TO UNDERSIDE OF STRUCTURE - SMOKE RATED

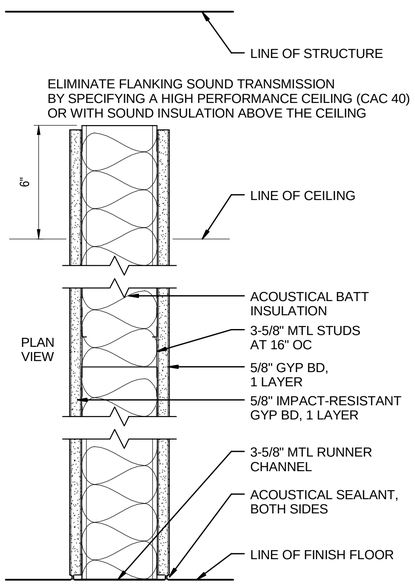

6A STC 40

6B IMPACT-RESISTANT GYP BD - BOTH SIDES STC 40

6C OMIT IMPACT- RESISTANT GYP BD PROVIDE GYP BD BOTH SIDES STC 40

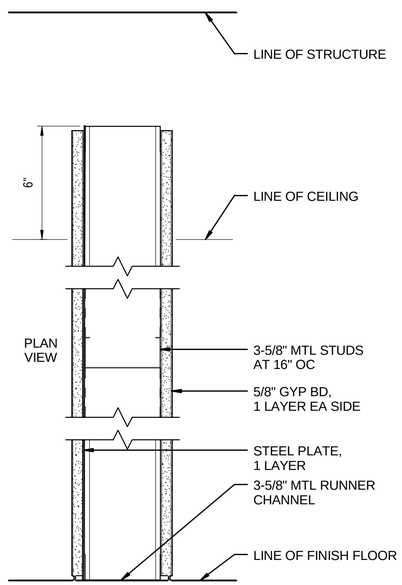

7

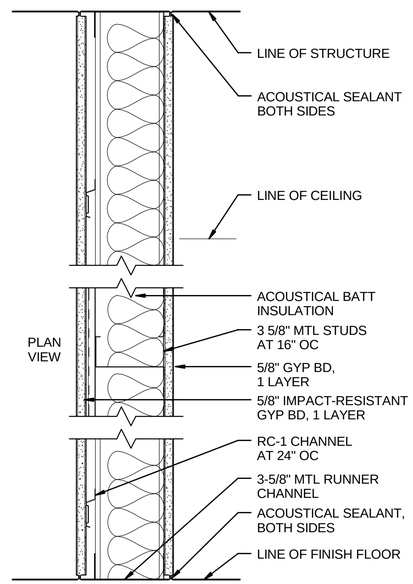

8A STC 50 RATED

8B STC 50 RATED OMIT IMPACT-RESISTANT GYP BD PROVIDE GYP BD BOTH SIDES

RATED DEFLECTION TRACK DETAILS

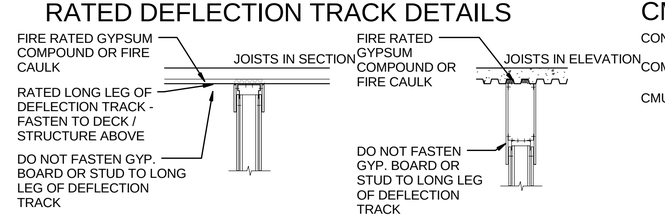

CMU WALL DETAILS



DEFLECTION TRACK DETAILS

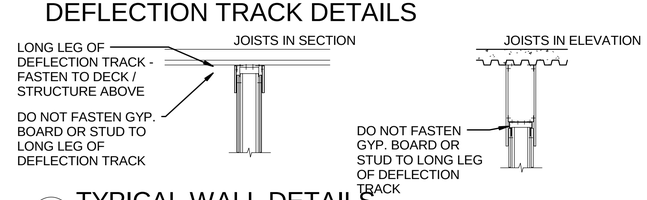

A4 TYPICAL WALL DETAILS
NOT TO SCALE

NOTE: PARTITION TYPES ARE NOT TO SCALE

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.
-	-	-	-

DESIGN BY: Designer | DATE: SEPTEMBER 12, 2012
DRAWN BY: Author | CKD BY: Checker | SOLICITATION NO.:
SBMT BY: Designer | PLOT DATE: 11/22/2012 9:32:42 AM | CONTRACT NO.:
PLOT SCALE: | FILE NUMBER:
SIZE: 22" x 34" | FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
PARTITION TYPES

SHEET IDENTIFICATION
A-601
SHEET OF 1

A A-601-

DOOR SCHEDULE

DOOR NUMBER	TYPE	DOOR SIZE WIDTH	DOOR SIZE HEIGHT	DOOR SIZE THICKNESS	DOOR MATERIAL	DOOR FINISH	UNDER CUT	FIRE RATING	SOUND RATING	FRAME TYPE	FRAME MATERIAL	FRAME FINISH	DETAILS HEAD	DETAILS JAMB	DETAILS SILL HEIGHT	HARDWARE SET	HARDWARE FUNCTION	COMMENTS
001A	G	6'-0"	7'-0"	2"	ALUM	ANOD					ALUM	ANOD			0"		F04 ENTRANCE OR OFFICE	
001B	G	6'-0"	7'-0"	2"	ALUM	ANOD					ALUM	ANOD			0"		F04 ENTRANCE OR OFFICE	
002A	E	3'-0"	7'-0"	2"	ALUM	ANOD					ALUM	ANOD			0"		CYPHER LOCK OR CARD ACCESS	
002B	E	3'-0"	7'-0"	2"	ALUM	ANOD					ALUM	ANOD			0"		F04 ENTRANCE OR OFFICE	
003A	E	3'-0"	7'-0"	2"	ALUM	ANOD					ALUM	ANOD			0"		CYPHER LOCK OR CARD ACCESS	
003B	E	3'-0"	7'-0"	2"	ALUM	ANOD					ALUM	ANOD			0"		F04 ENTRANCE OR OFFICE	
101	C	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		CYPHER LOCK OR CARD ACCESS	
102	C	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F01 PASSAGE	
103	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F01 PASSAGE	
104	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F01 PASSAGE	
105	C	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		CYPHER LOCK OR CARD ACCESS	DELAYED EGRESS HARDWARE
106A	D	3'-0"	7'-0"	2"	HM	PTD					HM	PTD			0"		F01 PASSAGE	
106B	D	3'-0"	7'-0"	2"	HM	PTD					HM	PTD			0"		F01 PASSAGE	
107	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F02 PRIVACY	
108	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 50		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
109	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 45		HM	PTD			0"		F05 CLASSROOM	
110	C	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 50		HM	PTD			0"		SECURITY HARDWARE	
111	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 45		HM	PTD			0"		F05 CLASSROOM	
112	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 45		HM	PTD			0"		F05 CLASSROOM	
115	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 45		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
116	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 50		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
117	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F04 ENTRANCE OR OFFICE	
118	C	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		SECURITY HARDWARE	
119	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F01 PASSAGE	
120	C	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		CYPHER LOCK OR CARD ACCESS	
121	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		SECURITY HARDWARE	
121A	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		SECURITY HARDWARE	
122	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		SECURITY HARDWARE	CLOSER AND LOCKSET
123	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
124	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		SECURITY HARDWARE	CLOSER AND LOCKSET
125A	A	3'-0"	7'-0"	1 3/4"	ALUM	ANOD					ALUM	ANOD			0"		F04 ENTRANCE OR OFFICE	
125B	F	10'-0"	10'-0"	2"											0"		F04 ENTRANCE OR OFFICE	
125C	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F04 ENTRANCE OR OFFICE	CLOSER AND LOCKSET
126	- - -	3'-0"	6'-8"												0"			ARMS VAULT DOOR WITH INTERIOR DAY GATE
127	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		SECURITY HARDWARE	
128	B	6'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F04 ENTRANCE OR OFFICE	
129	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F04 ENTRANCE OR OFFICE	
130	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
132	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
133	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
134	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
135	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
136	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
137	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
138	A	3'-0"	7'-0"	1 3/4"	HM	PTD			STC 40		HM	PTD			0"		F04 ENTRANCE OR OFFICE	
140	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F07 STORAGE	
141A	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F04 ENTRANCE OR OFFICE	
141B	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F04 ENTRANCE OR OFFICE	
142	A	3'-0"	7'-0"	1 3/4"	HM	PTD					HM	PTD			0"		F07 STORAGE	

DOOR TYPES

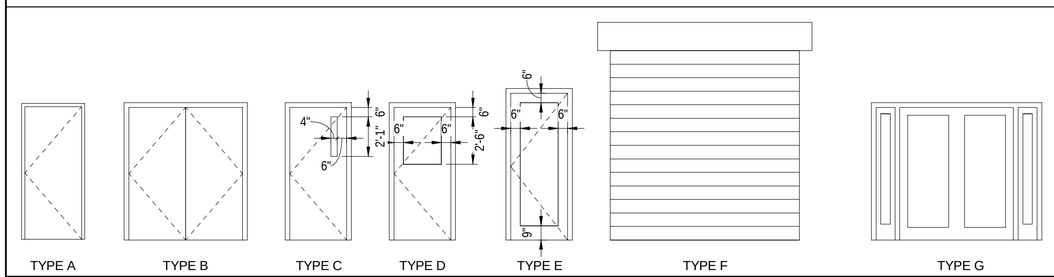

TYPE A TYPE B TYPE C TYPE D TYPE E TYPE F TYPE G

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
SIZE: 22" x 34"
CKD BY: Checker
PLOT SCALE:
PLOT DATE: 1/12/2012 8:52:44 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
DOOR SCHEDULE

SHEET IDENTIFICATION
A-602
SHEET OF 1

A A-602-

WINDOW SCHEDULE

MARK	UNIT DIMENSIONS WIDTH	UNIT DIMENSIONS HEIGHT	TYPE	FRAME FINISH	FRAME MATERIAL	GLAZING TYPE	GLAZING THICKNESS	GLAZING SHGC	DETAILS HEAD	DETAILS JAMB	DETAILS SILL	REMARKS (SEE NOTES BELOW)
A	4'-4"	5'-2 1/2"	Double Hung with Trim_TEST					0.25				
B	3'-4"	5'-2 1/2"	Double Hung with Trim_TEST									
C	3'-0"	4'-0"	Windows-Transaction-Protective_Structures-Bullet_Resistant-Acrylic_Circular_Voice_Port									
D	2'-0"	4'-8"	Window_Fixed									
E	5'-0"	4'-4"	Window_Fixed									
F	2'-0"	5'-4"	Window_Fixed					0.25				
G	4'-4"	5'-2 1/2"	Double Hung with Trim_TEST									

WINDOW TYPES

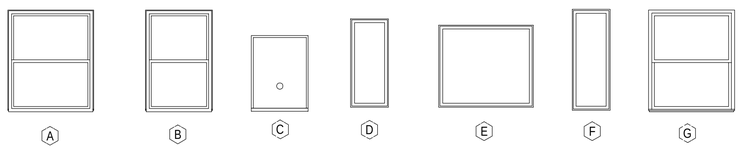

WINDOW DETAILS

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
CKD BY: Checker
PLOT DATE: 11/2/2012 10:26:47 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
WINDOW SCHEDULE

SHEET IDENTIFICATION
A-603
SHEET OF 1

A-603-

ROOM FINISH SCHEDULE

ROOM NO	ROOM NAME	WALL								BASE FINISH				FLOOR		CEILING			NOTES & REMARKS (SEE NOTES)
		NORTH		EAST		SOUTH		WEST											
		MAT'L	FIN.	MAT'L	FIN.	MAT'L	FIN.	MAT'L	FIN.	NORTH	EAST	SOUTH	WEST	MAT'L	FIN.	MAT'L	FIN.	HEIGHT	
001	ENTRY VESTIBULE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	CT	CT	CT	CT	ENTRYWAY MAT SYS/CT		GB	PTD	9'-0"	ENTRYWAY MAT SYS INCLUDES ABSORPTION + FINISHING SURFACES
002	VESTIBULE WEST	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	CT	CT	CT	CT	ENTRYWAY MAT SYS/CT		GYP BD	PTD	9'-0"	ENTRYWAY MAT SYS INCLUDES ABSORPTION + FINISHING SURFACES
003	VESTIBULE NORTH	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	CT	CT	CT	CT	ENTRYWAY MAT SYS/CT		GYP BD	PTD	9'-0"	ENTRYWAY MAT SYS INCLUDES ABSORPTION + FINISHING SURFACES
101	VISITOR WAITING AREA	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	CT	CT	CT	CT	CT		ACT	MFG STANDARD	9'-0"	WOOD CHAIR RAIL
102	CORRIDOR	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET TILE		ACT	MFG STANDARD	9'-0"	WOOD CHAIR RAIL
103	MEN	GYP BD	CT/PTD	GYP BD	CT/PTD	GYP BD	CT/PTD	GYP BD	CT/PTD	CT	CT	CT	CT	CT		WATER RESISTENT GYP BD	PTD	9'-0"	
104	WOMEN	GYP BD	CT/PTD	GYP BD	CT/PTD	GYP BD	CT/PTD	GYP BD	CT/PTD	CT	CT	CT	CT	CT		WATER RESISTENT GYP BD	PTD	9'-0"	
105	CORRIDOR	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET TILE		ACT	MFG STANDARD	9'-0"	WOOD CHAIR RAIL
106	MULTI-PURPOSE LOUNGE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT FLOORING		ACT	MFG STANDARD	9'-0"	WOOD CHAIR RAIL
107	SHOWER	GYP BD	CT/PTD	GYP BD	CT/PTD	GYP BD	CT/PTD	GYP BD	CT/PTD	CT	CT	CT	CT	CT		WATER RESISTENT GYP BD	PTD	9'-0"	
108	SPECIAL AGENT IN CHARGE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
109	LARGE INTERVIEW ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
110	CRIMINAL INTELLIGENCE CENTER ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
111	SMALL INTERVIEW ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
112	SMALL INTERVIEW ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
113	PHOTO ID ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT FLOORING		ACT	MFG STANDARD	9'-0"	
114	CORRIDOR	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT FLOORING		ACT	MFG STANDARD	9'-0"	RESILIENT CHAIR RAIL
115	POLYGRAPH EXAM OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
116	POLYGRAPH EXAM ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
117	OBSERVATION ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
118	SUSPECT WAITING ROOM	GYP BD	PTD EPOXY	GYP BD	PTD EPOXY	GYP BD	PTD EPOXY	GYP BD	PTD EPOXY	EPOXY	EPOXY	EPOXY	EPOXY	CONCRETE	EPOXY	GYP BD	PTD	9'-0"	
119	SUSPECT TOILET	GYP BD	PTD EPOXY	GYP BD	PTD EPOXY	GYP BD	PTD EPOXY	GYP BD	PTD EPOXY	EPOXY	EPOXY	EPOXY	EPOXY	CONCRETE	EPOXY	GYP BD	PTD	9'-0"	
120	CORRIDOR	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT FLOORING		ACT	MFG STANDARD	9'-0"	RESILIENT CHAIR RAIL
121	EVIDENCE CUSTODIAN OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT FLOORING		ACT	MFG STANDARD	9'-0"	
122	EVIDENCE DEPOSITORY ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT FLOORING		ACT	MFG STANDARD	9'-0"	
123	DUTY AGENT OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT FLOORING		ACT	MFG STANDARD	9'-0"	
124	EVIDENCE PROCESSING	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	STATIC-CONTROL RESILIENT FLOORING		ACT	MFG STANDARD	9'-0"	
125	TABLE OF ORGANIZATION AND EQUIPMENT STORAGE	GYP BD/CMU	PTD EPOXY	CMU	PTD EPOXY	CMU	PTD EPOXY	GYP BD	PTD EPOXY	EPOXY	EPOXY	EPOXY	EPOXY	SEALED CONC		EXPOSED STRUCTURE	-	9'-0"	
126	ARMS VAULT	CONC	PTD EPOXY	CONC	PTD EPOXY	CONC	PTD EPOXY	CONC	PTD EPOXY	-	-	-	-	SEALED CONC		ACT	MFG STANDARD	9'-0"	
127	TELECOM ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	STATIC-CONTROL RESILIENT FLOORING		GYP BD	PTD	9'-0"	
128	MECHANICAL ROOM	GYP BD	PTD	CMU	PTD	CMU	PTD	CMU	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	SEALED CONC		EXPOSED STRUCTURE	-	9'-0"	
129	ELECTRICAL ROOM	GYP BD	PTD	CMU	PTD	CMU	PTD	CMU	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	SEALED CONC		EXPOSED STRUCTURE	-	9'-0"	
130	CRIMINAL INVESTIGATOR OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
131	CORRIDOR	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET TILE		ACT	MFG STANDARD	9'-0"	WOOD CHAIR RAIL
132	INVESTIGATIVE OPS TECH OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
133	DRUG SUPPRESSION TEAM OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
134	DRUG SUPPRESSION TEAM OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
135	SPECIAL AGENT OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
136	SPECIAL AGENT OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
137	SPECIAL AGENT OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
138	SPECIAL AGENT OFFICE	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
139	CORRIDOR	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET TILE		ACT	MFG STANDARD	9'-0"	WOOD CHAIR RAIL
140	RECYCLE CLOSET	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
141	ADMIN / OPS ROOM	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	RESILIENT WALL BASE	CARPET		ACT	MFG STANDARD	9'-0"	
142	JANITOR	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	GYP BD	PTD	CT	CT	CT	CT	CT		WATER RESISTENT GYP BD	PTD	9'-0"	

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:
DESIGN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Designer
PLOT DATE: 1/12/2012 8:52:46 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
FINISH SCHEDULE

SHEET IDENTIFICATION
A-604
SHEET OF 1

A-604-

SIGNAGE SCHEDULE

Number	Name	Type	Quantity	Message	Comments
001	ENTRY VESTIBULE				
002	VESTIBULE WEST				
003	VESTIBULE NORTH				
101	VISITOR WAITING AREA				
102	CORRIDOR				
103	MEN				
104	WOMEN				
105	CORRIDOR				
106	MULTI-PURPOSE LOUNGE				
107	SHOWER				
108	SPECIAL AGENT IN CHARGE				
109	LARGE INTERVIEW ROOM				
110	CRIMINAL INTELLIGENCE CENTER ROOM				
111	SMALL INTERVIEW ROOM				
112	SMALL INTERVIEW ROOM				
113	PHOTO ID ROOM				
114	CORRIDOR				
115	POLYGRAPH EXAM OFFICE				
116	POLYGRAPH EXAM ROOM				
117	OBSERVATION ROOM				
118	SUSPECT WAITING ROOM				
119	SUSPECT TOILET				
120	CORRIDOR				
121	EVIDENCE CUSTODIAN OFFICE				
122	EVIDENCE DEPOSITORY ROOM				
123	DUTY AGENT OFFICE				
124	EVIDENCE PROCESSING				
125	TABLE OF ORGANIZATION AND EQUIPMENT STORAGE				
126	ARMS VAULT				
127	TELECOM ROOM				
128	MECHANICAL ROOM				
129	ELECTRICAL ROOM				
130	CRIMINAL INVESTIGATOR OFFICE				
131	CORRIDOR				
132	INVESTIGATIVE OPS TECH OFFICE				
133	DRUG SUPPRESSION TEAM OFFICE				
134	DRUG SUPPRESSION TEAM OFFICE				
135	SPECIAL AGENT OFFICE				
136	SPECIAL AGENT OFFICE				
137	SPECIAL AGENT OFFICE				
138	SPECIAL AGENT OFFICE				
139	CORRIDOR				
140	RECYCLE CLOSET				
141	ADMIN / OPS ROOM				
142	JANITOR				

ROOM SIGNAGE TYPES



SIGN TYPE: A

PLASTIC FRAME
CATEGORY: ROOM ID



SIGN TYPE: B

PLASTIC FRAME
CATEGORY: ROOM ID WITH REMOVABLE NAMEPLATE



SIGN TYPE: C

PLASTIC FRAME
CATEGORY: ROOM ID WITH ALTERNATING MESSAGE PLAQUE



SIGN TYPE: D

CATEGORY: ROOM NAME



SIGN TYPE: E

CATEGORY: ADA



SIGN TYPE: F

CATEGORY: ADA

SIGN TYPE: G

CATEGORY: ADA

SIGN TYPE: H

CATEGORY: ADA

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 1/22/2012 8:32:40 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
SIGNAGE SCHEDULE

SHEET IDENTIFICATION
A-703
SHEET OF 1

A-703-

A1 PERSPECTIVE VIEW

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIRCLE
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Designer
PLOT SCALE:
SIZE: 22" x 34"
DATE: SEPTEMBER 12, 2012
CKD BY: Checker
PLOT DATE: 11/22/2012 9:51:48 AM
FILE NAME:
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
PERSPECTIVE VIEWS

SHEET IDENTIFICATION
A-901
SHEET OF 1

A A-901-

A1 FIRST FLOOR PLAN

1/8" = 1'-0"

PLAN NORTH

8 6 4 2 0 8 16

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®

NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012

SOLICITATION NO.:

CONTRACT NO.:

FILE NUMBER:

DESIGN BY: Designer

DRAWN BY: Author

SBMT BY: Approver

PLOT SCALE:

CKD BY: Checker

PLOT DATE: 11/2/2012 8:30:24 AM

FILE NAME:

SIZE: 22" x 34"

US ARMY CORPS OF ENGINEERS

NORFOLK DISTRICT

NORFOLK, VA

PARSONS BRINCKERHOFF

6135 KEMPSVILLE CIR

NORFOLK, VA 23502

SUITE 110

US ARMY

CRIMINAL INVESTIGATION COMMAND

FIELD OPERATION BUILDING, RA10-15

ADAPT-BUILD-FORT DRUM, NY

FURNITURE PLAN

SHEET IDENTIFICATION

IF-101

SHEET OF 1

IF-101-

FF&E PROCUREMENT SCHEDULE

Type Mark	Item	Description	Justification	Environmental	Manufacturer	Model No.	Style	Dimensions	Alternate Manufacturers	Category	Dealer/ Supplier	GSA Contract No.	GSA Expiration	GSA SIN	Freight	MOL	Count
A-1	MARKER BOARD	MARKER BOARD WITH ALUMINUM FRAME AND TRAY	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY					72" WIDE BY 36" HIGH									2
B-2	OPEN SHELVING	HEAVY DUTY INDUSTRIAL OPEN METAL SHELVING, 5 SHELVES EACH WITH A 400 POUND CAPACITY	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY					48" WIDE BY 24" DEEP BY 84" HIGH									4
B-4	OPEN SHELVING	HEAVY DUTY INDUSTRIAL OPEN METAL SHELVING, 5 SHELVES EACH WITH A 400 POUND CAPACITY	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY					48" WIDE BY 36" DEEP BY 84" HIGH									11
B-5	CLOSED SHELVING	HEAVY DUTY INDUSTRIAL CLOSED METAL SHELVING, 400 POUND CAPACITY	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY					48" WIDE BY 18" DEEP BY 84" HIGH									8
B-8	METAL BOOKCASE	FREESTANDING THREE SHELF METAL BOOKCASE, ADJUSTABLE SHELVES, POWDER COAT PAINT FINISH	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.					36" WIDE BY 42" HIGH									9
B-9	METAL BOOKCASE	FREESTANDING FOUR SHELF METAL BOOKCASE, ADJUSTABLE SHELVES, POWDER COAT PAINT FINISH	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.					36" WIDE									1
C-1	WOOD CREDENZA	WOOD CREDENZA WITH DOORS, WOOD VENEER AND FINISH TO MATCH CONFERENCE TABLE, METAL PULLS, SOLID WOOD MITERED EDGE AT TOP	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				24" WIDE BY 28-1/2" HIGH BY 72" LONG									1
C-2	LATERAL FILE	FREESTANDING WOOD LATERAL FILE, ADJUSTABLE LEVELING GLIDES, CENTRAL LOCKING, ANTI-TIP, FRONT-TO-BACK AND SIDE-TO-SIDE FILING OPTIONS	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				36" WIDE									1
C-4	LATERAL FILE	METAL LATERAL FILE, TWO DRAWER WITH POWDER COAT PAINT FINISH, ADJUSTABLE LEVELING GLIDES, CENTRAL LOCKING CAPABILITY, AND ANTI-TIP MECHANISM, FRONT-TO-BACK AND SIDE-TO-SIDE FILING OPTIONS	THIS PRODUCT IS SELECTED TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	98% RECYCLABLE MBDC SILVER CRADLE TO CRADLE CERTIFIED				36" WIDE									2
C-5	LATERAL FILE	METAL LATERAL FILE, THREE DRAWER WITH POWDER COAT PAINT FINISH, ADJUSTABLE LEVELING GLIDES, CENTRAL LOCKING CAPABILITY, AND ANTI-TIP MECHANISM, FRONT-TO-BACK AND SIDE-TO-SIDE FILING OPTIONS	THIS PRODUCT IS SELECTED TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	98% RECYCLABLE MBDC SILVER CRADLE TO CRADLE CERTIFIED				36" WIDE									15
C-6	LATERAL FILE	METAL LATERAL FILE, FOUR DRAWER WITH POWDER COAT PAINT FINISH, ADJUSTABLE LEVELING GLIDES, CENTRAL LOCKING CAPABILITY, AND ANTI-TIP MECHANISM, FRONT-TO-BACK AND SIDE-TO-SIDE FILING OPTIONS	THIS PRODUCT IS SELECTED TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	98% RECYCLABLE MBDC SILVER CRADLE TO CRADLE CERTIFIED				36" WIDE									1
D-2	DESK WITH RETURN AND HUTCH	METAL DESK WITH RETURN AND LOCKABLE DRAWER PEDESTALS	THIS PRODUCT IS SELECTED TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION													2
D-3	WOOD DESK WITH RETURN, CREDENZA AND HUTCH	WOOD DESK WITH RETURN, CREDENZA AND HUTCH	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				36" WIDE BY 72" LONG DESK, 24" BY 48" RETURN, 72" LONG CREDENZA									1
D-4	DESK WITH RETURN	METAL DESK WITH RETURN AND LOCKABLE DRAWER PEDESTALS	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION				36" WIDE BY 72" LONG DESK, 24" BY 48" RETURN, 72" LONG CREDENZA									15
D-6	DESK WITH RETURN AND HUTCH	METAL DESK WITH PEDESTALS, RETURN AND CREDENZA, NOMINAL 6 FEET BY 8 FEET WORK AREA PLAN DIMENSIONS		NSF BIFMA e3 LEVEL 1 CERTIFICATION				36" WIDE BY 72" LONG DESK, 24" BY 48" RETURN, 72" LONG CRENDEZA									1
D-7	DESK WITH RETURN	METAL DESK WITH RETURN AND LOCKABLE DRAWER PEDESTALS	THIS PRODUCT IS SELECTED TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION				36" WIDE BY 72" LONG DESK, 24" BY 42" RETURN									4
D-10	DESK	METAL DESK WITH PLASTIC LAMINATE TOP	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY	NSF BIFMA e3 LEVEL 1 CERTIFICATION				30" WIDE BY 60" LONG									2
D-13	CORNER WORK STATION	CORNER WORK STATION INCLUDING PLASTIC LAMINANTE WORKSURFACES AND TWO PEDESTAL DRAWER UNITS	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION													1
E-1	SECURITY CAMERA	INTERIOR, FIXED, ADJUSTABLE HEAD, SECURITY CAMERA	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP														5
E-2	SECURITY CAMERA	EXTERIOR, FIXED, ADJUSTABLE HEAD, SECURITY CAMERA	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP														8
E-3	RECORDER	HEAD END A/V EQUIPMENT FOR INTERVIEW RECORDING	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP														2
E-4	FUME HOOD	DESKTOP LABORATORY FUME EXHAUST HOOD, STAINLESS STEEL, NOT INCLUDED IN FF&E SCOPE	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP														1
E-5	EVIDENCE REFRIGERATOR	STAINLESS STEEL EVIDENCE REFRIGERATOR AND FREEZER, NOT INCLUDED IN FF&E SCOPE	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP					NOMINAL 36" WIDE BY 84" HIGH									1
E-6	MICROWAVE	UNDERCABINET MICROWAVE OVEN, FINISH TO MATCH OTHER APPLIANCES															1
E-7	FLAT SCREEN TV	FLAT SCREEN TELEVISION WITH WALL MOUNTING BRACKET	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP					72" DIAGONAL									4
L-1	GUN SAFE LOCKER	METAL GUN LOCKER, 1 FULL LENGTH UNIT	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP														2
L-2	GUN SAFE LOCKER	METAL GUN LOCKER, 2 COMPARTMENTS IN 1 FULL LENGTH UNIT	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP														4
L-3	GUN SAFE LOCKER	METAL GUN LOCKER, SET OF 3 FULL LENGTH UNITS	THIS PRODUCT IS REQUESTED BY THE CIDC USER GROUP														2

CODE	ITEM DESCRIPTION
A	ACCESSORIES
B	SHELVING AND BOOKCASES
C	STORAGE AND FILE CABINETS
D	DESKS
E	EQUIPMENT
L	LOCKERS
P	PANEL, SYSTEMS FURNITURE
S	SEATING
SA	SAFE
T	TABLES
WS	WORKSTATION

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK | DESCRIPTION | DATE | APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
CKD BY: Checker
PLOT DATE: 11/2/2012 8:28:22 AM
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

US ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATION BUILDING, RA10-15
ADAPT-BUILD-FORT DRUM, NY
FURNITURE SCHEDULE

SHEET IDENTIFICATION
IF-102
SHEET OF 1

IF-102-

FF&E PROCUREMENT SCHEDULE (CONTINUED)

Code	Item	Description	Justification	Environmental	Manufacturer	Model No.	Style	Dimensions	Alternate Manufacturers	Category	Dealer/ Supplier	GSA Contract No.	GSA Expiration	GSA SIN	Freight	MOL	Count
S-1	TASK CHAIR	ERGONOMIC MID-BACK TASK CHAIR WITH SWIVEL TILT PASSIVE SEAT MECHANISM, PNEUMATIC HEIGHT ADJUSTMENT, FIVE STAR BASE WITH CASTERS	THIS PRODUCT IS SELECTED FOR IT'S ERGONOMIC FEATURES AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION				26" BY 26-3/4" BY 42-1/2"									24
S-2	EXECUTIVE TASK CHAIR	ERGONOMIC MID-BACK EXECUTIVE CHAIR WITH SWIVEL TILT PASSIVE SEAT MECHANISM, PNEUMATIC HEIGHT ADJUSTMENT, FIVE STAR BASE WITH CASTERS	THIS PRODUCT IS SELECTED FOR IT'S ERGONOMIC FEATURES AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION				26" BY 26-3/4" BY 42-1/2"									1
S-3	CONFERENCE CHAIR	ERGONOMIC MID-BACK CHAIR WITH ARMS, SWIVEL KNEE TILT MECHANISM,SINGLE LEVER TILT LOCK, PNEUMATIC HEIGHT ADJUSTMENT, WATERFALL EDGE SEAT, LUMBAR AND LATERAL BACK SUPPORT, FOUR STAR BASE WITH CASTERS	THIS PRODUCT IS SELECTED FOR IT'S ERGONOMIC FEATURES AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION				17-1/4" BY 25-1/8" BY 37-1/8"									15
S-4	SIDE CHAIR	SIDE CHAIR WITH METAL FRAME, BACK AND ARMS, UPHOLSTERED SEAT AND MESH BACK	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION				SEAT 21" WIDE BY 24" DEEP, BACK 19" WIDE BY 17" HIGH									27
S-5	BREAK ROOM CHAIR	STACKABLE FOUR LEG CHAIR WITHOUT ARMS, ADJUSTABLE BACK TENSION BASED ON WEIGHT OF OCCUPANT	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY	NSF BIFMA e3 LEVEL 1 CERTIFICATION				24" BY 17-1/2" BY 32"									18
S-6	WOOD STOOL	WOOD STOOL, STRAIGHT LEG, WITHOUT UPHOLSTERY OR CASTERS	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY					16" DIAMETER BY 28-1/2" HIGH									2
S-7	WOOD CHAIR	SOLID WOOD CHAIR WITH LEGS, WITHOUT UPHOLSTERY AND CASTERS	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT													7
S-8	GUEST CHAIR	GUEST CHAIR WITH WOOD FRAME, BACK AND ARMS, UPHOLSTERED SEAT AND BACK	THIS PRODUCT IS SELECTED FOR IT'S ERGONOMIC FEATURES AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION													4
S-10	SECTIONAL SOFA	UPHOLSTERED SECTIONAL SOFA	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION				NOMINAL 30" WIDE									4
S-11	SECTIONAL SOFA CORNER	UPHOLSTERED SECTIONAL SOFA CORNER SECTION	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION													1
S-12	HEAVY DUTY WOOD CHAIR	HEAVY DUTY SOLID WOOD CHAIR WITH LEGS, WITHOUT UPHOLSTERY OR CASTERS	THE PRODUCT MEETS THE REQUIREMENT FOR HEAVY DUTY WOOD SEATING IN THIS AREA	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT													4
SA-1	FIVE DRAWER SAFE	FIVE DRAWER GSA APPROVED CLASS 5 SECURITY CONTAINER INDIVIDUAL LOCKS ON DRAWERS, NOT INCLUDED IN FF&E SCOPE	THIS PRODUCT IS SELECTED FOR QUALITY, SECURITY AND DURABILITY					15" WIDE									5
SA-2	TWO DRAWER SAFE	TWO DRAWER GSA APPROVED CLASS 5 SECURITY CONTAINER INDIVIDUAL LOCKS ON DRAWERS, NOT INCLUDED IN FF&E SCOPE	THIS PRODUCT IS SELECTED FOR QUALITY, SECURITY AND DURABILITY					15" WIDE									1
T-1	SIDE TABLE	HEAVY DUTY WOOD SIDE TABLE	THE PRODUCT MEETS THE REQUIREMENT FOR HEAVY DUTY WOOD PRODUCTS IN THIS AREA	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				24" SQUARE BY 22" HIGH									2
T-2	SIDE TABLE	WOOD SIDE TABLE, FINISH AND STYLE TO COORDINATE WITH SECTIONAL SEATING	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				24" SQUARE BY 22" HIGH									1
T-3	LAYOUT TABLE	HEAVY DUTY INDUSTRIAL WORK TABLE, METAL LEGS AND FRAME, HEAVY GAUGE STEEL TOP	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY	98% RECYCLABLE MBDC SILVER CRADLE TO CRADLE CERTIFIED				36" WIDE BY 72" LONG BY 36" HIGH									2
T-4	CONFERENCE TABLE	WOOD CONFERENCE TABLE WITH TRESTLE BASE, WOOD VENEER TOP WITH SOLID WOOD EDGE	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				48" WIDE BY 84" LONG BY 29" HIGH									1
T-6	CONFERENCE TABLE	WOOD CONFERENCE TABLE WITH TRESTLE BASE, WOOD VENEER TOP WITH SOLID WOOD EDGE	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				42" WIDE BY 84" LONG BY 29" HIGH									1
T-7	SMALL RECTANGULAR TABLE	RECTANGULAR TABLE WITH LAMINATE TOP AND VINYL EDGE, FOUR STAR BASE WITH ADJUSTABLE LEGS	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				36" WIDE BY 60" LONG BY 29" HIGH									1
T-11	CONFERENCE TABLE	WOOD CONFERENCE TABLE WITH PEDESTAL BASE, WOOD VENEER TOP WITH SOLID WOOD EDGE	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	GREENGUARD CERTIFIED 81% PRECONSUMER RECYCLED CONTENT				36" DIAMETER BY 29" HIGH									1
T-14	BREAK ROOM TABLE	MULTI-PURPOSE TABLE WITH METAL FRAME AND PLASTIC LAMINATE TOP WITH WOOD EDGE, BASE WITH ADJUSTABLE GLIDES	THIS PRODUCT IS SELECTED FOR QUALITY AND DURABILITY, AND TO COORDINATE WITH OTHER OFFICE FURNITURE AND FINISHES.	NSF BIFMA e3 LEVEL 1 CERTIFICATION				36" WIDE BY 72" LONG BY 29" HIGH									3

CODE	ITEM DESCRIPTION
A	ACCESSORIES
B	SHELVING AND BOOKCASES
C	STORAGE AND FILE CABINETS
D	DESKS
E	EQUIPMENT
L	LOCKERS
P	PANEL, SYSTEMS FURNITURE
S	SEATING
SA	SAFE
T	TABLES
WS	WORKSTATION

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:
DESIGN BY: Designer
CKD BY: Checker
DRAWN BY: Author
PLOT DATE: 11/2/2012 8:52:32 AM
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6135 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

US ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATION BUILDING, RA10-15
ADAPT-BUILD-FORT DRUM, NY
FURNITURE SCHEDULE

SHEET IDENTIFICATION
IF-103
SHEET OF 1

IF-103-

GENERAL NOTE

1. PROVIDE RADIO FREQUENCY TRANSMITTER. MAYBE CONNECTED TO COMMUNICATE WITH BASE.

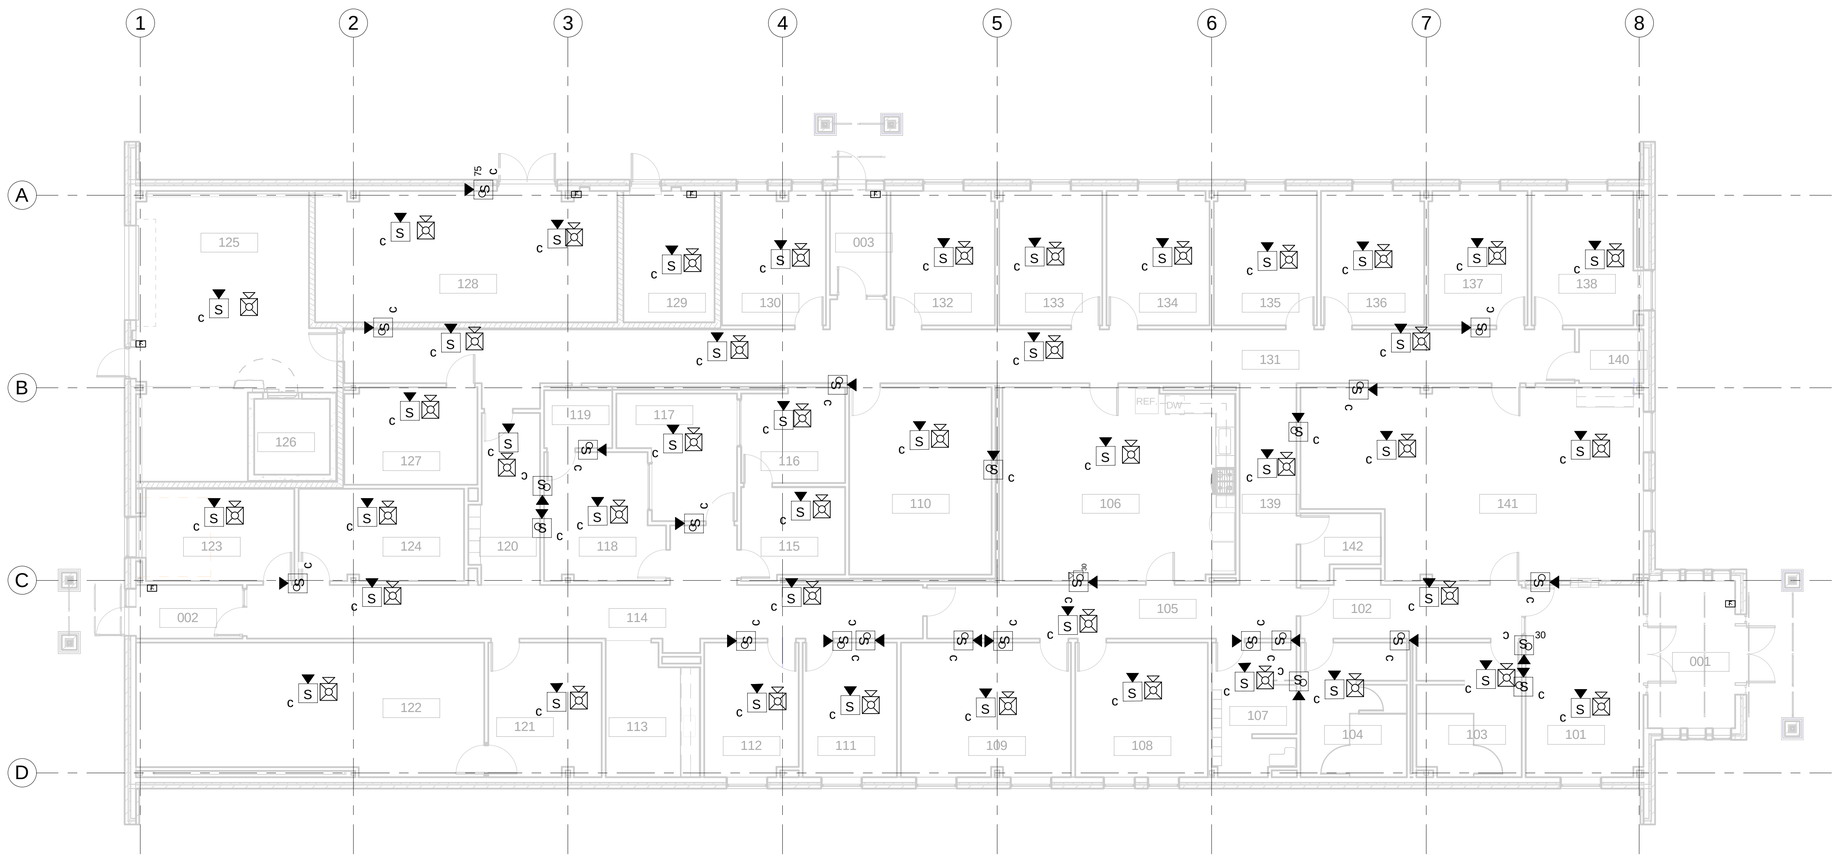

A1 FIRE ALARM PLAN
1/8" = 1'-0"

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer	DATE: SEPTEMBER 12, 2012
DRAWN BY: Author	SOLICITATION NO.:
CKD BY: Checker	CONTRACT NO.:
SBMT BY: Approver	PLOT DATE: 11/2/2012 9:14:27 AM
PLOT SCALE:	FILE NUMBER:
SIZE: 22" x 34"	FILE NAME:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDIND, RA 10-15
ADAPT-BUILD-FORT DRUM, NY
FIRE ALARM

SHEET IDENTIFICATION
FA-101
SHEET OF 0

FA-101-

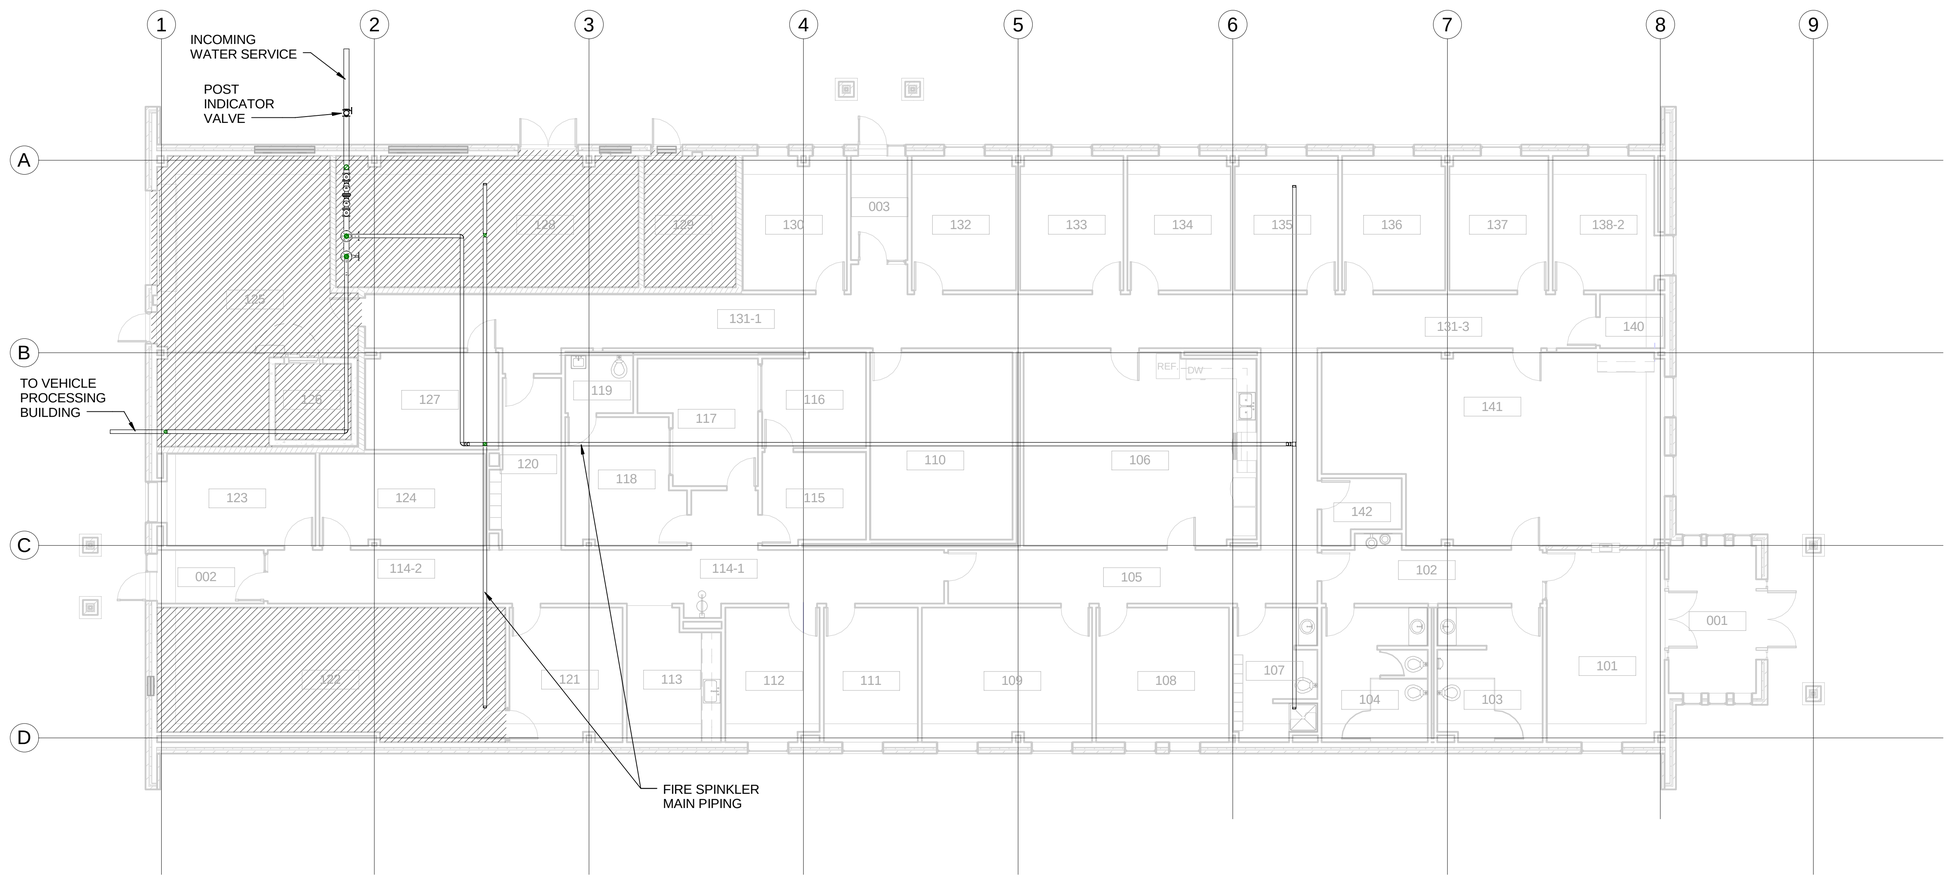

A1 FIRE PROTECTION PLAN

1/8" = 1'-0"

LEGEND

- LIGHT HAZARD
- ORDINARY HAZARD (GROUP 1)

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 9:09:54 AM
PLOT SCALE:
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

CRIMINAL INVESTIGATION COMMAND FIELD OPERATIONS BUILDING, RA 10-15 ADAPT- BUILD- FORT DRUM, NY

FIRE SPRINKLER PLAN

SHEET IDENTIFICATION

FX-101

SHEET OF 0

FX-101-

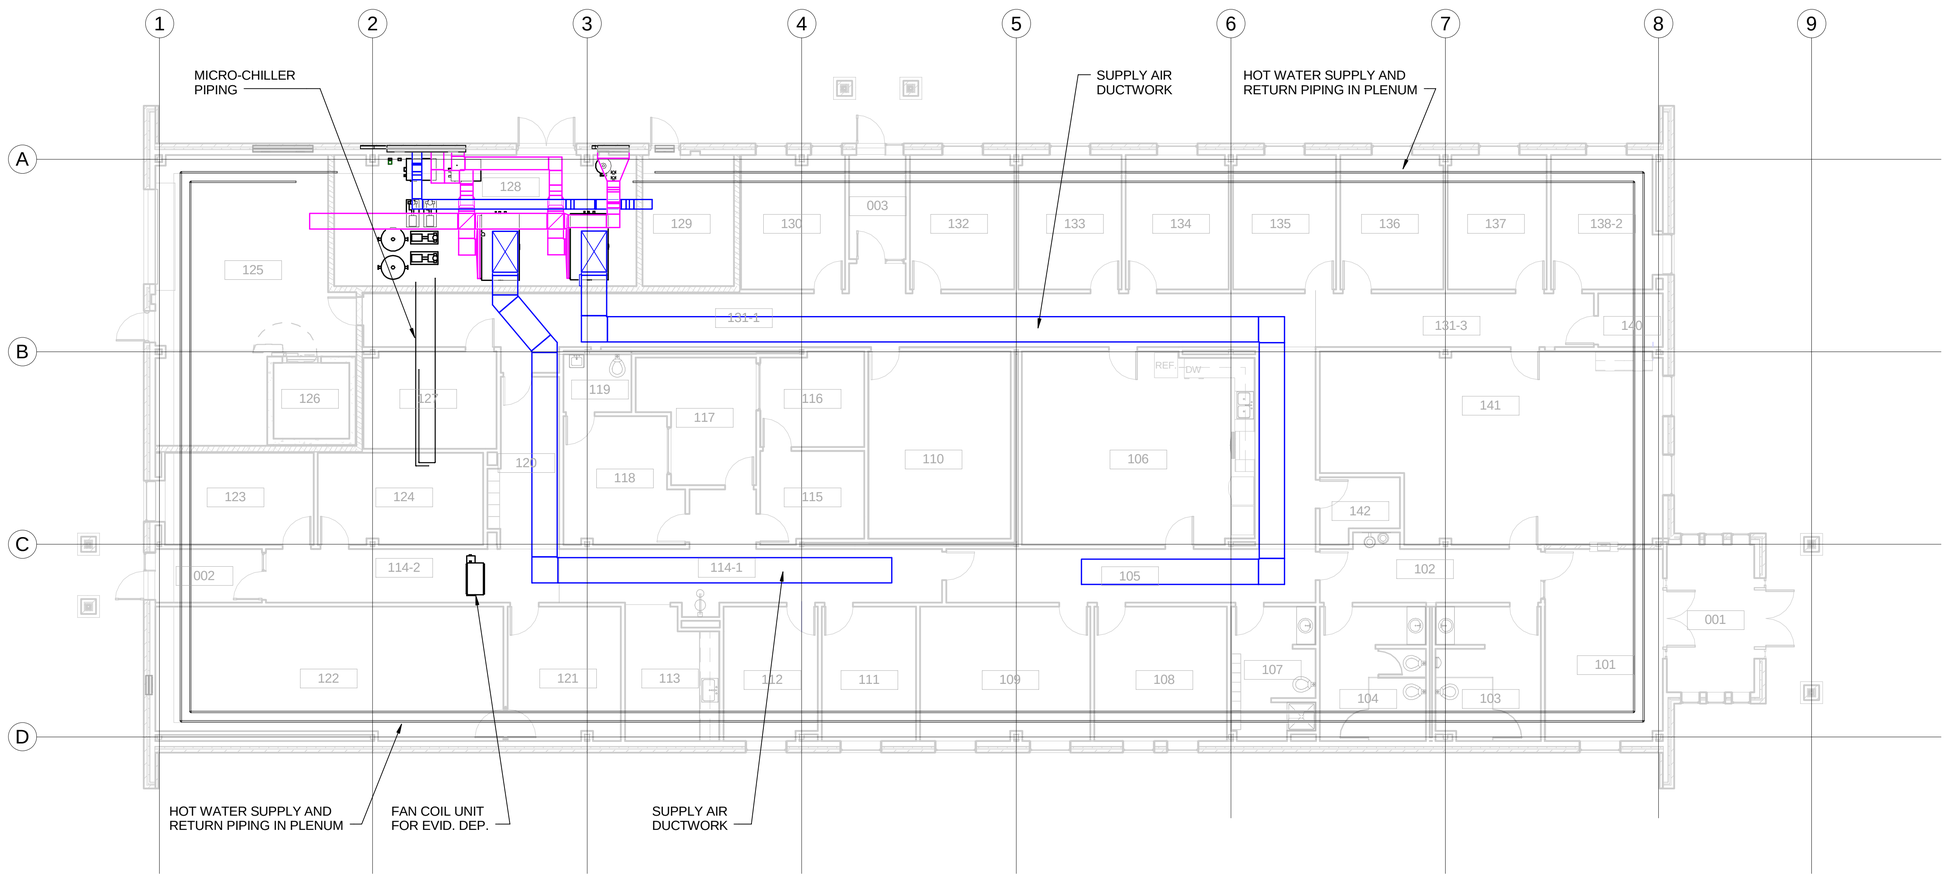

A1 MECHANICAL PLAN
1/8" = 1'-0"

PLAN NORTH

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:
PLOT DATE: 11/2/2012 9:06:57 AM
FILE NAME:
PLOT SCALE:
SIZE: 22" x 34"
DESIGN BY: Designer
DRAWN BY: Author
CKD BY: Checker
SBMT BY: Approver

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

CRIMINAL INVESTIGATION COMMAND FIELD OPERATIONS BUILDING, RA 10-15 ADAPT- BUILD- FORT DRUM, NY
MECHANICAL FLOOR PLAN

SHEET IDENTIFICATION
M-101
SHEET 0 OF 0

M-101-

LEGEND

ADMIN / OPS ROOM	EVIDENCE DEPOSITORY	RESTROOMS
CIC	EVIDENCE PROCESSING	SOUTHWEST OFFICES
CORE SUSPECT AREA	LARGE INTERVIEW / SAC	TELECOM ROOM
DUMMY	MECHANICAL ROOM	TOE STORAGE / ARMS VAULT
DUTY AGENT OFFICE	MULTIPURPOSE LOUNGE	VESTIBULE NORTH
EAST VESTIBULE	NORTH OFFICES	VESTIBULE WEST
ELECTRICAL ROOM	NORTHEAST OFFICES	VISITOR WAITING AREA

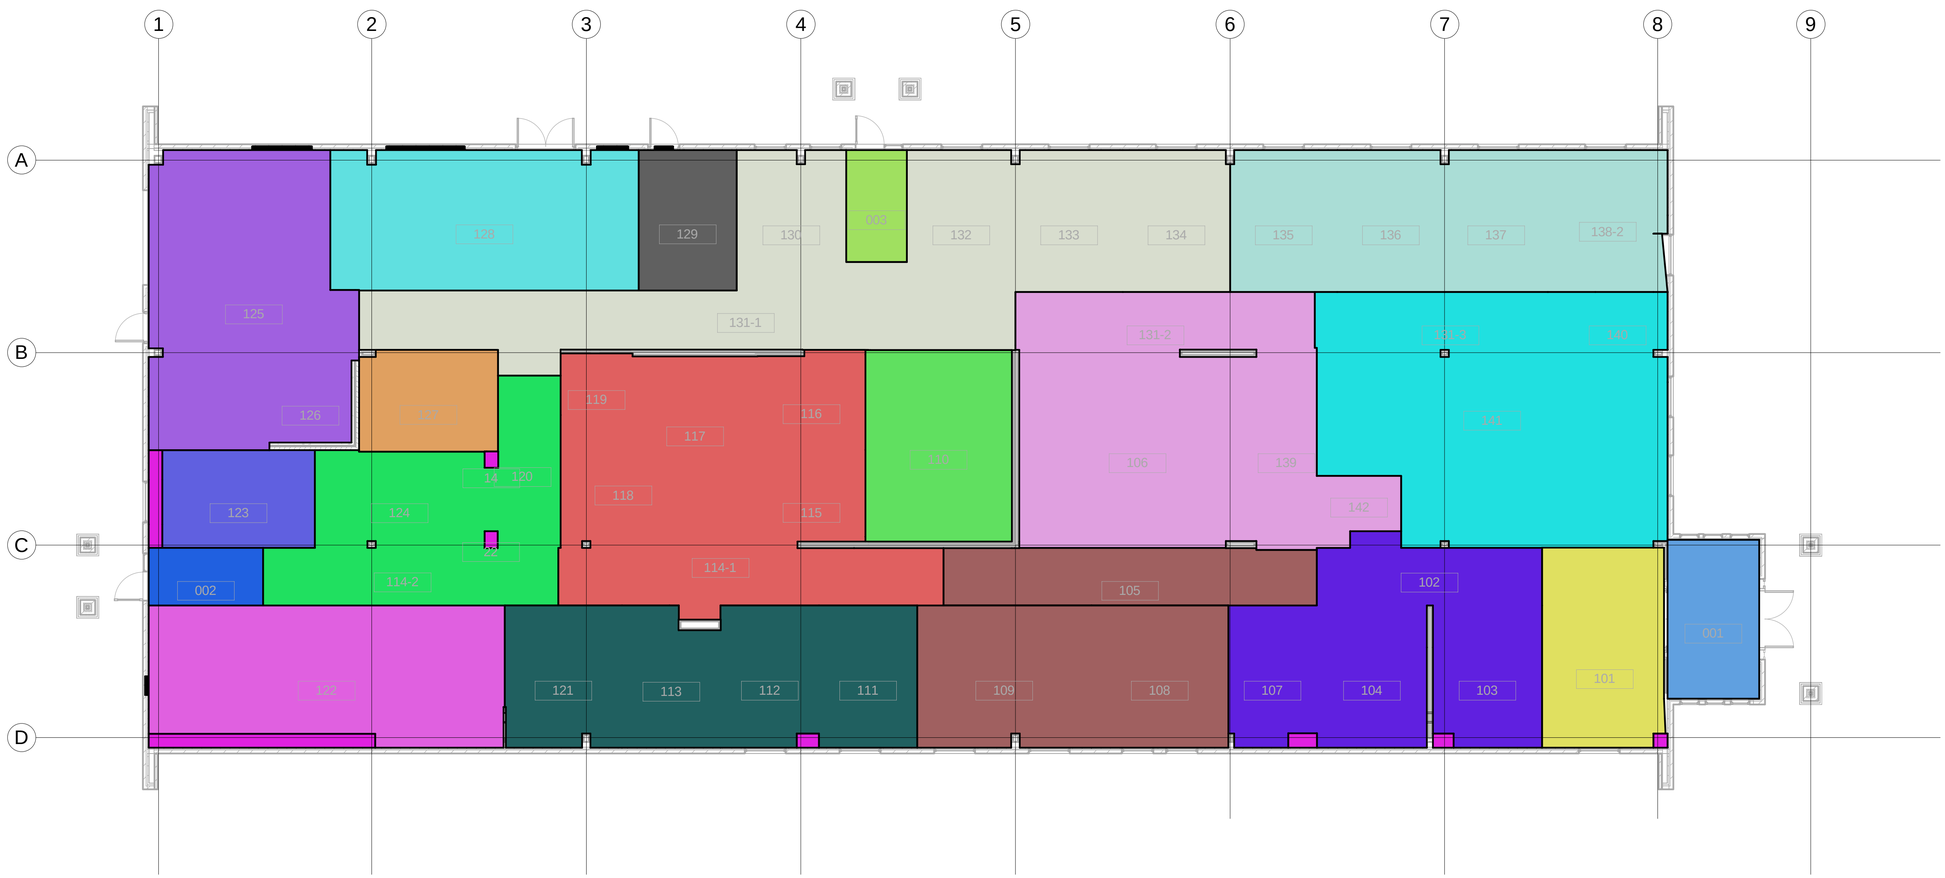

A1 HVAC THERMAL ZONES
1/8" = 1'-0"

PLAN NORTH

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
SIZE: 22" X 34"
CKD BY: Checker
PLOT DATE: 11/22/2012 9:10:00 AM
PLOT SCALE:
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

CRIMINAL INVESTIGATION COMMAND FIELD OPERATIONS BUILDING, RA 10-15 ADAPT- BUILD- FORT DRUM, NY

HVAC ZONES

SHEET IDENTIFICATION
M-102
SHEET OF 0

M-102-

SHEET NOTES EL-101

1 SWITCH FOR SUSPECT WAITING
2 SWITCH FOR SUSPECT TOILET
3 SWITCH FOR EXTERIOR LIGHT

A1 LIGHTING PLAN

1/8" = 1'-0"

PLAN NORTH

8 6 4 2 0 8 16

SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE: 1:1
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012, 9:14:21 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDIND, RA 10-15
ADAPT-BUILD-FORT DRUM, NY
ELECTRICAL LIGHTING PLAN

SHEET IDENTIFICATION
EL-101
SHEET OF 0

EL-101-

SHEET NOTES EP-101

1 8" ON CENTER ABOVE COUNTER.
2 RECEPTACLE FOR MICROWAVE
3 RECEPTACLE FOR STOVE
4 RECEPTACLE FOR TELEVISION. MOUNT AT 66" AFF
5 TAMPER RESISTANT RECEPTACLE.
6 RECEPTACLE FOR REFRIGERATOR.

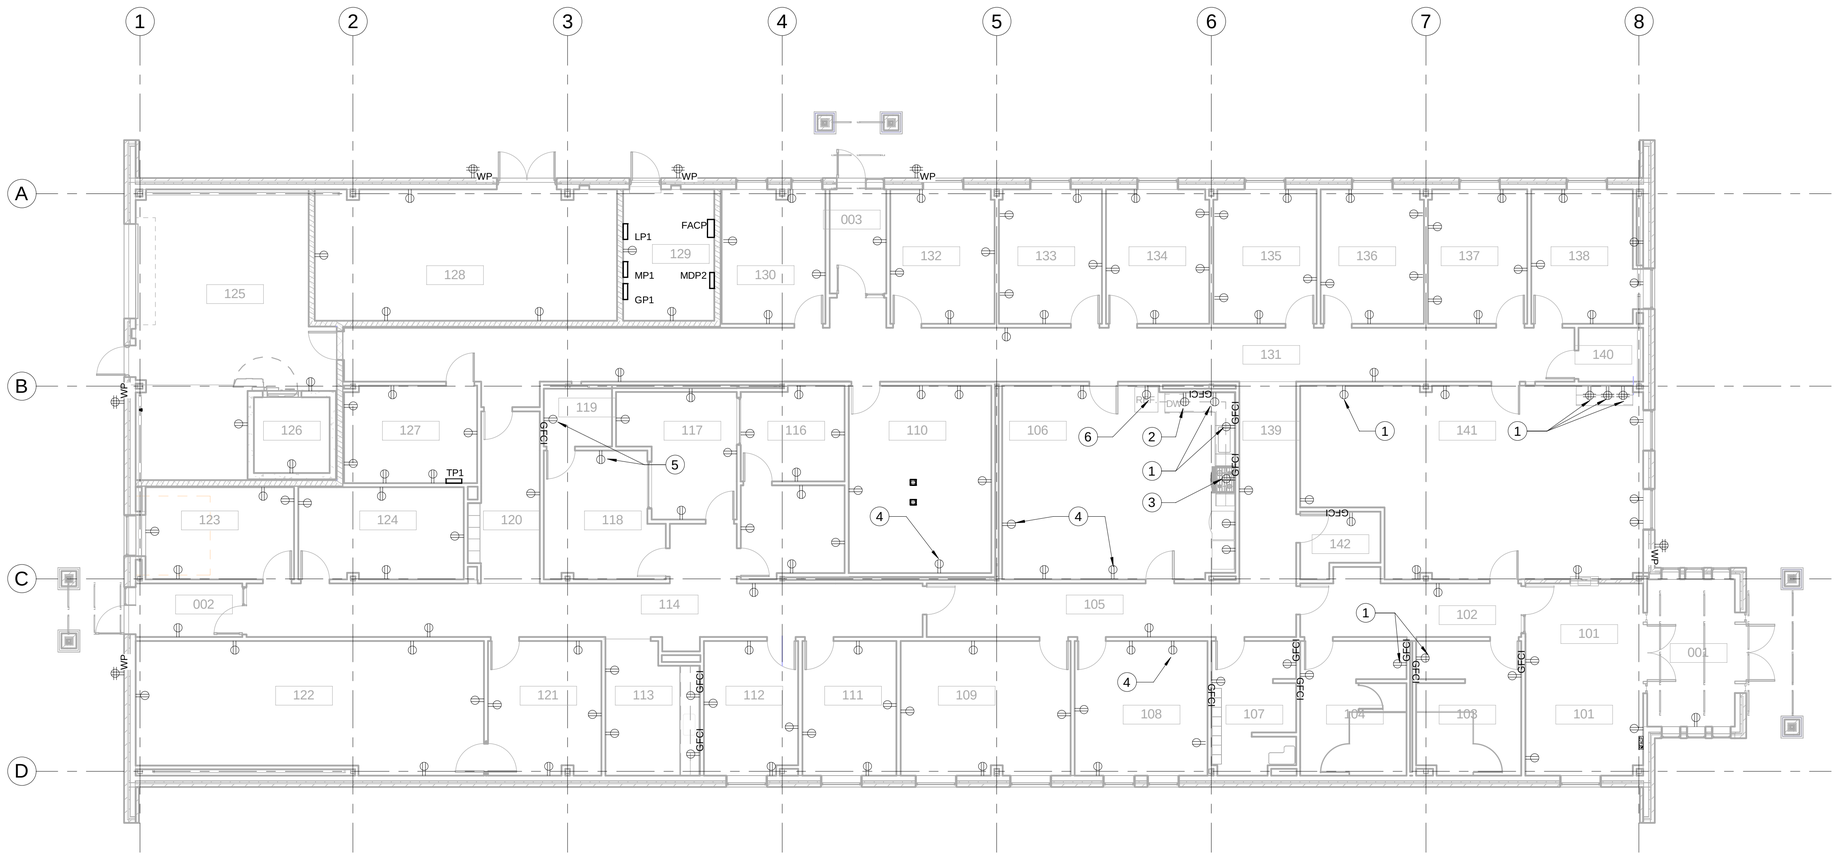

A1 POWER PLAN
1/8" = 1'-0"

PLAN NORTH

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/22/2012 9:14:24 AM
PLOT SCALE:
FILE NAME:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDIND, RA 10-15
ADAPT-BUILD-FORT DRUM, NY
ELECTRICAL POWER PLAN

SHEET IDENTIFICATION
EP-101
SHEET OF 0

EP-101-

SHEET NOTES EP-601

1 3 - 2 AWG 15-KV 133% EPR COPPER CONDUCTOR IN ONE (1) 4" TYPE EB SCHEDULE 20 CONCRETE ENCLOSED DUCKTBANK. PROVIDE 100% BARE CU GROUND.

2 4 - #4/0 AWG THN/THW IN ONE (1) 4" TYPE EB SCHEDULE 20 CONCRETE ENCLOSED DUCT BANK.

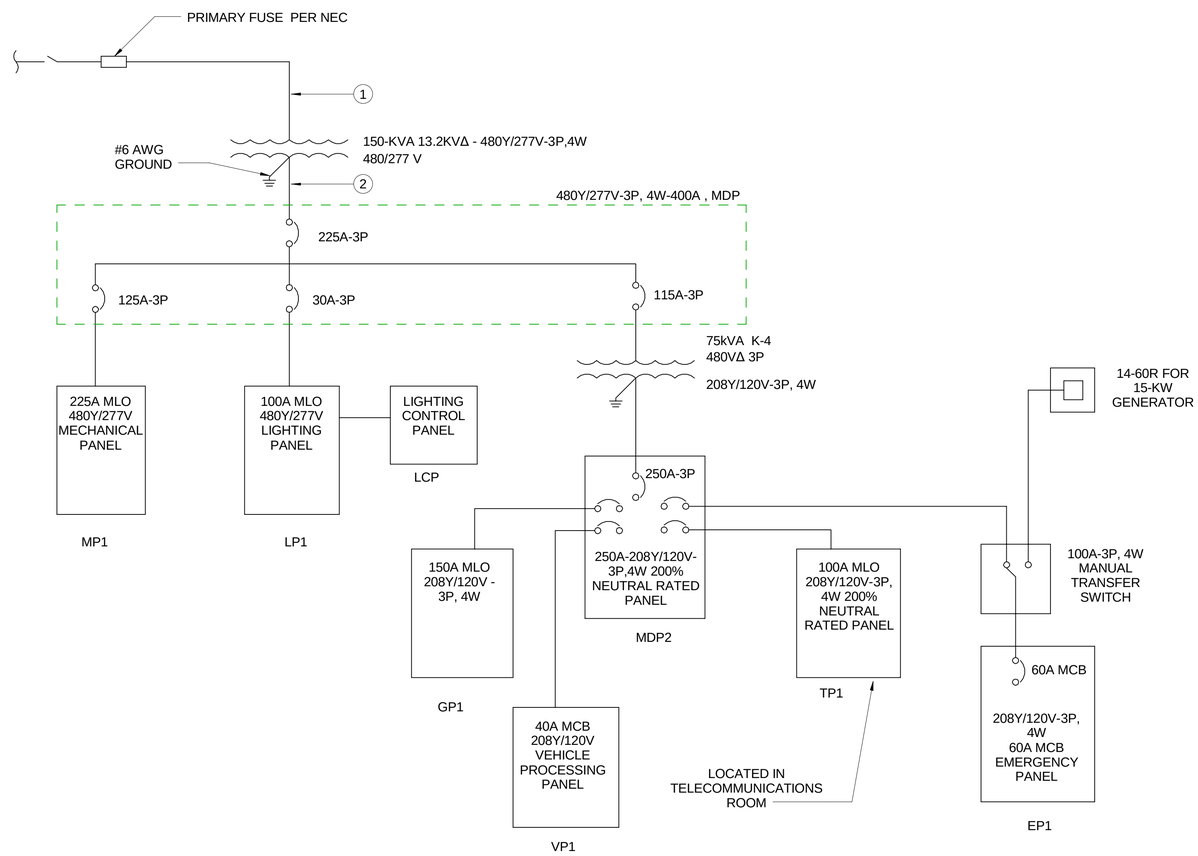

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
SIZE: 22" x 34"
CKD BY: Checker
PLOT SCALE:
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
PLOT DATE: 11/2/2012, 9:14:29 AM
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDIND, RA 10-15
ADAPT-BUILD-FORT DRUM, NY
ONE LINE DIAGRAM

SHEET IDENTIFICATION
EP-601
SHEET OF 0

EP-601-

CRIMINAL INVESTIGATION COMMAND FIELD OPERATIONS BUILDING

RA 10-15 VEHICLE PROCESSING BUILDING ADAPT-BUILD

FORT DRUM, NEW YORK

SEPTEMBER 12, 2012

CORRECTED FINAL SUBMISSION

SHEET INDEX

GENERAL

G-801 TITLE SHEET

STRUCTURAL

S-801 PLANS AND DETAILS
S-802 WALL SECTIONS

ARCHITECTURE

A-801 PLANS AND ELEVATIONS
A-802 SECTIONS AND SCHEDULES

MECHANICAL/ELECTRICAL

ME-801 MECHANICAL/ELECTRICAL PLAN

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 9/26/2012 3:41:13 PM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
TITLE SHEET

SHEET IDENTIFICATION
G-801
SHEET OF 1

G-801-

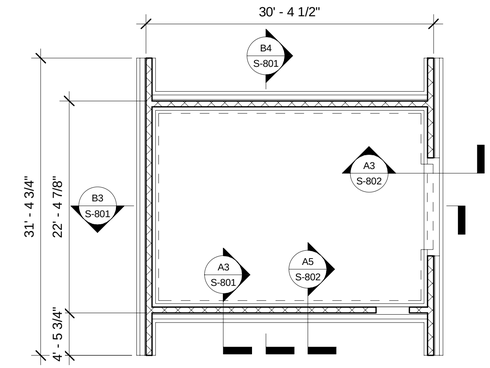

C3 FOUNDATION PLAN
1/8" = 1'-0"

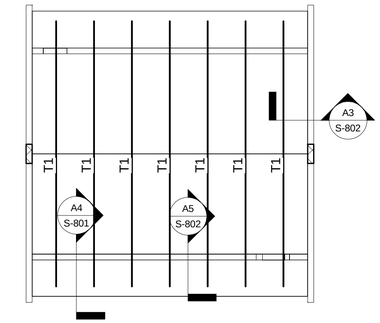

C4 ROOF FRAMING PLAN
1/8" = 1'-0"

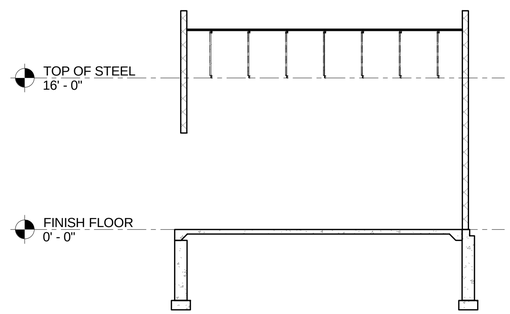

B3 LONGITUDINAL BUILDING SECTION
1/8" = 1'-0"

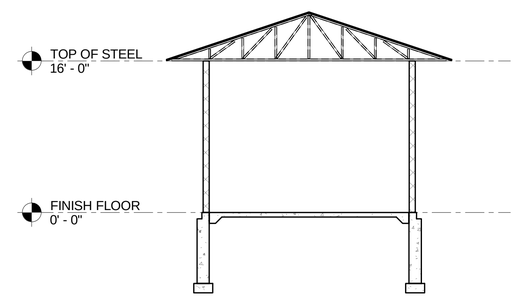

B4 TRANSVERSE BUILDING SECTION
1/8" = 1'-0"

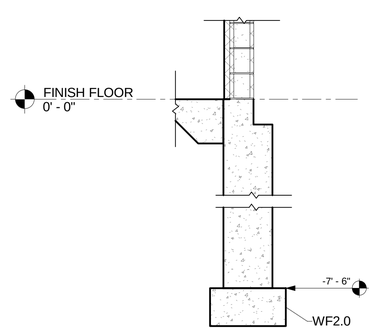

A3 TYPICAL FOOTING DETAIL
1/2" = 1'-0"

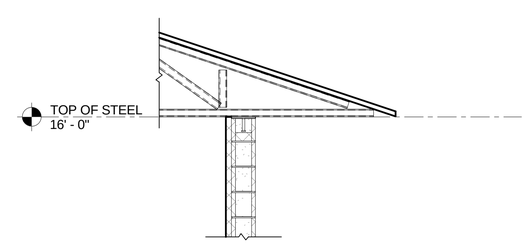

A4 TYPICAL TRUSS CONNECTION DETAIL
1/2" = 1'-0"

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

2 1 0 2 4
SCALE: 1/2"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 11/2/2012 9:18:32 AM
PLOT SCALE:
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD- FORT DRUM, NY
PLANS AND DETAILS

SHEET IDENTIFICATION
S-801
SHEET OF 500

S-801-

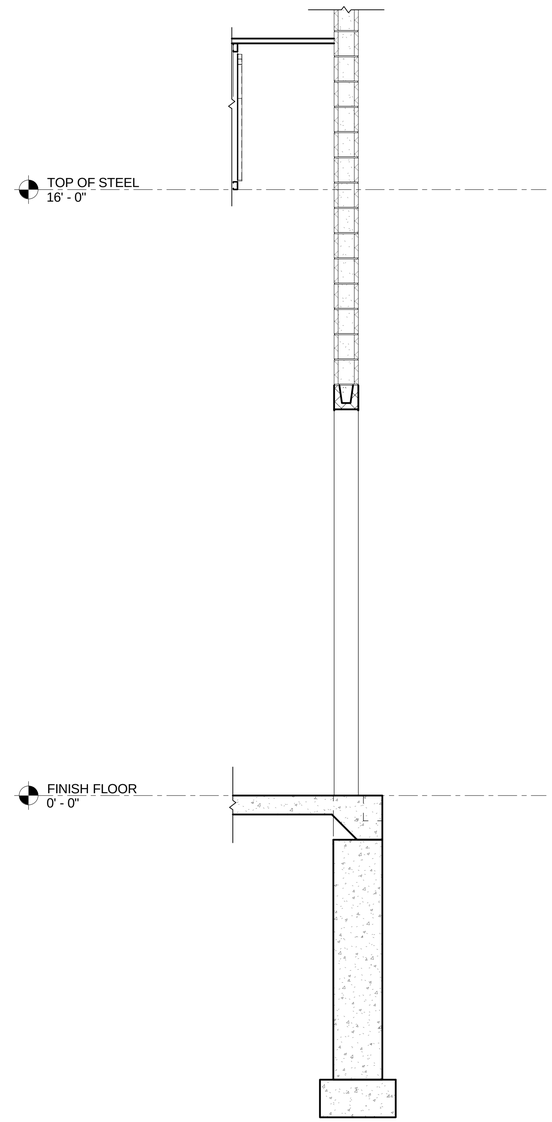

A3 WALL SECTION AT GARAGE DOOR
1/2" = 1'-0"

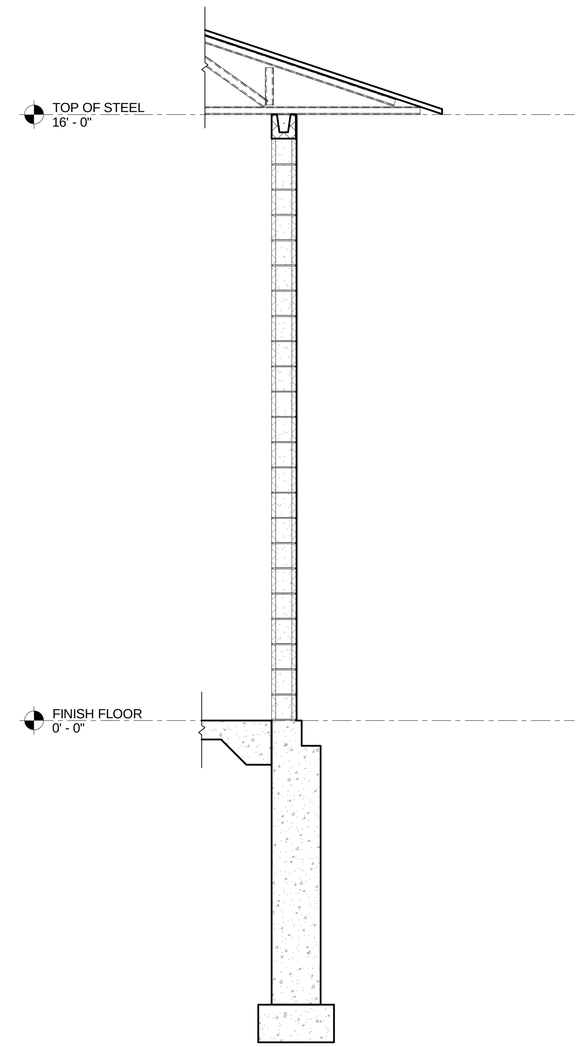

A5 TYPICAL WALL SECTION
1/2" = 1'-0"

2 1 0 2 4
SCALE: 1/2"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
SIZE: 22" x 34"
CKD BY: Checker
PLOT SCALE: 1:1
PLOT DATE: 11/2/2012, 9:18:32 AM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD- FORT DRUM, NY
WALL SECTIONS

SHEET IDENTIFICATION
S-802
SHEET OF 500

S-802-

LEGEND

XX" - CLEAR EXIT WIDTH

- TRAVEL DISTANCE

- 1-HOUR RATED WALL

- FIRE EXTINGUISHER

- EXIT SIGN

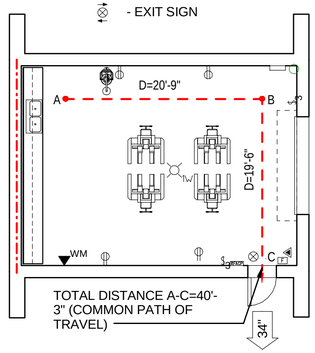

C1 LIFE SAFETY PLAN
1/8" = 1'-0"

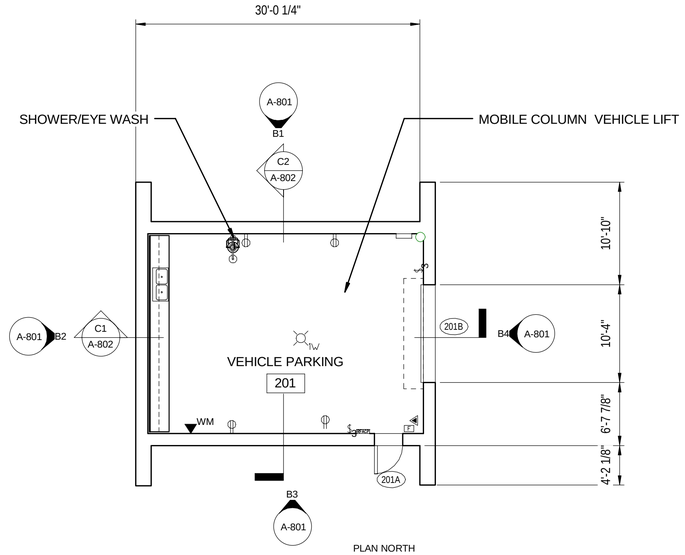

C2 FLOOR PLAN
1/8" = 1'-0"

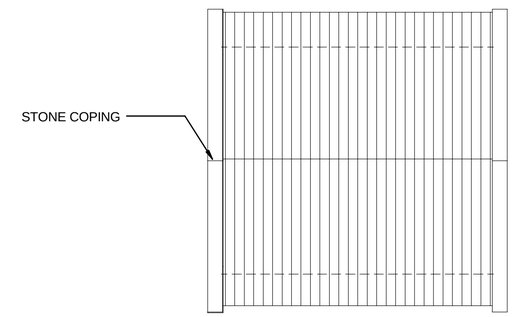

C4 ROOF PLAN
1/8" = 1'-0"

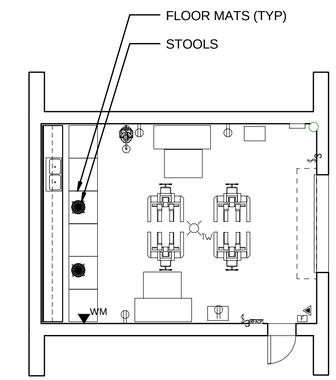

C5 FURNITURE PLAN
1/8" = 1'-0"

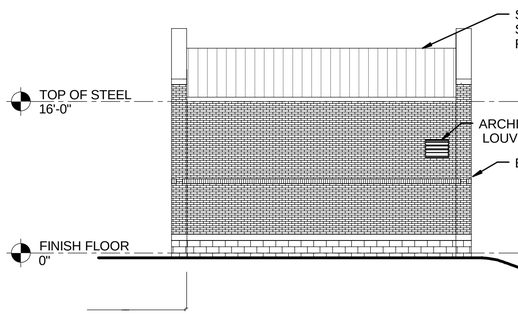

B1 NORTH ELEVATION
1/8" = 1'-0"

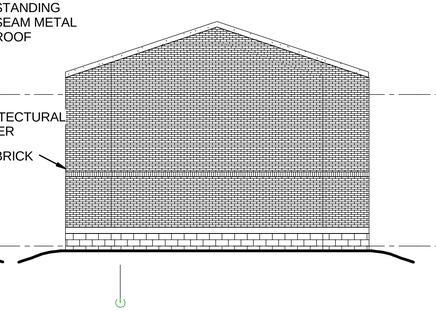

B2 WEST ELEVATION
1/8" = 1'-0"

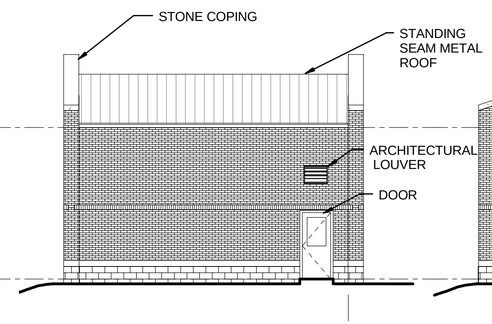

B3 SOUTH ELEVATION
1/8" = 1'-0"

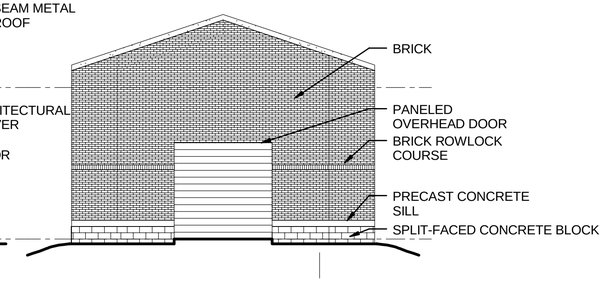

B4 EAST ELEVATION
1/8" = 1'-0"

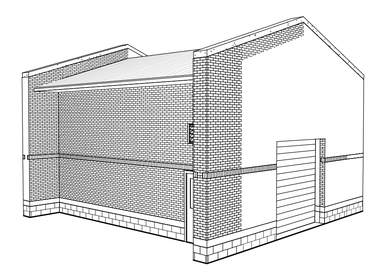

A4 PERSPECTIVE VIEW

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6135 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 9/28/2012 3:22:23 PM
PLOT SCALE: 1
FILE NAME: file name
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER: 232C61 112912

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
PLANS AND ELEVATIONS
Floor PLAN, ELEVATIONS & SECTIONS

SHEET IDENTIFICATION
A-801
SHEET OF 1

A L- A-801- XXX

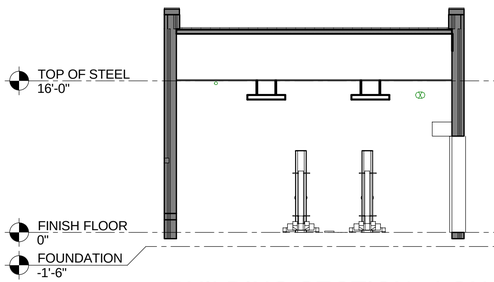

C1 BUILDING SECTION - LONGITUDINAL
1/8" = 1'-0"

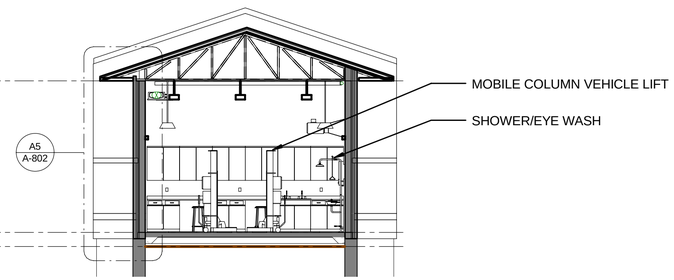

C2 BUILDING SECTION - TRANSVERSE
1/8" = 1'-0"

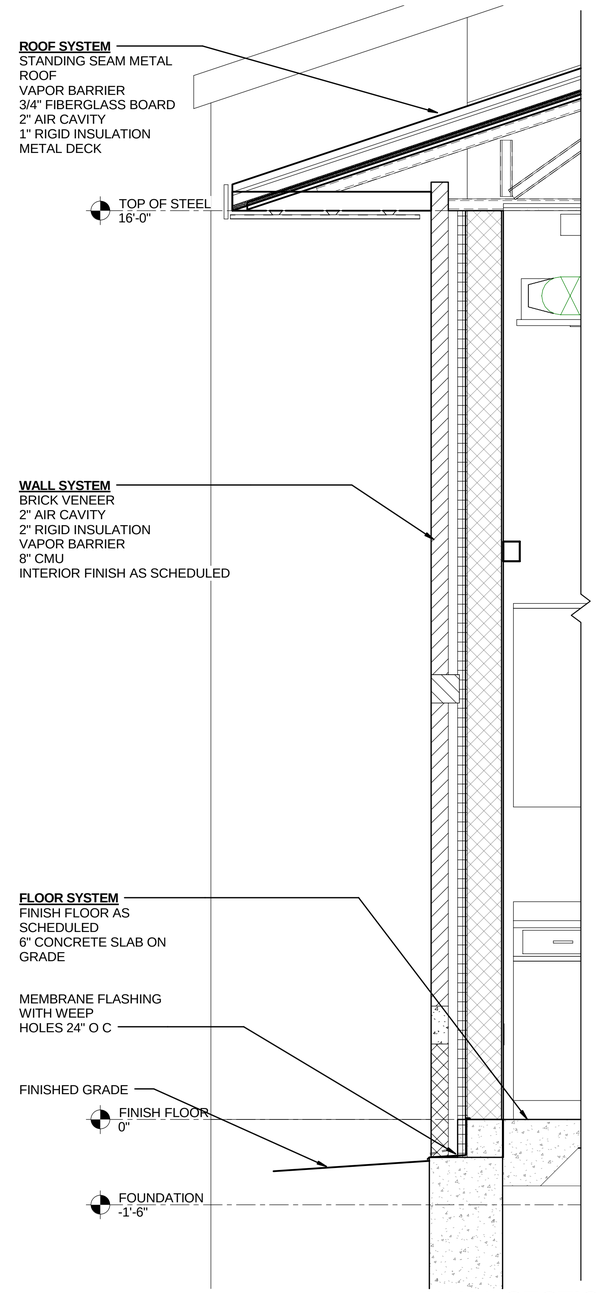

A5 WALL SECTION
3/4" = 1'-0"

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

2 1 0 2
SCALE: 3/4"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer
DRAWN BY: Author
SBMT BY: Approver
PLOT SCALE:
SIZE: 22" x 34"
CKD BY: Checker
PLOT DATE: 9/28/2012, 3:23:32 PM
FILE NAME:
DATE: SEPTEMBER 12, 2012
SOLICITATION NO.:
CONTRACT NO.:
FILE NUMBER:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
SECTIONS AND SCHEDULES

SHEET IDENTIFICATION
A-802
SHEET OF 1

A A-802-

LEGEND

ORDINARY HAZARD (GROUP 2)

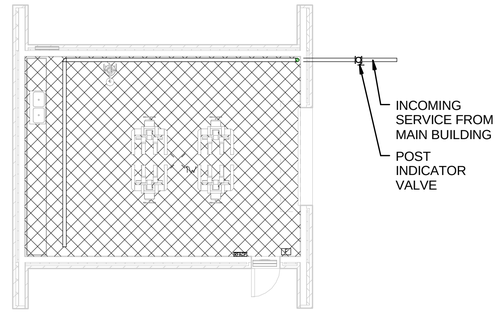

C3 FIRE PROTECTION PLAN
1/8" = 1'-0"

PLAN NORTH

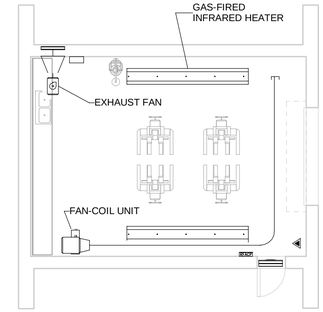

C4 MECHANICAL PLAN
1/8" = 1'-0"

PLAN NORTH

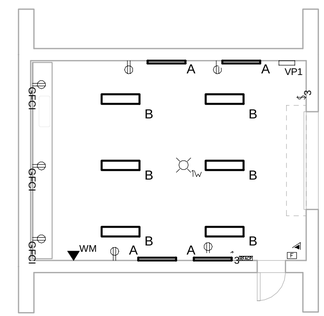

B4 ELECTRICAL PLAN
1/8" = 1'-0"

PLAN NORTH

8 6 4 2 0 8 16
SCALE: 1/8"=1'-0"

US Army Corps of Engineers ®
NORFOLK DISTRICT

MARK	DESCRIPTION	DATE	APPR.

US ARMY CORPS OF ENGINEERS
NORFOLK DISTRICT
NORFOLK, VA

PARSONS BRINCKERHOFF
6161 KEMPSVILLE CIR
NORFOLK, VA 23502
SUITE 110

DESIGN BY: Designer	DATE: SEPTEMBER 12, 2012
DRAWN BY: Author	CKD BY: Checker
SBMT BY: Approver	SOLICITATION NO.:
PLOT DATE: 9/28/2012, 3:23:33 PM	CONTRACT NO.:
PLOT SCALE: 1	FILE NUMBER:
SIZE: 22" x 34"	FILE NAME:

U.S. ARMY
CRIMINAL INVESTIGATION COMMAND
FIELD OPERATIONS BUILDING, RA 10-15
ADAPT-BUILD - FORT DRUM, NY
MECHANICAL/ELECTRICAL PLAN

SHEET IDENTIFICATION
ME-801
SHEET OF 1

ME-801-